




INSTALLATION MANUAL
AIR CONDITIONER (SPLIT TYPE)

R32

ENGLISH

ภาษาไทย

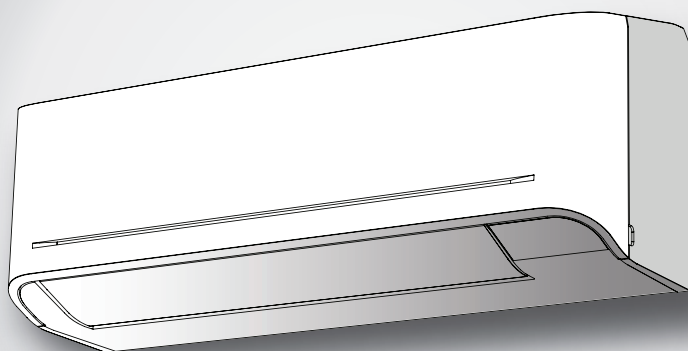

Indoor unit
42TVDA010, 013, 016, 018

Outdoor unit
38TVDA010, 013, 016, 018



1144180107

EN	CONTENTS	TH	สารบัญ
PRECAUTIONS FOR SAFETY	1	ข้อควรระวังเพื่อความปลอดภัย	1
ACCESSORY PARTS	5	ชิ้นส่วนอุปกรณ์เสริม	6
INSTALLATION DIAGRAM OF INDOOR AND OUTDOOR UNITS	6	ผังการติดตั้งตัวเครื่องภายในและภายนอก	7
■ Optional Installation Parts.....	6	■ ชิ้นส่วนในการติดตั้ง	7
INDOOR UNIT	7	ตัวเครื่องภายใน	8
■ Installation Place	7	■ สถานที่ติดตั้ง	8
■ Cutting a Hole and Mounting Installation Plate	7	■ การเจาะรูและการติดแผ่นติดตั้ง	8
■ Piping and Drain Hose Installation	8	■ การติดตั้งท่อน้ำทิ้งและท่อส่ง	9
■ Indoor Unit Fixing	8	■ การติดตั้งตัวเครื่องภายใน	10
■ Drainage	9	■ การระบายน้ำ	10
OUTDOOR UNIT	9	ตัวเครื่องภายนอก	11
■ Installation Place	9	■ สถานที่ติดตั้ง	11
■ Refrigerant Piping Connection	9	■ การต่อท่อส่งสารทำความเย็น	11
■ Evacuating	10	■ การไล่อากาศออก	12
ELECTRICAL WORKS	11	การทำงานเกี่ยวกับไฟฟ้า	13
■ Wiring Connection	11	■ การเชื่อมต่อสายไฟ	13
■ Power Supply and Connecting Cable Connection	12	■ แหล่งจ่ายไฟและการเชื่อมต่อสายเชื่อมต่อ	14
OTHERS	13	ระบบอื่นๆ	15
■ Gas Leak Test	13	■ การทดสอบการรั่วของสารทำความเย็น	15
■ Remote Control A-B Selection	13	■ การเลือกรีโมทคอนโทรล A-B	15
■ Test Operation	13	■ การทดสอบ	15
■ Auto Restart Function Setting.....	13	■ การตั้งค่าระบบเริ่มทำงานใหม่โดยอัตโนมัติ	15
APPENDIX	14	ภาคผนวก	16

PRECAUTIONS FOR SAFETY

	Read the precautions in this manual carefully before operating the unit.		This appliance is filled with R32.
---	--	---	------------------------------------

■ Warning indications on the air conditioner unit

Warning indication	Description
 CAUTION BURST HAZARD Open the service valves before the operation, otherwise there might be the burst.	CAUTION BURST HAZARD Open the service valves before the operation, otherwise there might be the burst.

- Before installation, please read these precautions for safety carefully.
- Be sure to follow the precautions provided here to avoid safety risks.

The symbols and their meanings are shown below.

WARNING : It indicates that incorrect use of this unit may cause severe injury or death.

CAUTION : It indicates that incorrect use of this unit may cause personal injury (*1), or property damage (*2).

*1: Personal injury means a slight accident, burn, or electrical shock which does not require admission or repeated hospital treatment.

*2: Property damage means greater damage which affects assets or resources.

For general public use

Power supply cord and connecting cable of appliance use shall be at least polychloroprene sheathed flexible cord (design H07RN-F) or cord designation 60245 IEC66. (Shall be installed in accordance with national wiring regulations.)

CAUTION To disconnect the appliance from the main power supply

This appliance must be connected to the main power supply by means of a circuit breaker or a switch with a contact separation of at least 3 mm in all poles.

DANGER

- FOR USE BY QUALIFIED PERSONS ONLY.
- TURN OFF MAIN POWER SUPPLY BEFORE ATTEMPTING ANY ELECTRICAL WORK. MAKE SURE ALL POWER SWITCHES ARE OFF.
FAILURE TO DO SO MAY CAUSE ELECTRIC SHOCK.
- CONNECT THE CONNECTING CABLE CORRECTLY. IF THE CONNECTING CABLE IS CONNECTED WRONGLY, ELECTRIC PARTS MAY BE DAMAGED.
- CHECK THE EARTH WIRE THAT IT IS NOT BROKEN OR DISCONNECTED BEFORE INSTALLATION.
- DO NOT INSTALL NEAR CONCENTRATIONS OF COMBUSTIBLE GAS OR GAS VAPORS.
FAILURE TO FOLLOW THIS INSTRUCTION CAN RESULT IN FIRE OR EXPLOSION.
- TO PREVENT OVERHEATING THE INDOOR UNIT AND CAUSING A FIRE HAZARD, PLACE THE UNIT WELL AWAY (MORE THAN 2 M) FROM HEAT SOURCES SUCH AS RADIATORS, HEATERS, FURNACE, STOVES, ETC.
- WHEN MOVING THE AIR CONDITIONER FOR INSTALLING IT IN ANOTHER PLACE AGAIN, BE VERY CAREFUL NOT TO GET THE SPECIFIED REFRIGERANT (R32) WITH ANY OTHER GASEOUS BODY INTO THE REFRIGERATION CYCLE. IF AIR OR ANY OTHER GAS IS MIXED IN THE REFRIGERANT, THE GAS PRESSURE IN THE REFRIGERATION CYCLE BECOMES ABNORMALLY HIGH AND IT RESULTINGLY CAUSES BURST OF THE PIPE AND INJURIES ON PERSONS.
- IN THE EVENT THAT THE REFRIGERANT GAS LEAKS OUT OF THE PIPE DURING THE INSTALLATION WORK, IMMEDIATELY LET FRESH AIR INTO THE ROOM. IF THE REFRIGERANT GAS IS HEATED BY FIRE OR SOMETHING ELSE, IT CAUSES GENERATION OF POISONOUS GAS.

WARNING

- Never modify this unit by removing any of the safety guards or bypassing any of the safety interlock switches.
- Do not install in a place which cannot bear the weight of the unit.
Personal injury and property damage can result if the unit falls.
- Before doing the electrical work, attach an approved plug to the power supply cord.
Also, make sure the equipment is properly earthed.
- Appliance shall be installed in accordance with national wiring regulations.
If you detect any damage, do not install the unit. Contact your dealer immediately.
- Do not use any refrigerant different from the one specified for complement or replacement.
Otherwise, abnormally high pressure may be generated in the refrigeration cycle, which may result in a failure or explosion of the product or an injury to your body.

- Do not use means to accelerate the defrosting process or to clean, other than those recommended by the manufacturer.
- The appliance shall be stored in a room without continuously operating ignition sources (for example: open flames, an operating gas appliance or an operating electric heater).
- Be aware that refrigerants may not contain an odour.
- Do not pierce or burn as the appliance is pressurized. Do not expose the appliance to heat, flame, sparks, or other sources or ignition. Else, it may explode and cause injury or death.
- For R32 model, use pipes, flare nut and tools which is specified for R32 refrigerant. Using of existing (R22) piping, flare nut and tools may cause abnormally high pressure in the refrigerant cycle (piping), and possibly result in explosion and injury.
- Thickness of copper pipes used R32 must be more than 0.8 mm. Never use copper pipes thinner than 0.8 mm.
- Do not perform flare connection inside a building or dwelling or room, when joining the heat exchanger of indoor unit with interconnection piping. Refrigerant connection inside a building or dwelling or room must be made by brazing or welding. Joint connection of indoor unit by flaring method can only be made at outdoor or at outside of building or dwelling or room. Flare connection may cause gas leak and flammable atmosphere.
- After completion of installation or service, confirm there is no leakage of refrigerant gas. It may generate toxic gas when the refrigerant contacts with fire.
- Appliance and pipe-work shall be installed, operated and stored in a room with a floor area larger than $A_{\min}$ m².
How to get $A_{\min}$ m² : $A_{\min} = (M / (2.5 \times 0.22759 \times h_0))^2$
M is the refrigerant charge amount in appliance in kg, h_0 is the installation height of the appliance in m: 0.6 m for floor standing/1.8 m for wall mounted/1.0 m for window mounted/2.2 m for ceiling mounted. (For these units recommend installation height 2.5 m)
- Comply with national gas regulations.

WARNING

- **After installation work, make sure below before operation.**
 - **Connection pipes are connected properly and no leakage.**
 - **Packed valves are fully open.**

Running compressor without open packed valves may cause abnormal high pressure and parts failure.
Leakage at connection piping may suck air and make further high pressure cause burst and injury.
- **During pump down work make sure below process.**
 - **Don't mix air into the refrigerant cycle.**
 - **Stop the compressor before removing piping after packed valves are fully closed.**

Removing piping under the compressor running and packed valves open, air might be sucked and refrigeration cycle pressure becomes abnormally high, and it causes burst or injury on persons.

CAUTION

- Exposure of unit to water or other moisture before installation could result in electric shock.
Do not store it in a wet basement or expose to rain or water.
- After unpacking the unit, examine it carefully for possible damage.
- Do not install the unit at place where leakage of flammable gas may occur.
In case gas leaks and accumulates at surrounding of the unit, it may cause of fire.
- Do not install in a place that can increase the vibration of the unit. Do not install in a place that can amplify the noise level of the unit or where noise and discharged air might disturb neighbors.
- To avoid personal injury, be careful when handling parts with sharp edges.
- Please read this installation manual carefully before installing the unit. It contains further important instructions for proper installation.
- The manufacturer shall not assume any liability for the damage caused by not observing the description of this manual.

REQUIREMENT OF REPORT TO THE LOCAL POWER SUPPLIER

Please make absolutely sure that the installation of this appliance is reported to the local power supplier before installation. If you experience any problems or if the installation is not accepted by the supplier, the service agency will take adequate countermeasures.

■ Important information regarding the refrigerant used

This product contains fluorinated greenhouse gases.

Do not vent gases into the atmosphere.

Refrigerant type: **R32**

GWP⁽¹⁾ value: **675** * (ex. R32 ref. AR4)

⁽¹⁾GWP = global warming potential

The refrigerant quantity is indicated on the unit name plate.

* This value is based on F gas regulation 517/2014

ACCESSORY PARTS

Indoor Unit			
No.	Part name	No.	Part name
①	 Installation plate × 1	②	 Wireless remote control × 1
③	 Battery × 2	④	 Remote control holder × 1
⑤	 Ultra Fresh filter × 1	⑥	 Mounting screw × 6
⑦	 Flat head wood screw × 2	⑧	 Owner's Manual × 1
⑨	 Installation Manual × 1		

Air filters

Clean every 2 weeks.

1. Open the air inlet grille.
2. Remove the filters if they are on the air filter.
3. Vacuum or wash and then dry them.
4. Reinstall the filters and close the air inlet grille.

Ultra Fresh filter

Maintaining your strong purifying and revitalizing filter.



Clean every 6 months or when dust covers the filter.

1. Shake and blow with normal air or
2. Rinse the filter in water and dry it in under sunlight or in air.
(Do not wash or rinse with high pressure water)
3. Replace every 3 years or sooner. (P/N: RB-A701FE)


Note: Filter life depends on the level of impurities in your operating environment.

Higher levels of impurities may require more frequent cleaning and replacement.

In all cases, we recommend an additional set of filters to improve the purifying and deodorizing performance of your air conditioner.



INSTALLATION DIAGRAM OF INDOOR AND OUTDOOR UNITS



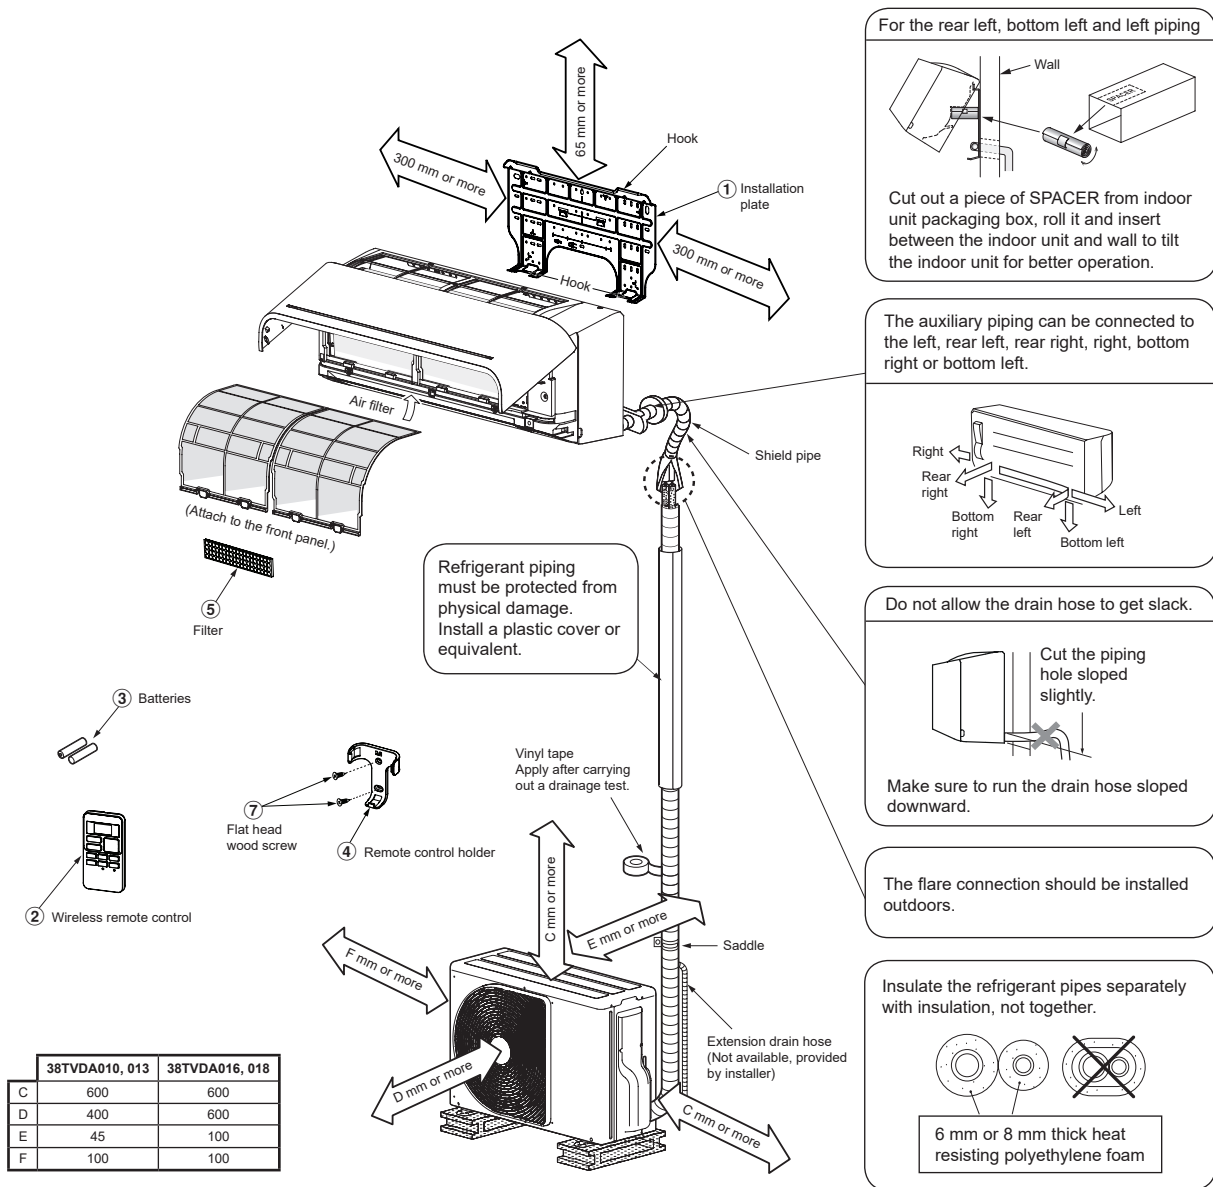


Optional Installation Parts

Part code	Parts name	Q'ty
A	Refrigerant piping Liquid side : Ø6.35 mm Gas side : Ø9.52 mm (42TVDA010, 013) : Ø12.70 mm (42TVDA016, 018)	One each
B	Pipe insulating material (polyethylene foam, 6 mm thick) For 42TVDA010, 013 (polyethylene foam, 8 mm thick) For 42TVDA016, 018	1
C	Putty, PVC tapes	One each

Fixing bolt arrangement of outdoor unit

- Secure the outdoor unit with fixing bolts and nuts if the unit is likely to be exposed to a strong wind.
- Use Ø8 mm or Ø10 mm anchor bolts and nuts.

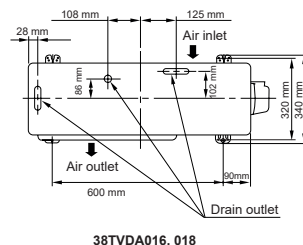

INDOOR UNIT

Installation Place


- A place which provides the spaces around the indoor unit as shown in the diagram
 - A place where there are no obstacles near the air inlet and outlet
 - A place which allows easy installation of the piping to the outdoor unit
 - A place which allows the front panel to be opened
 - The indoor unit shall be installed at least 2.5 m height.
- Also, it must be avoided to put anything on the top of the indoor unit.

CAUTION

- Direct sunlight to the indoor unit's wireless receiver should be avoided.
 - The microprocessor in the indoor unit should not be too close to RF noise sources.
- (For details, see the owner's manual.)

Remote control


- A place where there are no obstacles such as a curtain that may block the signal from the indoor unit
- Do not install the remote control in a place exposed to direct sunlight or close to a heating source such as a stove.
- Keep the remote control at least 1 m apart from the nearest TV set or stereo equipment. (This is necessary to prevent image disturbances or noise interference.)
- The location of the remote control should be determined as shown below.

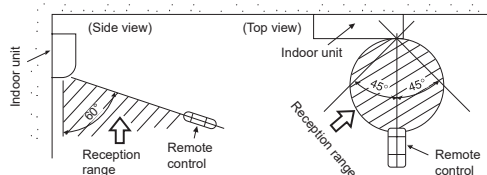

Cutting a Hole and Mounting Installation Plate

Cutting a hole

When installing the refrigerant pipes from the rear

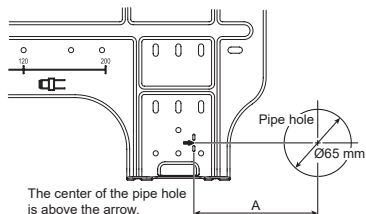


Model name	A (Unit : mm)
42TVDA010, 013	100
42TVDA016, 018	120

1. After determining the pipe hole position on the mounting plate (➡), drill the pipe hole (Ø65 mm) at a slight downward slant to the outdoor side.


NOTE

- When drilling a wall that contains a metal lath, wire lath or metal plate, be sure to use a pipe hole brim ring sold separately.

Mounting the installation plate

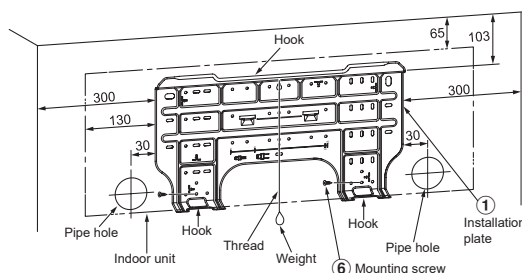

For 42TVDA010, 013

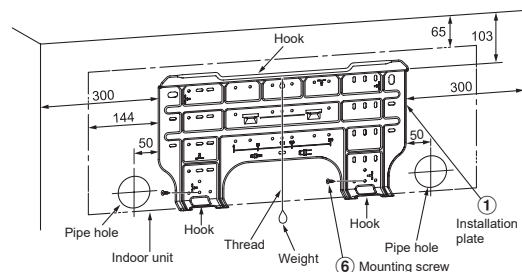


For 42TVDA016, 018

When the installation plate is directly mounted on the wall

1. Securely fit the installation plate onto the wall by screwing it in the upper and lower parts to hook up the indoor unit.
2. To mount the installation plate on a concrete wall with anchor bolts, use the anchor bolt holes as illustrated in the below figure.
3. Install the installation plate horizontally in the wall.

CAUTION

When installing the installation plate with a mounting screw, do not use the anchor bolt holes. Otherwise, the unit may fall down and result in personal injury and property damage.

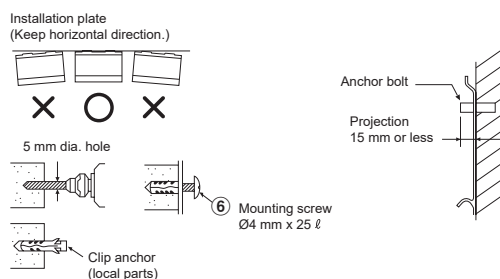

CAUTION

Failure to firmly install the unit may result in personal injury and property damage if the unit falls.

- In case of block, brick, concrete or similar type walls, make 5 mm dia. holes in the wall.
- Insert clip anchors for appropriate mounting screws (6).


NOTE

- Secure four corners and lower parts of the installation plate with 4 to 6 mounting screws to install it.

Piping and Drain Hose Installation

Piping and drain hose forming

* Since dewing results in a machine trouble, make sure to insulate both connecting pipes. (Use polyethylene foam as insulating material.)

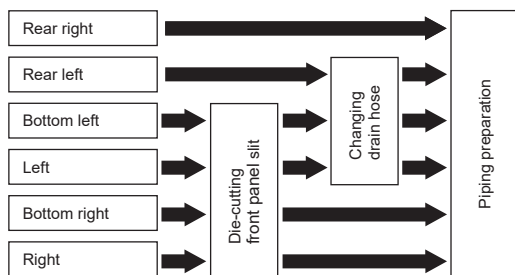

1. Die-cutting front panel slit


Cut out the slit on the left or right side of the front panel for the left or right connection and the slit on the bottom left or right side of the front panel for the bottom left or right connection with a pair of nippers.

2. Changing drain hose

For leftward connection, bottom-leftward connection and rear-leftward connection's piping, it is necessary to change the drain hose and drain cap.


How to remove the drain hose

- The drain hose can be removed by removing the screw securing the drain hose and then pulling out the drain hose.
- When removing the drain hose, be careful of any sharp edges of steel plate. The edges can injuries.
- To install the drain hose, insert the drain hose firmly until the connection part contacts with heat insulator, and then secure it with original screw.



How to remove the drain cap

Clip the drain cap by needle-nose pliers and pull out.




How to fix the drain cap

- Insert hexagon wrench (4 mm) in a center head.

- Firmly insert the drain cap.

Do not apply lubricating oil (refrigerant machine oil) when inserting the drain cap. Application causes deterioration and drain leakage of the plug.

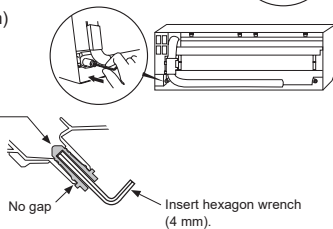


CAUTION

Firmly insert the drain hose and drain cap; otherwise, water may leak.


In case of right or left piping

- After scribing slits inside of the front panel with a knife or a making-off pin, cut them with a pair of nippers or an equivalent tool.



In case of bottom right or bottom left piping

- After scribing slits inside of the front panel with a knife or a making-off pin, cut them with a pair of nippers or an equivalent tool.




Left-hand connection with piping

- Bend the connecting pipe so that it is laid within 43 mm above the wall surface. If the connecting pipe is laid exceeding 43 mm above the wall surface, the indoor unit may unstably be set on the wall. When bending the connecting pipe, make sure to use a spring bender so as not to crush the pipe.

Bend the connecting pipe within a radius of 30 mm.

To connect the pipe after installation of the unit (figure)

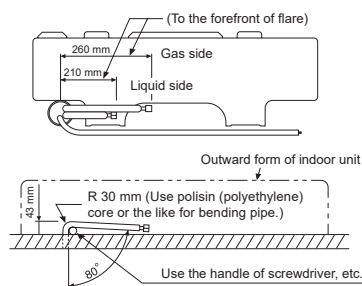


NOTE

If the pipe is bent incorrectly, the indoor unit may unstably be set on the wall. After passing the connecting pipe through the pipe hole, connect the connecting pipes to the auxiliary pipes and wrap the facing tape around them.

CAUTION



- Bind the auxiliary pipes (two) and connecting cable with facing tape tightly. In case of leftward piping and rear-leftward piping, bind the auxiliary pipes (two) only with facing tape.

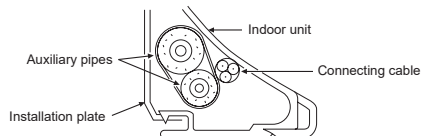


- Carefully arrange pipes so that any pipe does not stick out of the rear plate of the indoor unit.
- Carefully connect the auxiliary pipes and connecting pipes to one another and cut off the insulating tape wound on the connecting pipe to avoid double-taping at the joint; moreover, seal the joint with the vinyl tape, etc.
- Since dewing results in a machine trouble, make sure to insulate both connecting pipes. (Use polyethylene foam as insulating material.)
- When bending a pipe, carefully do it, not to crush it.

Indoor Unit Fixing

- Pass the pipe through the hole in the wall and hook the indoor unit on the installation plate at the upper hook.
- Swing the indoor unit to right and left to confirm that it is firmly hooked up on the installation plate.
- While pressing the indoor unit onto the wall, hook it at the lower part on the installation plate. Pull the indoor unit toward you to confirm that it is firmly hooked up on the installation plate.



- For detaching the indoor unit from the installation plate, pull the indoor unit toward you while pushing its bottom up at the specified parts.




Drainage


1. Run the drain hose sloped downwards.

NOTE

- The hole should be made at a slight downward slant on the outdoor side.

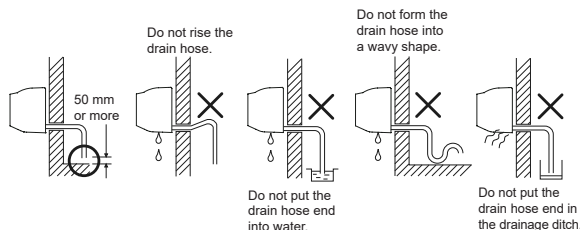


2. Put water in the drain pan and make sure that the water is drained out of doors.
3. When connecting extension drain hose, insulate the connecting part of extension drain hose with shield pipe.



CAUTION

Arrange the drain pipe for proper drainage from the unit. Improper drainage can result in dew-dropping.

This air conditioner has the structure designed to drain water collected from dew, which forms on the back of the indoor unit, to the drain pan. Therefore, do not store the power cord and other parts at a height above the drain guide.



OUTDOOR UNIT

Installation Place

- A place which provides the spaces around the outdoor unit as shown in the diagram
- A place which can bear the weight of the outdoor unit and does not allow an increase in noise level and vibration
- A place where the operation noise and discharged air do not disturb your neighbors
- A place which is not exposed to a strong wind
- A place free of a leakage of combustible gases
- A place which does not block a passage
- When the outdoor unit is to be installed in an elevated position, be sure to secure its feet.
- The allowable length of the connecting pipe.

Model	38TVDA010	38TVDA013	38TVDA016	38TVDA018
Chargeless	Up to 15 m	Up to 15 m	Up to 15 m	Up to 15 m
Maximum length	15 m	15 m	20 m	20 m
Additional refrigerant charging	-	-	16 - 20 m (20 g / 1 m)	16 - 20 m (20 g / 1 m)
Maximum refrigerant charging	0.42 kg	0.46 kg	0.69 kg	0.97 kg

- The allowable height of outdoor unit installation site.

Model	38TVDA010	38TVDA013	38TVDA016	38TVDA018
Maximum height	12 m	12 m	12 m	12 m

- A place where the drain water does not raise any problems or with good drainage.
- A place where it can be installed horizontally.

Precautions for adding refrigerant

Use a scale having a precision with at least 10 g per index line when adding the refrigerant.

Do not use a bathroom scale or similar instrument.


CAUTION

When the outdoor unit is installed in a place where the drain water might cause any problems, Seal the water leakage point tightly using a silicone adhesive or caulking compound.

CAUTION

1. Install the outdoor unit without anything blocking the air discharging.
2. When the outdoor unit is installed in a place always exposed to strong wind like a coast or on a high storey of a building, secure the normal fan operation using a duct or a windshield.
3. In particularly windy areas, install the unit such as to avoid admission of wind.
4. Installation in the following places may result in trouble.


- Do not install the unit in such places.
- A place full of machine oil
- A saline-place such as the coast
- A place full of sulfi de gas
- A place where high-frequency waves are likely to be generated as from audio equipment, welders, and medical equipment



Refrigerant Piping Connection

Flaring

1. Cut the pipe with a pipe cutter.




2. Insert a flare nut into the pipe and flare the pipe.

- Projection margin in flaring : A (Unit : mm)

RIDGID (clutch type)

Outer dia. of copper pipe	R32 tool used	Conventional tool used
Ø6.35	0 to 0.5	1.0 to 1.5
Ø9.52	0 to 0.5	1.0 to 1.5
Ø12.70	0 to 0.5	1.0 to 1.5
Pipe thickness	0.8 mm or more	



IMPERIAL (wing nut type)


Outer dia. of copper pipe	R32
Ø6.35	1.5 to 2.0
Ø9.52	1.5 to 2.0
Ø12.70	2.0 to 2.5
Pipe thickness	0.8 mm or more

CAUTION

- Do not scratch the inner surface of the flared part when removing burrs.
- Flare processing under the condition of scratches on the inner surface of flare processing part will cause refrigerant gas leak.

Tightening connection

Align the centers of the connecting pipes and tighten the flare nut as far as possible with your fingers. Then tighten the nut with a spanner and torque wrench as shown in the figure.

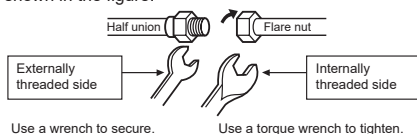

CAUTION


Do not apply excess torque. Otherwise, the nut may crack depending on the conditions.

(Unit : N·m)

Outer dia. of copper pipe	Tightening torque
Ø6.35 mm	16 to 18 (1.6 to 1.8 kgf·m)
Ø9.52 mm	30 to 42 (3.0 to 4.2 kgf·m)
Ø12.70 mm	50 to 62 (5.0 to 6.2 kgf·m)

• Tightening torque of flare pipe connections

The operating pressure of R32 is higher than that of R22 (approx. 1.6 times). It is therefore necessary to firmly tighten the flare pipe connecting sections (which connect the indoor and outdoor units) up to the specified tightening torque. Incorrect connections may cause not only a gas leakage, but also damage to the refrigeration cycle.



Evacuating

After the piping has been connected to the indoor unit, you can perform the air purge together at once.


AIR PURGE

Evacuate the air in the connecting pipes and in the indoor unit using a vacuum pump. Do not use the refrigerant in the outdoor unit. For details, see the manual of the vacuum pump.

Using a vacuum pump

Be sure to use a vacuum pump with counter-flow prevention function so that inside oil of the pump does not flow backward into pipes of the air conditioner when the pump stops. (If oil inside of the vacuum pump enters the air conditioner, which use R32, refrigeration cycle trouble may result.)

1. Connect the charge hose from the manifold valve to the service port of the packed valve at gas side.
2. Connect the charge hose to the port of the vacuum pump.
3. Open fully the low pressure side handle of the gauge manifold valve.
4. Operate the vacuum pump to start evacuating. Perform evacuating for about 15 minutes if the piping length is 20 meters. (15 minutes for 20 meters) (assuming a pump capacity of 27 liters per minute) Then confirm that the compound pressure gauge reading is -101 kPa (-76 cmHg).
5. Close the low pressure side valve handle of the gauge manifold valve.
6. Open fully the valve stem of the packed valves (both gas and liquid sides).
7. Remove the charging hose from the service port.
8. Securely tighten the caps on the packed valves.

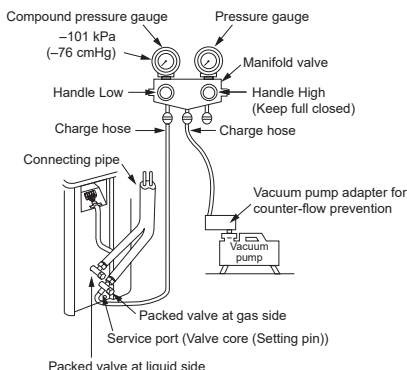

CAUTION

• KEEP IMPORTANT 7 POINTS FOR PIPING WORK.

- (1) Take away dust and moisture (inside of the connecting pipes).
- (2) Tighten the connections (between pipes and unit).
- (3) Evacuate the air in the connecting pipes using a VACUUM PUMP.
- (4) Check gas leak (connected points).
- (5) Be sure to fully open the packed valves before operation.
- (6) Reusable mechanical connectors and flared joints are not allowed indoors. When mechanical connectors are reused indoors, sealing parts shall be renewed. When flared joints are reused indoors, the flare part shall be refabricated.
- (7) Don't operate air conditioner in case no refrigerant in the system.

Packed valve handling precautions

- Open the valve stem all the way out, but do not try to open it beyond the stopper.

Pipe size of Packed Valve	Size of Hexagon wrench
12.70 mm and smaller	A = 4 mm
15.88 mm	A = 5 mm

Pump down process


1. Turn off the Air Conditioner system.
2. Connect the charge hose from the manifold valve to the service port of the packed valve at gas side.
3. Turn on the Air Conditioner system in cooling operation more than 10 minutes.
4. Check the operating pressure of the system should be normal value. (Ref. with product specification)
5. Release the valve rod cap of both service valves.
6. Use the Hexagon wrench to turning the valve rod of Liquid side fully close. (*Make sure no entering air into the system)
7. Continue operate Air Conditioner system until and the gauge of manifold dropped into the range of 0.5 - 0 kgf/cm²
8. Use the Hexagon wrench to turning the valve rod of Gas side fully close. And turn off the Air Conditioner system immediately thereafter.
9. Remove the gauge manifold from the service port of the packed valve.
10. Securely tighten the valve rod cap to the both service valves.

CAUTION

Should be check the compressor operating condition while pumping down process. It must not any abnormal sound, more vibration. It is abnormal condition appears and must turn off the Air Conditioner immediately.

- Securely tighten the valve cap with torque in the following table:

Cap	Cap Size (H)	Torque
Valve Rod Cap	H17 - H19	14~18 N·m (1.4 to 1.8 kgf·m)
	H22 - H30	33~42 N·m (3.3 to 4.2 kgf·m)
Service Port Cap	H14	8~12 N·m (0.8 to 1.2 kgf·m)
	H17	14~18 N·m (1.4 to 1.8 kgf·m)

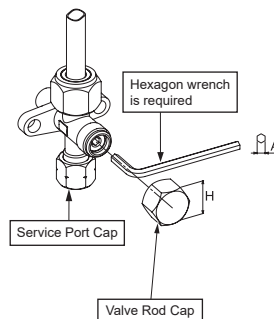

ELECTRICAL WORKS

Model	42TVDA010	42TVDA013	42TVDA016	42TVDA018
Power source	50Hz, 220V Single phase			
Maximum running current	5.60A	6.65A	8.20A	9.80A
Circuit breaker rating	15A	15A	15A	15A
Power supply cable	H07RN-F or 60245 IEC66 (1.25 mm ² or more)			H07RN-F or 60245 IEC66 (1.5 mm ² or more)
Connecting cable	H07RN-F or 60245 IEC66 (0.75 mm ² or more)			


EN

Wiring Connection

Indoor unit


Wiring of the connecting cable can be carried out without removing the front panel.

1. Remove the air inlet grille.
Open the air inlet grille upward and pull it toward you.
2. Remove the terminal cover and cord clamp.
3. Insert the connecting cable (according to the local cords) into the pipe hole on the wall.
4. Take out the connecting cable through the cable slot on the rear panel so that it protrudes about 20 cm from the front.
5. Insert the connecting cable fully into the terminal block and secure it tightly with screws.
6. Tightening torque : 1.2 N·m (0.12 kgf·m)
7. Secure the connecting cable with the cord clamp.
8. Fix the terminal cover, rear plate bushing and air inlet grille on the indoor unit.

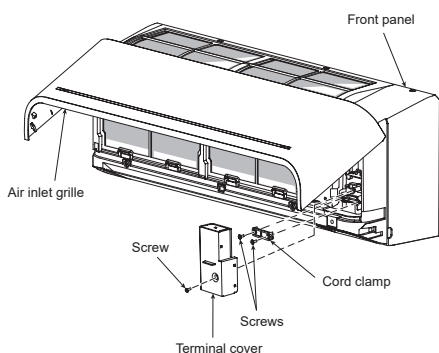


How to install the air inlet grille on the indoor unit

- When attaching the air inlet grille, the contrary of the removed operation is performed.

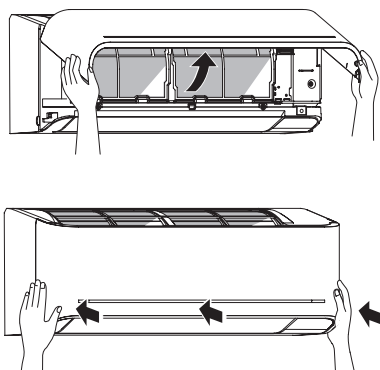


Outdoor unit (38TVDA010)

1. Remove the valve cover from the outdoor unit.
2. Connect the connecting cable to the terminals as identified with their respective matched numbers on the terminal block of indoor and outdoor unit.
3. When connecting the connecting cable to the outdoor unit terminals, make a loop as shown in the installation diagram of indoor and outdoor unit to prevent water coming in the outdoor unit.
4. Insulate the unused cords (conductors) from any water coming in the outdoor unit. Proceed them so that they do not touch any electrical or metal parts

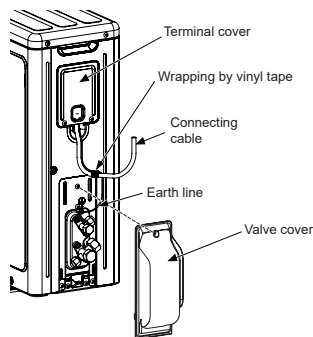

Outdoor unit (38TVDA013, 016, 018)

1. Remove the valve cover, the electric parts cover and the cord clamp from the outdoor unit.
2. Connect the connecting cable to the terminal as identified by the matching numbers on the terminal block of indoor and outdoor unit.
3. Insert the power cord and the connecting cable carefully into the terminal block and secure it tightly with screws.
4. Use vinyl tape, etc. to insulate the cords which are not going to be used. Locate them so that they do not touch any electrical or metal parts.
5. Secure the power cord and the connecting cable with the cord clamp.
6. Attach the electric parts cover and the valve cover on the outdoor unit.

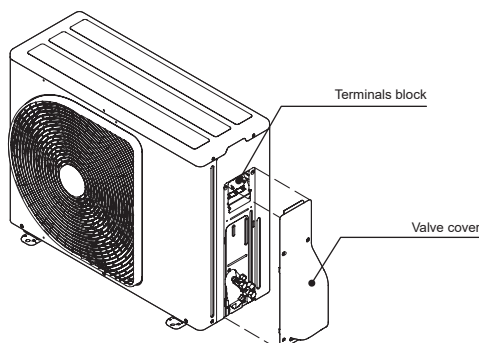


Power Supply and Connecting Cable Connection

Power Supply Input at Outdoor Unit Terminal Block

Indoor Unit

Connecting cable




Connecting cable connect to 1 2 3 ⊕

Terminal block (1 2 3)


Earth line

Connecting cable

Stripping length of the connecting cable



Outdoor Unit

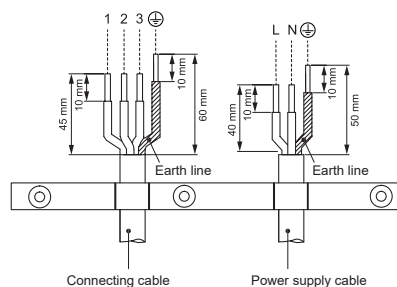

Connecting cable

Power supply cable


CAUTION

1. The power supply must be same as the rated of air conditioner.
2. Prepare the power source for exclusive use with air conditioner.
3. Circuit breaker must be used for the power supply line of this air conditioner.
4. Be sure to comply power supply and connecting cable for size and wiring method.
5. Every wire must be connected firmly.
6. Perform wiring works so as to allow a general wiring capacity.
7. Wrong wiring connection may cause some electrical part burn out.
8. Incorrect or incomplete wiring is carried out, it will cause an ignition or smoke.
9. This product can be connected to main power supply.

Connection to fixed wiring : A switch which disconnects all poles and has a contact separation at least 3 mm must be incorporated in the fixed wiring.

OTHERS

Gas Leak Test

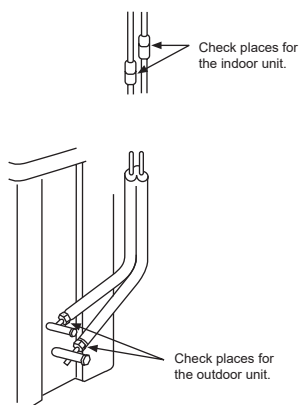

- Check the flare nut connections for the gas leak with a gas leak detector or soap water.

Remote Control A-B Selection


- When two indoor units are installed in the same room or adjacent two rooms, if operating a unit, two units may receive the remote control signal simultaneously and operate. In this case, the operation can be preserved by setting either one remote control to B setting. (Both are set to A setting in factory shipment.)
- The remote control signal is not received when the settings of indoor unit and remote control are different.
- There is no relation between A setting/B setting and A room/B room when connecting the piping and cables.

To separate using of remote control for each indoor unit in case of 2 air conditioner are installed near.

Remote Control B Setup.


1. Press [RESET] button on the indoor unit to turn the air conditioner ON.
2. Point the remote control at the indoor unit.
3. Push and hold [CHECK] button on the Remote Control by the tip of the pencil. "00" will be shown on the display (Picture ①).
4. Press [MODE] during pushing [CHECK]. "B" will show on the display and "00" will disappear and the air conditioner will turn OFF. The Remote Control B is memorized (Picture ②).

Note : 1. Repeat above step to reset Remote Control to be A.
2. Remote Control A have not "A" display.
3. Default setting of Remote Control from factory is A.

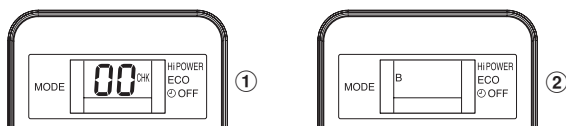

Test Operation

To switch the TEST RUN (COOL) mode, press [RESET] button for 10 seconds. (The beeper will make a short beep.)

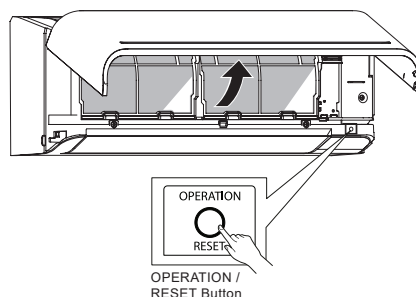

Auto Restart Function Setting

This product is designed so that, after a power failure, it can restart automatically in the same operating mode as before the power failure.

Information

The product is shipped with Auto Restart function in the ON position. Turn it OFF if this function is not required.

How to turn OFF the Auto Restart Function

- Press and hold the [OPERATION] button on the indoor unit for 3 seconds (3 beep sounds but OPERATION lamp does not blink).

How to turn ON the Auto Restart Function

- Press and hold the [OPERATION] button on the indoor unit for 3 seconds (3 beep sounds and OPERATION lamp blink 5 time/sec for 5 seconds).

NOTE

- In case of ON timer or OFF timer are set, AUTO RESTART OPERATION does not activate.

APPENDIX

Work instructions

The existing R22 and R410A piping can be reused for inverter R32 product installations.

WARNING

Confirming the existence of scratches or dents on the existing pipes and confirming the reliability of the pipe strength are conventionally referred to the local site.

If the specified conditions can be cleared, it is possible to update existing R22 and R410A pipes to those for R32 models.

Basic conditions needed to reuse existing pipes

Check and observe the presence of three conditions in the refrigerant piping works.

1. **Dry** (There is no moisture inside of the pipes.)
2. **Clean** (There is no dust inside of the pipes.)
3. **Tight** (There are no refrigerant leaks.)

Restrictions for use of existing pipes

In the following cases, the existing pipes should not be reused as they are. Clean the existing pipes or exchange them with new pipes.

1. When a scratch or dent is heavy, be sure to use new pipes for the refrigerant piping works.
2. When the existing pipe thickness is thinner than the specified "Pipe diameter and thickness," be sure to use new pipes for the refrigerant piping works.

- The operating pressure of R32 is high (1.6 items that of R22). If there is a scratch or dent strength on the pipe or a thinner pipe is used, the pressure may be inadequate, which may cause the pipe to break in the worst case.

• Pipe diameter and thickness (mm)

Pipe outer diameter	Ø6.4	Ø9.5	Ø12.7
Thickness	R32, R410A R22	0.8	0.8

3. When the outdoor unit was left with the pipes disconnected, or the gas leaked from the pipes and the pipes were not repaired and refilled.

- There is the possibility of rain water or air, including moisture, entering the pipe.

4. When refrigerant cannot be recovered using a refrigerant recovery unit.

- There is the possibility that a large quantity of dirty oil or moisture remains inside the pipes.

5. When a commercially available dryer is attached to the existing pipes.

- There is the possibility that copper green rust has been generated.

6. When the existing air conditioner is removed after refrigerant has been recovered.

Check if the oil is judged to be clearly different from normal oil.

- The refrigerant oil is copper rust green in color: There is the possibility that moisture has mixed with the oil and rust has been generated inside the pipe.
- There is discolored oil, a large quantity of residue, or a bad smell.
- A large quantity of shiny metal dust or other wear residue can be seen in the refrigerant oil.

7. When the air conditioner has a history of the compressor failing and being replaced.

- When discolored oil, a large quantity of residue, shiny metal dust, or other wear residue or mixture of foreign matter is observed, trouble will occur.

8. When temporary installation and removal of the air conditioner are repeated such as when leased etc.

9. If the type of refrigerant oil of the existing air conditioner is other than the following oil (Mineral oil), Suniso, Freol-S, MS (Synthetic oil), alkyl benzene (HAB, Barrel-freeze), ester series, PVE only of other series.

- The winding-insulation of the compressor may deteriorate.

NOTE


The above descriptions are results have been confirmed by our company and represent our views on our air conditioners, but do not guarantee the use of the existing pipes of air conditioners that have adopted R32 in other companies.

Curing of pipes

When removing and opening the indoor or outdoor unit for a long time, cure the pipes as follows:

- Otherwise rust may be generated when moisture or foreign matter due to condensation enters the pipes.
- The rust cannot be removed by cleaning, and new pipes are necessary.

Placement location	Term	Curing manner
Outdoors	1 month or more	Pinching
Indoors	Less than 1 month Every time	Pinching or taping

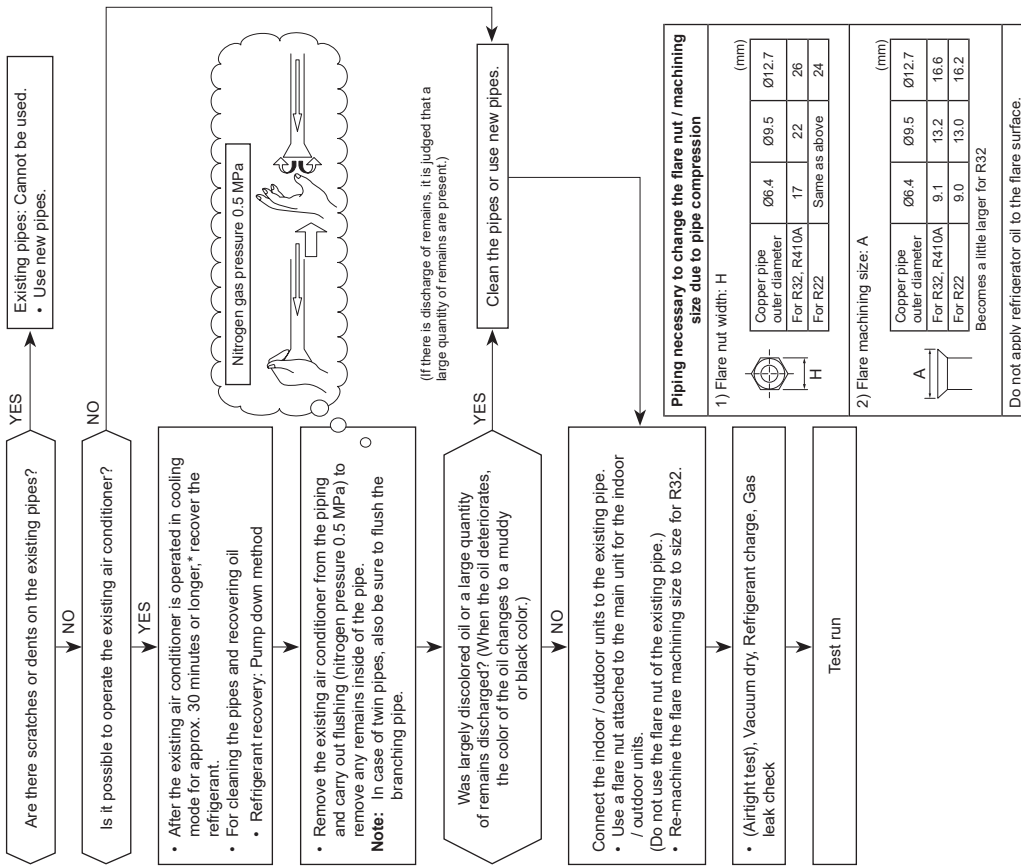

ข้อควรระวังเพื่อความปลอดภัย

	อ่านข้อควรระวังในคู่มือนี้ โดยละเอียดก่อนใช้งานเครื่อง		เครื่องนี้ต้องเติมด้วย R32
---	---	---	----------------------------

■ สัญลักษณ์คำเตือนของตัวเครื่องปรับอากาศ

สัญลักษณ์คำเตือน	คำอธิบาย
 CAUTION BURST HAZARD Open the service valves before the operation, otherwise there might be the burst.	ข้อควรระวัง อันตรายจากการระเบิด ให้เปิดวาล์วบริการก่อนเปิดเครื่องปรับอากาศ มิฉะนั้น อาจเกิดการระเบิด

TH

- ก่อนการติดตั้ง โปรดอ่านข้อควรระวังเพื่อความปลอดภัยอย่างระมัดระวัง
- ควรทำตามข้อควรระวังที่เขียนไว้ ณ ที่นี้เพื่อหลีกเลี่ยงอันตรายที่อาจเกิดขึ้นต่อไปนี้เป็นสัญลักษณ์และความหมาย

คำเตือน : สัญลักษณ์นี้แสดงว่าการใช้งานที่ผิดอาจก่อให้เกิดการบาดเจ็บสาหัสหรือถึงแก่ชีวิต

ข้อควรระวัง : สัญลักษณ์นี้แสดงว่าการใช้งานที่ผิดอาจก่อให้เกิดการบาดเจ็บส่วนบุคคล (*1) หรือความเสียหายแก่ทรัพย์สิน (*2)

*1 : การบาดเจ็บส่วนบุคคลหมายถึง อุบัติเหตุเล็กน้อย การลื่นล้ม หรือไฟดูด ซึ่งไม่จำเป็นต้องเข้ารับการรักษาตัวในโรงพยาบาล

*2 : ความเสียหายแก่ทรัพย์สิน หมายถึง ความเสียหายที่รุนแรงกว่าซึ่งส่งผลต่อทรัพย์สินหรือทรัพยากร

สำหรับการใช้งานทั่วไป

สายจ่ายไฟและสายเชื่อมต่อของตัวเครื่องภายนอกอย่างน้อยจะต้องเป็นสายชนิดอ่อนหุ้มด้วยโพลีคลอโรพรีน (แบบ H07RN-F) หรือสายไฟที่ตรงตามข้อกำหนด 60245 IEC66 (ควรติดตั้งตามข้อกำหนดการเดินสายไฟ)

ข้อควรระวัง

การปลดสายเครื่องจากตัวจ่ายไฟฟ้าหลัก

เครื่องนี้ต้องได้รับการต่อเข้ากับตัวจ่ายไฟหลักด้วยเบรกเกอร์วงจรไฟฟ้า หรือสวิตช์ที่มีการแยกข้อสัมผัสอย่างน้อย 3 มม. ในทุกขั้ว

อันตราย

- ใช้โดยผู้ชำนาญงานเท่านั้น
 - ปิดตัวจ่ายไฟหลักก่อนการปฏิบัติงานที่เกี่ยวข้องกับไฟฟ้า ให้แน่ใจว่าได้ปิดสวิตช์ไฟทั้งหมดแล้ว การละลายอาจทำให้เกิดไฟฟ้าช็อต
 - ต่อสายไฟอย่างถูกต้อง ถ้าต่อสายผิดพลาดอาจทำให้อุปกรณ์ไฟฟ้าเกิดการเสียหายได้
 - ตรวจสอบสายดินอย่าให้ขาด หรือหลุดก่อนการติดตั้ง
 - อย่าติดตั้งใกล้กับแหล่งก๊าซไวไฟหรือไอก๊าซ
- การละลายไม่ปฏิบัติตามคำแนะนำอาจเป็นผลให้เกิดเพลิงไหม้หรือระเบิด
- เพื่อเป็นการป้องกันตัวเครื่องภายในไม่ให้ร้อนเกินและไม่ทำให้เกิดอันตรายจากเพลิงไหม้ วางเครื่องให้ห่าง (มากกว่า 2 ม.) จากแหล่งความร้อน เช่นเครื่องกระจายความร้อน เครื่องทำความร้อน เตาลอหม เต้าไฟ เป็นต้น
 - ในการเคลื่อนย้ายเครื่องปรับอากาศไปติดตั้งในที่อื่นๆ ควรระมัดระวังในการอัดสารทำความเย็น (R32) ถ้าอากาศหรือก๊าซใดๆ ผสมเข้าไปในสารทำความเย็นแรงดันก๊าซภายในวงจรสารทำความเย็นสูงขึ้นแบบผิดปกติ และอาจเป็นสาเหตุของการระเบิดของท่อ และเกิดอันตรายได้
 - ในกรณีที่ก๊าซสารทำความเย็นรั่วออกจากท่อในระหว่างทำการติดตั้ง ให้รีบเปิดรับอากาศเข้ามาในห้อง ถ้าก๊าซสารทำความเย็นถูกทำให้ร้อนด้วยไฟ หรืออื่นๆ จะทำให้เกิดก๊าซพิษ

คำเตือน

- อย่าแก้ไขดัดแปลงเครื่องโดยการถอดตัวป้องกัน หรือลัดวงจรสวิตช์ภายในเพื่อความปลอดภัย
- ไม่ควรติดตั้งในสถานที่ที่ไม่สามารถรองรับน้ำหนักของตัวเครื่องได้ เพราะถ้าเครื่องหล่นลงมา จะทำให้เกิดอันตรายและสิ่งของเสียหายได้
- ก่อนทำงานเกี่ยวกับไฟฟ้า ควรตัดปลั๊กที่ได้มาตรฐานเข้ากับสายจ่ายไฟ และต่อสายดินให้กับอุปกรณ์
- เครื่องต้องได้รับการติดตั้งตามข้อกำหนดการเดินสายไฟ ถ้าตรวจพบความเสียหายอย่าติดตั้งเครื่อง ให้ติดต่อตัวแทนจำหน่ายทันที
- ห้ามใช้สารทำความเย็นใดๆ ที่แตกต่างไปจากที่ระบุไว้สำหรับการเติม หรือการเปลี่ยน มิฉะนั้นอาจมีแรงดันสูงผิดปกติแพร่กระจายเข้าสู่วงจรการทำความเย็น ซึ่งทำให้ผลิตภัณฑ์นี้ทำงานผิดปกติ หรือเกิดการระเบิด หรืออาจทำให้ท่านได้รับบาดเจ็บได้

- อย่าใช้วิธีการเร่งกระบวนการละลายน้ำแข็งหรือทำความสะอาดนอกเหนือจากวิธีการที่ผู้ผลิตได้แนะนำ
- ควรวางเครื่องไว้ในห้องที่ปราศจากแหล่งที่ก่อให้เกิดประกายไฟ (เช่น เปลวไฟที่ไม่มีสิ่งปิดกั้น เครื่องใช้ไฟฟ้าที่ใช้ก๊าซที่กำลังทำงานอยู่ หรือเครื่องทำความร้อนที่ใช้ไฟฟ้าที่กำลังทำงานอยู่)
- ควรใช้ความระมัดระวังเนื่องจากสารทำความเย็นอาจไม่มีกลิ่น
- ห้ามเจาะหรือเผาในขณะที่เครื่องมีแรงดัน อย่าให้เครื่องใกล้ความร้อน เปลวไฟประกายไฟ หรือการลุกไหม้อื่นๆ ซึ่งอาจก่อให้เกิดการระเบิดจนทำให้เกิดการบาดเจ็บหรือเสียชีวิตได้
- สำหรับรุ่น R32 ให้ใช้ท่อแฟรน์ท และเครื่องมือที่กำหนดไว้ให้ใช้กับ R32 การใช้ระบบท่อ (R22) แฟรน์ท และเครื่องมือที่มีอยู่แล้วอาจทำให้เกิดความดันสูงผิดปกติในวงจรสารทำความเย็น (ระบบท่อ) และอาจทำให้เกิดการระเบิดและบาดเจ็บได้
- ความหนาของท่อทองแดงที่ใช้กับ R32 ต้องมีขนาดมากกว่า 0.8 มม. ห้ามใช้ท่อทองแดงที่หนาน้อยกว่า 0.8 มม. โดยเด็ดขาด
- อย่าทำการต่อท่อแบบปลายบานภายในอาคาร ที่พักอาศัย หรือห้องพัก เมื่อต่อเครื่องแลกเปลี่ยนความร้อนของเครื่องภายในเข้ากับท่อเชื่อมต่อ การเชื่อมต่อสารทำความเย็นภายในอาคาร ที่พักอาศัย หรือห้องพัก จะต้องกระทำโดยการบัดกรีแข็ง หรือการเชื่อมโลหะ การเชื่อมต่อของเครื่องภายในด้วยวิธีการบานท่อ สามารถกระทำได้เฉพาะกลางแจ้ง หรือด้านนอกของอาคาร ที่พักอาศัย หรือห้องพักเท่านั้น การต่อท่อแบบปลายบานอาจเป็นสาเหตุให้ก๊าซรั่ว และทำให้บรรยากาศโดยรอบอยู่ในสภาพไวไฟได้
- หลังจากเสร็จสิ้นการติดตั้งหรือการบำรุงรักษาแล้ว ควรตรวจยืนยันว่าไม่มีการรั่วของก๊าซสารทำความเย็นเกิดขึ้น หากสารทำความเย็นติดไฟ อาจทำให้เกิดก๊าซพิษได้
- ควรติดตั้ง ใช้งาน และจัดเก็บเครื่องและงานระบบท่อในห้องที่มีพื้นที่ห้องกว้างกว่า $A_{\min} \text{ m}^2$
 วิธีการหาค่า $A_{\min} \text{ m}^2 : A_{\min} = (M / (2.5 \times 0.22759 \times h_0))^2$
 M คือปริมาณของการเติมสารทำความเย็นภายในเครื่อง มีหน่วยเป็น กิโลกรัม (kg)
 h_0 คือความสูงของการติดตั้งเครื่อง มีหน่วยเป็นเมตร (m): 0.6 เมตร
 สำหรับเครื่องแบบตั้งพื้น /1.8 เมตร สำหรับเครื่องแบบติดผนัง /1.0 เมตร
 สำหรับเครื่องแบบติดบนวงกบหน้าต่าง /2.2 เมตร สำหรับเครื่องแบบติดเพดาน (สำหรับเครื่องประเภทนี้ ความสูงที่เหมาะสมควรอยู่ที่ 2.5 เมตร)
- สอดคล้องกับระเบียบแห่งชาติว่าด้วยก๊าซ

คำเตือน

- หลังการติดตั้ง โปรดตรวจสอบตามรายละเอียดด้านล่างก่อนการเปิดใช้งาน
 - ท่อมีการเชื่อมต่ออย่างถูกต้องและไม่มีการรั่วไหล
 - วาล์วเปิดอยู่เต็มที่

การทำงานของคอมเพรสเซอร์ที่วาล์วอัดปิดอยู่อาจทำให้เกิดแรงดันสูงผิดปกติและทำให้ชิ้นส่วนเสียหายได้

การรั่วไหลที่ท่อต่ออาจดูดอากาศเข้าไปและทำให้แรงดันสูงขึ้นจนทำให้เกิดการระเบิดและการบาดเจ็บได้

- ระหว่างที่มีการทำปั๊มดาวนเพื่อเก็บน้ำยาแอร์ ดำเนินการตรวจสอบให้แน่ใจว่าได้ดำเนินการตามขั้นตอนด้านล่างต่อไปนี้

- ห้ามผสมอากาศเข้าไปในวงจรสารทำความเย็น
- หยุดคอมเพรสเซอร์ก่อนถอดท่อหลังจากปิดวาล์วอัดจนสุดแล้ว

การถอดท่อในระหว่างที่คอมเพรสเซอร์กำลังทำงานและวาล์วที่บรรจุเปิดอยู่ อาจทำให้เกิดการดูดอากาศเข้าไปและแรงดันวงจรการทำงานจะสูงผิดปกติ และทำให้เกิดการระเบิดหรือการบาดเจ็บขึ้นได้

ข้อควรระวัง

- ถ้าเครื่องถูกน้ำหรือความชื้นก่อนการติดตั้ง อาจทำให้เกิดไฟฟ้าลัดวงจรได้ อย่าเก็บเครื่องไว้ในห้องใต้ดินที่ชื้นหรือให้เครื่องถูกฝนหรือน้ำ
- หลังนำเครื่องออกจากบรรจุภัณฑ์ ตรวจสอบความเสียหายที่อาจเกิดขึ้นอย่างละเอียด
- อย่าติดตั้งเครื่องในสถานที่ซึ่งอาจมีการรั่วไหลของก๊าซไวไฟเกิดขึ้น ในกรณีก๊าซรั่วและสะสมอยู่โดยรอบตัวเครื่องอาจทำให้เกิดไฟไหม้ได้
- อย่าติดตั้งในสถานที่ซึ่งจะเพิ่มความชื้นให้กับเครื่อง อย่าติดตั้งในสถานที่ซึ่งสามารถขยายระดับเสียงของเครื่อง ที่ซึ่งเสียงและลมที่เป่าออกมาอาจรบกวนเพื่อนบ้าน
- เพื่อหลีกเลี่ยงการได้รับบาดเจ็บ ระวังเมื่อจับถือส่วนที่มีขอบคม
- กรุณาอ่านคู่มือการติดตั้งนี้อย่างละเอียดก่อนติดตั้งเครื่อง ในคู่มือประกอบด้วยคำแนะนำสำคัญเพื่อการติดตั้งอย่างถูกต้อง
- ผู้ผลิตจะไม่รับประกันความเสียหายใดๆ อันเกิดจากการละเลยต่อคำแนะนำในคู่มือเล่มนี้

ข้อกำหนดในการแจ้งการไฟฟ้าส่วนท้องถิ่น

โปรดตรวจสอบให้แน่ใจว่าได้แจ้งการไฟฟ้าส่วนท้องถิ่นให้ทราบถึงการติดตั้งเครื่องนี้ ก่อนดำเนินการแล้วหากประสบปัญหาใดๆ หรือหากการไฟฟ้าไม่อนุญาตให้ทำการติดตั้ง หน่วยงานผู้ให้บริการควรหามาตรการรับมือที่เหมาะสม

■ ข้อมูลสำคัญเกี่ยวกับการใช้สารทำความเย็น

เครื่องปรับอากาศนี้บรรจุก๊าซเรือนกระจกกลุ่มฟลูออรีน

อย่าระบายก๊าซเข้าสู่บรรยากาศ

ประเภทสารทำความเย็น : **R32**

ค่า GWP⁽¹⁾ : **675*** (ตัวอย่าง R32 ref. AR4)

⁽¹⁾GWP = ค่าศักยภาพในการทำให้เกิดภาวะโลกร้อน

ปริมาณสารทำความเย็นระบุไว้ที่ป้ายข้อมูลของเครื่อง

* ค่านี้จะอ้างอิงตามระเบียบว่าด้วยก๊าซกลุ่มฟลูออรีน (F gas regulation) 517/2014

ชิ้นส่วนอุปกรณ์เสริม

ตัวเครื่องภายใน			
หมายเลข	ชื่อชิ้นส่วน	หมายเลข	ชื่อชิ้นส่วน
①	 แผ่นติดตั้ง × 1	②	 รีโมทคอนโทรลไร้สาย × 1
③	 แบตเตอรี่ × 2	④	 โครงเสียบรีโมทคอนโทรล × 1
⑤	 แผ่นกรอง Ultra Fresh × 1	⑥	 สกรูยึด × 6
⑦	 สกรูหัวแบน × 2	⑧	 คู่มือการใช้งาน × 1
⑨	 คู่มือการติดตั้ง × 1		

แผ่นกรองอากาศ

ทำความสะอาดแผ่นกรองทุก ๆ 2 สัปดาห์

1. เปิดหน้ากากด้านหน้า (ช่องลมเข้า)
2. ถอดแผ่นกรองอากาศออก หากมีการติดตั้งบนแผ่นกรองอากาศ
3. ดูดฝุ่นหรือล้างแผ่นกรองด้วยน้ำ แล้วปล่อยให้แห้ง
4. ประกอบแผ่นกรองเข้าที่และปิดหน้ากากด้านหน้า

แผ่นกรอง Ultra Fresh

บำรุงรักษาแผ่นกรองอากาศให้บริสุทธิ์และทำให้กลับสภาพเหมือนใหม่เสมอ



ทำความสะอาดทุก ๆ 6 เดือน หรือเมื่อมีฝุ่นปิดคลุมแผ่นกรอง

1. เชยหรือเป่าด้วยลมปกติ หรือ
2. ล้างแผ่นกรองในน้ำและทำให้แห้งโดยตากแดดหรือปล่อยให้แห้ง (ห้ามล้างด้วยผลิตภัณฑ์ทำความสะอาดหรือน้ำสะอาดโดยใช้แรงดันสูง)
3. เปลี่ยนทุก ๆ 3 ปีหรือเร็วกว่านั้น (P/N: RB-A701FE)

หมายเหตุ: อายุการใช้งานของแผ่นกรองขึ้นอยู่กับระดับของฝุ่นที่อยู่ในสภาวะแวดล้อมนั้น

หากระดับของฝุ่นมีมาก อาจจะต้องทำความสะอาดและเปลี่ยนแผ่นกรองบ่อย

เราขอแนะนำให้ติดตั้งแผ่นกรองอากาศเพื่อเพิ่มประสิทธิภาพของเครื่องปรับอากาศในการกรองอากาศบริสุทธิ์และดับกลิ่นมากยิ่งขึ้น



ตัวเครื่องภายใน

สถานที่ติดตั้ง


- สถานที่ซึ่งมีพื้นที่โดยรอบเครื่องตามที่แสดงไว้ในผังการติดตั้ง
- สถานที่ซึ่งไม่มีสิ่งกีดขวางใกล้ช่องรับและระบายอากาศ
- สถานที่ซึ่งติดตั้งห้องไปยังตัวเครื่องภายนอกได้ง่าย
- สถานที่ซึ่งสามารถเปิดหน้ากากล่องออกได้
- การติดตั้งภายในอาคารควรมีความสูงในการติดตั้งอย่างน้อย 2.5 ม. และต้องหลีกเลี่ยงการวางสิ่งของใดๆ ไว้บนตัวเครื่องภายในด้วย

ข้อควรระวัง

- อย่าให้ตัวรับสัญญาณไร้สายของตัวเครื่องภายในถูกแสงแดดโดยตรง
- ส่วนไมโครโปรเซสเซอร์ในตัวเครื่องภายในไม่ควรอยู่ใกล้กับแหล่งที่มีคลื่นวิทยุ (RF) รบกวน (รายละเอียดดูในคู่มือการใช้งาน)

รีโมทคอนโทรล


- ไม่ควรมีสิ่งกีดขวางการส่งสัญญาณจากรีโมทคอนโทรล เช่น ฝ่ามือ ซึ่งจะกั้นสัญญาณจากตัวเครื่องภายในได้
- อย่าติดตั้งรีโมทคอนโทรลในสถานที่ถูกแสงแดดโดยตรง หรือใกล้กับแหล่งทำความร้อน เช่น เตาไฟ
- เก็บรีโมทคอนโทรลให้ห่างจากเครื่องรับโทรทัศน์หรือเครื่องเสียงที่ใกล้ที่สุดอย่างน้อย 1 ม. (เพื่อป้องกันการรบกวนของสัญญาณ)
- ตำแหน่งของรีโมทคอนโทรลถูกกำหนดตามที่แสดงไว้ด้านล่าง

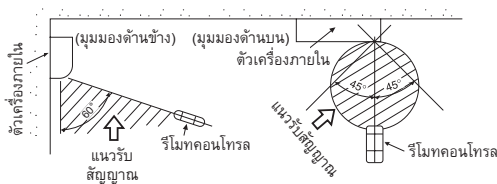

การเจาะรูและการติดแผ่นติดตั้ง

การเจาะรู

เมื่อติดตั้งท่อสารทำความเย็นจากด้านหลัง

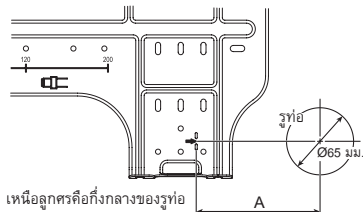


ชื่อรุ่น	A (หน่วย : มม.)
42TVDA010, 013	100
42TVDA016, 018	120

1. หลังจากกำหนดตำแหน่งรูที่บนแผ่นยึด (➡) เจาะรูท่อ (Ø65 มม.) ให้เอียงลงไปทางตัวเครื่องภายในเพียงเล็กน้อย


หมายเหตุ

- เมื่อเจาะผนังที่มีโครงโลหะ โครงลวด หรือแผ่นโลหะ ให้ใช้ผ้าปิดสำหรับรูท่อซึ่งขายต่างหาก

การติดแผ่นติดตั้ง

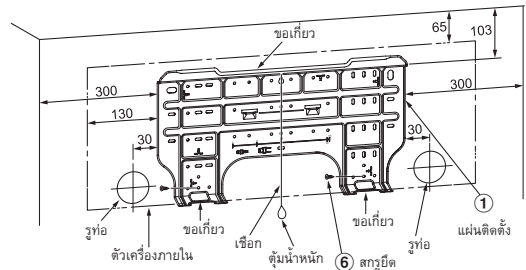

สำหรับรุ่น 42TVDA010, 013

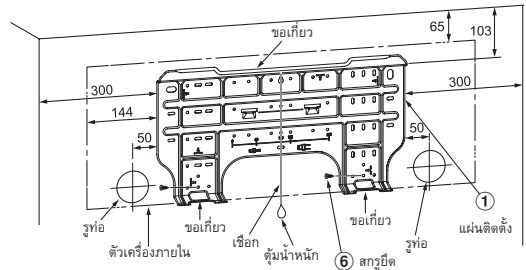


สำหรับรุ่น 42TVDA016, 018

เมื่อติดแผ่นติดตั้งกับผนังโดยตรง

1. ติดแผ่นติดตั้งเข้ากับผนังโดยใช้สกรูยึดที่ส่วนบนและส่วนล่างเพื่อเกี่ยวเข้ากับตัวเครื่องภายใน
2. การติดแผ่นติดตั้งบนผนังคอนกรีตด้วยสลักเกลียวสมอ ให้ใช้สำหรับสลักเกลียวสมอตามภาพแสดงด้านล่าง
3. ติดตั้งแผ่นติดตั้งบนผนังตามแนวนอน

ข้อควรระวัง

เมื่อติดตั้งแผ่นติดตั้งด้วยสกรูยึด อย่าใช้สำหรับสลักเกลียวสมอ ไม่เช่นนั้นเครื่องอาจตกลงมา และทำให้ได้รับบาดเจ็บและความเสียหายต่อทรัพย์สิน

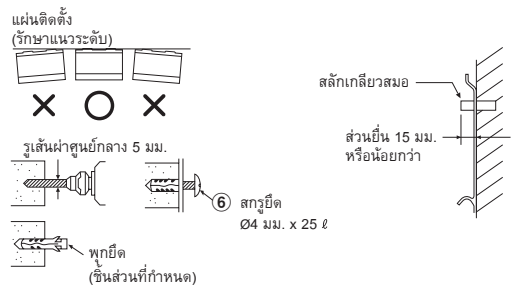

ข้อควรระวัง

การติดตั้งเครื่องไม่มั่นคงอาจทำให้ได้รับบาดเจ็บและความเสียหายต่อทรัพย์สินถ้าเครื่องตกลงมา

- ในกรณีที่ผนังเป็นแบบบล็อก อิฐ คอนกรีต หรือชนิดคล้ายกันนี้ ให้เจาะรูขนาดเส้นผ่าศูนย์กลาง 5 มม. ที่ผนัง
- ใส่สกรูยึดสำหรับสกรูยึด ⑥.


หมายเหตุ

- ยึดมุมสี่ด้านและส่วนล่างของแผ่นติดตั้งด้วยสกรูยึด 4 ถึง 6 ตัว เพื่อติดตั้ง

การติดตั้งท่อน้ำทิ้งและท่อส่ง

การวางท่อน้ำทิ้งและท่อส่ง

- * เนื่องจากหยดน้ำอาจทำให้เครื่องเกิดปัญหาได้ จึงต้องหุ้มฉนวนท่อทั้งสองท่อ (ใช้โฟมโพลีเอธิลีนเป็นฉนวน)

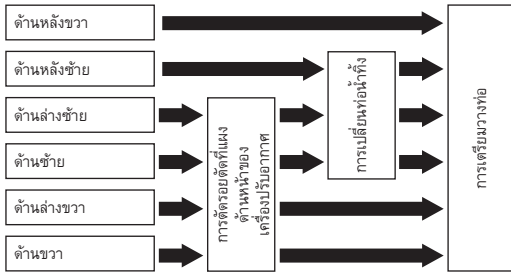

1. การตัดรอยตัดที่แผงหน้าของเครื่องปรับอากาศ


ให้ตัดพลาสติกทางด้านซ้ายหรือขวาที่แผงหน้าของเครื่องปรับอากาศสำหรับการนำท่อสารทำความเย็นออกจากด้านซ้ายหรือขวา และตัดพลาสติกทางด้านล่างซ้าย หรือขวาที่แผงหน้าของเครื่องปรับอากาศเพื่อนำท่อออกจากด้านล่างซ้าย โดยใช้คีมในการตัดพลาสติก

2. การเปลี่ยนท่อน้ำทิ้ง

สำหรับการต่อท่อทางด้านซ้าย การต่อด้านล่างซ้าย และการต่อด้านหลังซ้าย จะต้องเปลี่ยนท่อน้ำทิ้งและจุกปิดท่อน้ำทิ้ง


วิธีการถอดท่อน้ำทิ้ง

- สามารถถอดท่อน้ำทิ้งออกได้โดยถอดสกรูที่ยึดท่อน้ำทิ้ง จากนั้นดึงท่อออก
- เมื่อถอดท่อน้ำทิ้ง ควรระวังไม่ให้โดนส่วนที่แหลมคมของแผ่นเหล็ก เพราะอาจทำให้บาดเจ็บได้
- ในการประกอบท่อน้ำทิ้ง ให้เสียบท่อน้ำทิ้งให้แน่นจนกระทั่งส่วนเชื่อมต่อสัมผัสกับฉนวนกันความร้อน แล้วยึดด้วยสกรูตัวเดิม




วิธีการถอดจุกปิดท่อน้ำทิ้ง

ใช้คีมหัวแหลมหนีบจุกปิดท่อน้ำทิ้ง แล้วดึงออก




วิธีปิดจุกปิดท่อน้ำทิ้ง

- 1) สอดประแจหกเหลี่ยม (4 มม.) เข้าไปกลางจุกปิดท่อน้ำทิ้ง
- 2) ดันจุกปิดท่อน้ำทิ้งเข้าไปให้แน่น



เวลาใส่จุกปิดท่อน้ำทิ้ง ห้ามใช้น้ำมันหล่อลื่น (น้ำมันหล่อลื่นเครื่องเย็น) เพราะจะทำให้อายุการใช้งานสั้นลงและทำให้เกิดการรั่วที่จุกปิดท่อน้ำทิ้งได้




ข้อควรระวัง

ใส่ท่อน้ำทิ้งและจุกปิดท่อน้ำทิ้งให้แน่นหนา มิฉะนั้นน้ำอาจรั่วได้


การต่อท่อด้านขวาหรือซ้าย

- หลังกรีดรอยตัดภายในแผงด้านหน้า ตัวเครื่องปรับอากาศด้วยมีดหรือลิ้ม ให้ตัดออกด้วยคีมหรือเครื่องมืออื่นที่คล้ายกัน

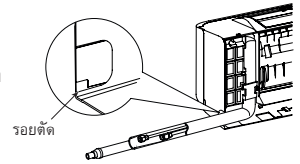

การต่อท่อด้านขวาล่างหรือด้านซ้ายล่าง

- หลังกรีดรอยตัดภายในแผงด้านหน้า ตัวเครื่องปรับอากาศด้วยมีดหรือลิ้ม ให้ตัดออกด้วยคีมหรือเครื่องมืออื่นที่คล้ายกัน

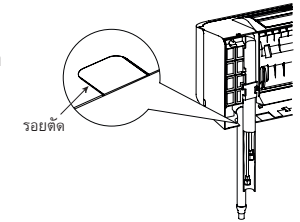


การต่อท่อออกด้านซ้าย

- ตัดท่อต่อให้ห่างจากผนัง 43 มม. ถ้าตัดท่อมากกว่า 43 มม. อาจทำให้ตัวเครื่องภายในติดบนผนังไม่มั่นคง ดังนั้นควรตัดท่อโดยใช้เครื่องตัดแบบสปริงเพื่อไม่ให้ท่อบุบ

ตัดท่อต่อใช้รีซีมีประมาณ 30 มม.

การต่อท่อส่งหลังการติดตั้งเครื่อง (ดูรูป)

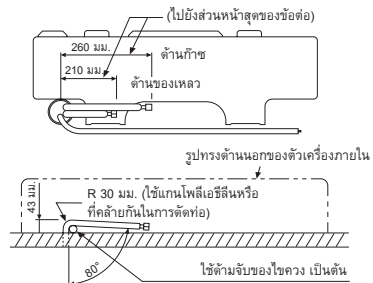


หมายเหตุ

ถ้าตัดท่อไม่ถูกต้อง อาจทำให้ตัวเครื่องภายในติดบนผนังไม่มั่นคง หลังสอดท่อต่อเชื่อมผ่านรูท่อ ต่อท่อต่อเชื่อมเข้ากับท่อจากตัวเครื่องและพันรอบท่อด้วยเทปพันท่อ

ข้อควรระวัง



- พันท่อต่อ (2 ท่อ) และสายเชื่อมต่อเข้าด้วยกันให้แน่นด้วยเทปพันท่อ ในกรณีที่เป็นท่อออกจากซ้ายและทางด้านหลังซ้าย พันเฉพาะท่อต่อ (2 ท่อ) เข้าด้วยกันด้วยเทปพันท่อ

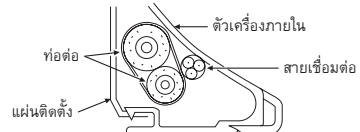


- จัดวางท่ออย่างระมัดระวัง อย่าให้ท่อใดๆ ยื่นออกจากแผ่นหลังของตัวเครื่องภายใน
- ต่อท่อจากตัวเครื่องและท่อต่อเชื่อมเข้าด้วยกันอย่างระมัดระวัง และเทปที่หุ้มบนท่อต่อเชื่อมออก เพื่อหลีกเลี่ยงการพันเทปสองชั้นที่ข้อต่อ หุ้มข้อต่อด้วยเทปไวนิล หรืออื่นๆ
- เนื่องจากหยดน้ำจะทำให้เครื่องมีปัญหา จึงต้องหุ้มฉนวนท่อต่อเชื่อมทั้งสองท่อ (ใช้โฟมโพลีเอธิลีนเป็นฉนวน)
- เมื่อตัดท่อ ตัดอย่างระมัดระวังอย่าให้ท่อบุบ

การติดตั้งเครื่องภายใน

1. สอดท่อผ่านช่องในผนัง และเกี่ยวตัวเครื่องภายในบนแผ่นติดตั้งเข้าที่ขอเกี่ยวบน
2. เลื่อนตัวเครื่องภายในไปมาซ้ายขวาเพื่อทดสอบว่าเครื่องเกี่ยวอยู่บนแผ่นติดตั้งแน่นดีแล้ว
3. ขณะดันตัวเครื่องภายในเข้าไปยังผนัง เกี่ยวเครื่องที่ส่วนล่างบนแผ่นติดตั้ง ตัวเครื่องภายในเข้าหาตัวเพื่อทดสอบว่าเครื่องเกี่ยวอยู่บนแผ่นติดตั้งแน่นดีแล้ว



- สำหรับการถอดตัวเครื่องภายในออกจากแผ่นติดตั้ง ให้ดึงตัวเครื่องภายในเข้าหาตัวขณะดันข้างใต้ตรงส่วนที่ระบุไว้




การระบายน้ำ


1. ปลอยท่อน้ำทิ้งให้ลาดลง

หมายเหตุ

- ควรเจาะรูด้านนอกให้ลาดเอียงลงเล็กน้อย

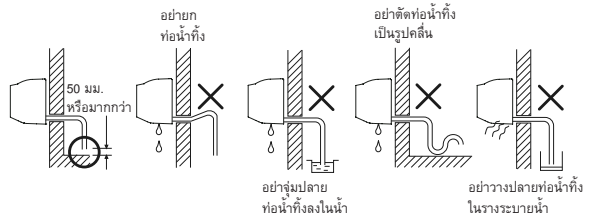

2. ทดลองใส่น้ำในถาดรับน้ำทิ้ง เพื่อทดสอบการระบายของน้ำออกสู่ภายนอก
3. เมื่อต่อท่อต่อน้ำทิ้ง หุ้มส่วนเชื่อมต่อท่อต่อน้ำทิ้งด้วยฉนวนหุ้มท่อ




ข้อควรระวัง

จัดวางท่อน้ำทิ้งให้ระบายน้ำจากเครื่องได้สะดวก

การระบายน้ำที่ไม่เหมาะสมทำให้เกิดการหยดของน้ำได้

เครื่องปรับอากาศนี้ถูกออกแบบให้ระบายน้ำที่เกิดจากหยดน้ำซึ่งเกาะอยู่ด้านหลังของตัวเครื่องภายในให้ไหลลงถาดรับน้ำทิ้ง ดังนั้น ไม่ควรติดตั้งสายไฟหรืออุปกรณ์อื่นๆ เหนือแนวระบายน้ำ



ตัวเครื่องภายนอก

สถานที่ติดตั้ง

- สถานที่ซึ่งมีพื้นที่โดยรอบตัวเครื่องภายนอกตามที่แสดงไว้ในผังการติดตั้ง
- สถานที่ซึ่งรองรับน้ำหนักตัวเครื่องภายนอกได้และไม่เพิ่มระดับเสียงและการสั่น
- สถานที่ซึ่งเสี่ยงจากการทำงานและลมที่เป่าออกมาไม่รบกวนเพื่อนบ้าน
- สถานที่ซึ่งไม่ถูกลมกรรโชก
- สถานที่ซึ่งไม่มีการรั่วของก๊าซไวไฟ
- สถานที่ซึ่งไม่กีดขวางทางเดิน
- เมื่อจะติดตั้งตัวเครื่องภายนอกในตำแหน่งที่ถูกยกขึ้น บิดขาตัวเครื่องให้แน่น
- ความยาวของท่อที่สามารถเชื่อมต่อได้

รุ่น	38TVDA010	38TVDA013	38TVDA016	38TVDA018
ไม่ต้องเพิ่มสารทำความเย็น	ไม่เกิน 15 ม.	ไม่เกิน 15 ม.	ไม่เกิน 15 ม.	ไม่เกิน 15 ม.
ความยาวสูงสุด	15 ม.	15 ม.	20 ม.	20 ม.
การชาร์จสารทำความเย็นเพิ่มเติม	-	-	16 - 20 ม. (20 ก. / 1 ม.)	16 - 20 ม. (20 ก. / 1 ม.)
การชาร์จสารทำความเย็นสูงสุด	0.42 กก.	0.46 กก.	0.69 กก.	0.97 กก.

- ความสูงของสถานที่ติดตั้งเครื่องภายนอกที่ใช้ได้

รุ่น	38TVDA010	38TVDA013	38TVDA016	38TVDA018
ความสูงสูงสุด	12 ม.	12 ม.	12 ม.	12 ม.

- ติดตั้งในตำแหน่งซึ่งเครื่องปรับอากาศไม่เกิดปัญหาจากน้ำทิ้งหรือติดตั้งในสถานที่ที่ระบายน้ำได้ดี
- ติดตั้งในสถานที่ที่สามารถติดตั้งเครื่องปรับอากาศในแนวนอนได้

ข้อควรระวังในการเดินสารทำความเย็น


ใช้เครื่องมือที่มีความเที่ยงตรงโดยใช้อย่างน้อย 10 กรัม ต่อระดับเข็มวัดเมื่อทำการเดินสารทำความเย็น
ห้ามใช้เครื่องชั่งน้ำหนักทั่วไปหรือเครื่องมือลักษณะเดียวกันนี้

ข้อควรระวัง

เมื่อติดตั้งตัวเครื่องภายนอกในบริเวณที่มีน้ำในท่อระบายน้ำอาจทำให้เกิดปัญหาได้ ให้ใช้วาล์วซิลิโคนหรือวัสดุขาวเพื่อปิดรอยรั่ว

ข้อควรระวัง

1. ติดตั้งตัวเครื่องภายนอกโดยอย่าให้มีสิ่งกีดขวางการระบายอากาศ
2. เมื่อติดตั้งตัวเครื่องภายนอกในสถานที่ที่มีลมกรรโชกเสมอ เช่น ชายทะเลหรือชั้นสูงๆ ของอาคาร ควรป้องกันการทำงานของพัดลมโดยใช้ท่อลมหรือแผ่นกันลม
3. ควรติดตั้งตัวเครื่องภายนอกให้พ้นจากทิศทางลม โดยเฉพาะในบริเวณที่มีลมแรง
4. การติดตั้งในสถานที่ต่อไปนี้อาจทำให้เกิดปัญหาอย่าติดตั้งเครื่องในสถานที่ดังนี้
 - ที่ซึ่งเต็มไปด้วยน้ำมันเครื่อง
 - ที่ซึ่งมีความเค็ม เช่น ชายทะเล
 - ที่ซึ่งเต็มไปด้วยก๊าซซัลไฟด์
 - ที่ซึ่งอาจก่อให้เกิดคลื่นความถี่สูง เช่น จากเครื่องเสียง เครื่องเชื่อมโลหะ และอุปกรณ์ทางการแพทย์



การต่อท่อส่งสารทำความเย็น

การบานท่อ

1. ตัดท่อกับตัวเครื่องด้วยเครื่องตัดท่อ



2. สวมแฟร้นท์เข้าไปในท่อ และบานท่อ


- ขอบการขยายในการบานท่อ : A (หน่วย : มม.)

RIDGID (แบบคลัทช์)

เส้นผ่านศูนย์กลางภายนอกของท่อทองแดง	เครื่องมือมาตรฐาน R32	เครื่องมืออื่นที่มีคุณสมบัติที่ทดแทนกันได้
Ø6.35	0 ถึง 0.5	1.0 ถึง 1.5
Ø9.52	0 ถึง 0.5	1.0 ถึง 1.5
Ø12.70	0 ถึง 0.5	1.0 ถึง 1.5
ความหนาของท่อ	0.8 มม. หรือมากกว่านั้น	

IMPERIAL (แบบใช้น็อตทางปลา)

เส้นผ่านศูนย์กลางภายนอกของท่อทองแดง	R32
Ø6.35	1.5 ถึง 2.0
Ø9.52	1.5 ถึง 2.0
Ø12.70	2.0 ถึง 2.5
ความหนาของท่อ	0.8 มม. หรือมากกว่านั้น




ข้อควรระวัง

- ขณะที่ตักแต่งขอบท่อ ต้องไม่ทำให้พื้นผิวด้านในเกิดรอยขีดข่วน
- รอยขีดข่วนบนพื้นผิวด้านใน ที่เกิดจากการบานท่ออาจเป็นสาเหตุทำให้สารทำความเย็นรั่วได้

การขันแน่นข้อต่อ

จัดให้ท่อที่เชื่อมอยู่กึ่งกลาง และขันแฟร้นท์ให้แน่นด้วยมือ จากนั้นขันแป้นเกลียวให้แน่นด้วยประแจปากตาย และประแจทอร์กตามภาพแสดง

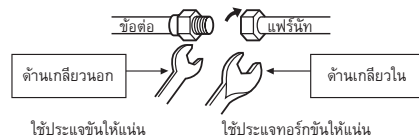

ข้อควรระวัง


อย่าใช้แรงบิดมากเกินไป ไม่เช่นนั้น แป้นเกลียวอาจแตกได้ ขึ้นอยู่กับการจัดตั้งด้วย

(หน่วย : นิวตันเมตร)

เส้นผ่าศูนย์กลางภายนอกของท่อทองแดง	แรงบิดในการขันแน่น
Ø6.35 มม.	16 ถึง 18 (1.6 ถึง 1.8 กก.ม.)
Ø9.52 มม.	30 ถึง 42 (3.0 ถึง 4.2 กก.ม.)
Ø12.70 มม.	50 ถึง 62 (5.0 ถึง 6.2 กก.ม.)

• แรงบิดในการขันแน่นการต่อท่อแบบปลายบาน

แรงดันของสารทำความเย็นรุ่น R32 สูงกว่ารุ่น R22 (ประมาณ 1.6 เท่า) ดังนั้นให้ขันแน่นท่อแบบปลายบานซึ่งเชื่อมต่อตัวเครื่องภายนอกกับตัวเครื่องภายในด้วยแรงบิดที่กำหนดไว้ โดยใช้ประแจวัดแรงบิด ถ้าต่อท่อแบบปลายบานไม่ถูกต้อง นอกจากจะเป็นสาเหตุให้ก๊าซรั่วแล้ว ยังอาจทำให้วงจรสารทำความเย็นเกิดปัญหา



การไล่อากาศออก

หลังต่อท่อส่งเข้าตัวเครื่องภายใน คุณสามารถไล่อากาศพร้อมกันได้


การไล่อากาศ

ไล่อากาศในท่อต่อเชื่อมและในตัวเครื่องภายในด้วยปั๊มสุญญากาศ อย่าใช้สารทำความเย็นในตัวเครื่องภายนอก สำหรับรายละเอียดดูคู่มือของปั๊มสุญญากาศ

การใช้ปั๊มสุญญากาศ

ใช้ปั๊มสุญญากาศที่มีระบบป้องกันการไหลย้อนกลับ เพื่อกันไม่ให้น้ำมันภายในปั๊มไหลกลับเข้าไปในท่อของเครื่องปรับอากาศเมื่อปั๊มหยุดทำงาน (หากมีน้ำมันที่อยู่ในเครื่องปั๊มสุญญากาศเข้าไปในเครื่องปรับอากาศที่ใช้สารทำความเย็นชนิด R32 อาจทำให้วงจรระบบทำความเย็นของเครื่องปรับอากาศทำงานไม่ได้)

1. ต่อท่อเติมสารทำความเย็นจากวาล์วร่วมไปยังวาล์วบริการของวาล์วร่วมที่ด้านก๊าซ
2. ต่อท่อเติมสารทำความเย็นเข้ากับพอร์ตของปั๊มสุญญากาศ
3. เปิดคัมจับวาล์วเกจพร้อมด้านแรงดันต่ำให้สุด
4. เปิดปั๊มเพื่อเริ่มการถ่ายอากาศ การถ่ายอากาศใช้เวลาประมาณ 15 นาที ถ้าท่อส่งมีความยาว 20 ม. (15 นาที สำหรับ 20 ม.) (สมมติความจุของปั๊มคือ 27 ลิตรต่อนาที) และค่าที่ควรอ่านได้จากเกจแรงดันประกอบคือ -101 กิโลปาสกาล (-76 ซม.ปรอท)
5. ปิดคัมจับวาล์วเกจพร้อมด้านแรงดันต่ำ
6. เปิดก้านวาล์วของวาล์วร่วม (ทั้งด้านก๊าซและของเหลว)
7. ถอดท่อเติมสารทำความเย็นออกจากวาล์วบริการ
8. ขันจุกปิดบนวาล์วร่วมให้แน่น

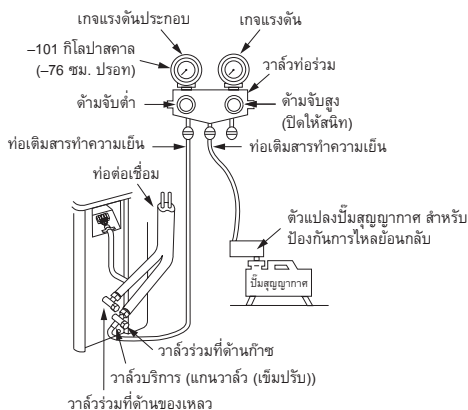

ข้อควรระวัง

• 7 จุดสำคัญในการเดินท่อ

- (1) ขจัดฝุ่นและความชื้น (ภายในท่อต่อเชื่อม)
- (2) ขันแน่นข้อต่อ (ระหว่างท่อและตัวเครื่อง)
- (3) ถ่ายอากาศในท่อต่อเชื่อมออกด้วยปั๊มสุญญากาศ
- (4) ตรวจสอบการรั่วของสารทำความเย็น (จุดเชื่อมต่อ)
- (5) โปรดแน่ใจว่าวาล์วร่วมเปิดจนสุดแล้วก่อนใช้งาน
- (6) ห้ามใช้อุปกรณ์เชื่อมต่อแบบใช้ซ้ำได้ และข้อต่อแบบบานภายในอาคาร หากใช้อุปกรณ์เชื่อมต่อแบบใช้ซ้ำได้ภายในอาคารต้องทำการเปลี่ยนส่วนซีลกันรั่วใหม่ หากใช้ข้อต่อแบบบานภายในอาคารต้องทำการบานท่อใหม่
- (7) ห้ามใช้งานเครื่องปรับอากาศในกรณีที่ไม่มีการทำความเย็นในระบบ

ข้อควรระวังในการควบคุมวาล์วร่วม

- เปิดก้านวาล์วออกตลอดทาง แต่อย่าเปิดเกินตัวสตอปเปอร์

ขนาดท่อของวาล์วร่วม	ขนาดของประแจหกเหลี่ยม
12.70 มม. และเล็กกว่า	A = 4 มม.
15.88 มม.	A = 5 มม.

กระบวนการปิดปั๊ม


1. ปิดระบบเครื่องปรับอากาศ
2. เชื่อมต่อท่อจากวาล์วร่วมไปยังช่องบริการของวาล์วอัดแผ่นปะเก็นที่ด้านก๊าซ
3. เปิดระบบเครื่องปรับอากาศเพื่อให้หมดทำความเย็นให้นานกว่า 10 นาที
4. ตรวจสอบแรงดันทำงานของระบบ ซึ่งควรจะเป็นค่าปกติ (อ้างอิงข้อมูลจำเพาะผลิตภัณฑ์)
5. คลายฝาปิดก้านวาล์วของวาล์วบริการทั้งสองตัว
6. ใช้ประแจหกเหลี่ยมเพื่อหมุนก้านวาล์วด้านของเหลวให้ปิดสนิท (*ต้องมั่นใจว่าไม่มีอากาศเข้าไปในระบบ)
7. ปิดระบบเครื่องปรับอากาศต่อเนื่องจนกว่าเกจวัดพร้อมอ่านค่าได้ 0.5 - 0 กก./ซม.²
8. ใช้ประแจหกเหลี่ยมขันก้านวาล์วด้านก๊าซให้ปิดสนิท และหลังจากนั้นให้ปิดระบบเครื่องปรับอากาศโดยทันที
9. ถอดเกจวัดพร้อมออกจากร่องบริการของวาล์วอัดแผ่นปะเก็น
10. ขันฝาปิดก้านวาล์วที่วาล์วบริการทั้งสองตัวให้แน่น

ข้อควรระวัง

ควรจะมีการตรวจสอบสภาวะการทำงานของคอมเพรสเซอร์ ขณะทำการปิดปั๊ม โดยจะต้องไม่มีเสียงดังผิดปกติ หากมีสภาวะการทำงานที่ผิดปกติเกิดขึ้น ต้องปิดระบบเครื่องปรับอากาศในทันที

- ขันฝาครอบบนวาล์วให้แน่นด้วยแรงบิดตามตารางต่อไปนี้

จุก	ขนาดของจุก (H)	แรงบิด
จุกปิดก้านวาล์ว	H17 - H19	14~18 นิวตันเมตร (1.4 ถึง 1.8 กก.ม.)
	H22 - H30	33~42 นิวตันเมตร (3.3 ถึง 4.2 กก.ม.)
จุกปิดวาล์วบริการ	H14	8~12 นิวตันเมตร (0.8 ถึง 1.2 กก.ม.)
	H17	14~18 นิวตันเมตร (1.4 ถึง 1.8 กก.ม.)

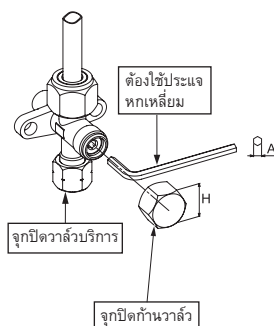

การทำงานเกี่ยวกับไฟฟ้า


รุ่น	42TVDA010	42TVDA013	42TVDA016	42TVDA018
แหล่งจ่ายไฟฟ้า	50Hz, 220V 1 เฟส			
กระแสไฟฟ้าสูงสุด	5.60A	6.65A	8.20A	9.80A
ขนาดเบรกเกอร์วงจรไฟฟ้า	15A	15A	15A	15A
สายของแหล่งจ่ายไฟ	H07RN-F หรือ 60245 IEC66 (1.25 มม. ² หรือใหญ่กว่า)			H07RN-F หรือ 60245 IEC66 (1.5 มม. ² หรือใหญ่กว่า)
สายเชื่อมต่อ	H07RN-F หรือ 60245 IEC66 (0.75 มม. ² หรือใหญ่กว่า)			

การเชื่อมต่อสายไฟ

ตัวเครื่องภายใน


การเดินสายเชื่อมต่อทำได้โดยไม่ต้องถอดแผงด้านหน้าออก

- ถอดหน้ากากด้านหน้า
เปิดหน้ากากด้านหน้าขึ้นและดึงเข้าหัวตัว
- ถอดฝาครอบขั้วต่อและตัวยึดสายไฟ
- สอดสายเชื่อมต่อ (ตามที่กำหนดไว้) เข้าไปในรูที่ผนัง
- ดึงสายเชื่อมต่อผ่านช่องสายไฟที่แผงด้านหลัง ให้สายไฟโผล่ออกมาด้านหน้าประมาณ 20 ซม.
- สอดสายเชื่อมต่อเข้าไปในบล็อกขั้วต่อให้สุด และยึดให้แน่นด้วยสกรู
- แรงบิดในการขันแน่น : 1.2 นิวตันเมตร (0.12 กก.ม.)
- ยึดสายเชื่อมต่อให้แน่นด้วยตัวยึดสายไฟ
- ติดตั้งฝาครอบขั้วต่อ ตัวรองแผ่นด้านหลัง และหน้ากากด้านหน้าที่ตัวเครื่องภายใน

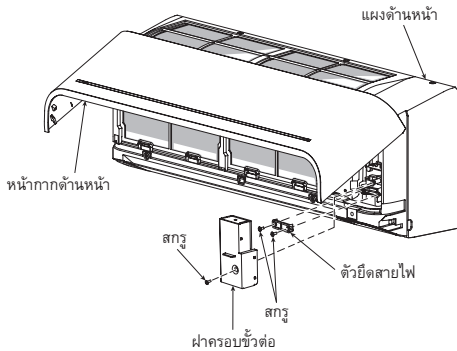


วิธีการติดตั้งหน้ากากด้านหน้าที่ตัวเครื่องภายใน

- สำหรับการประกอบหน้ากากด้านหน้า ให้ประกอบในลำดับย้อนกลับกับการถอด

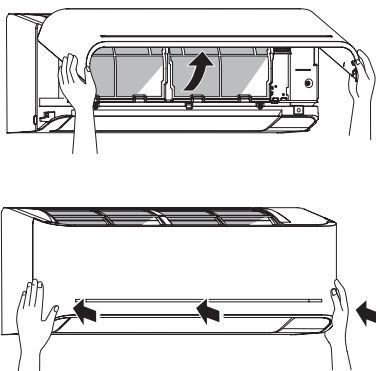


ตัวเครื่องภายนอก (38TVDA010)

- ถอดฝาครอบบวาล์วและฝาครอบขั้วต่อออกจากตัวเครื่องภายนอก
- เชื่อมต่อสายไฟเชื่อมต่อเข้ากับขั้วต่อสายตามที่ระบุไว้ด้วยตัวเลขที่ตรงกันบนกล่องขั้วต่อสายของตัวเครื่องภายในและตัวเครื่องภายนอก
- เมื่อเชื่อมต่อสายไฟเชื่อมต่อเข้ากับขั้วต่อสายตัวเครื่องภายนอก ให้ทำห้วงดิ่งที่แสดงให้เห็นในแผนภาพการติดตั้งของตัวเครื่องภายในและตัวเครื่องภายนอก เพื่อป้องกันน้ำไหลเข้ามาในตัวเครื่องภายนอก
- หุ้มฉนวนสายไฟที่ไม่ใช้งาน (ตัวนำไฟฟ้า) เพื่อป้องกันน้ำไหลเข้ามาในตัวเครื่องภายนอก ให้ดำเนินการดังกล่าวโดยอย่าให้สายไฟสัมผัสกับชิ้นส่วนที่มีไฟฟ้าหรือชิ้นส่วนที่มีโลหะใดๆ

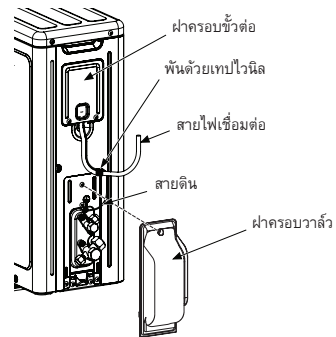

ตัวเครื่องภายนอก (38TVDA013, 016, 018)

- ถอดฝาครอบบวาล์ว, ฝาครอบส่วนที่เป็นไฟฟ้าและตัวยึดสายไฟออกจากตัวเครื่องภายนอก
- ต่อสายเชื่อมต่อเข้ากับขั้วต่อตามที่ระบุไว้โดยให้หมายเลขตรงกับบล็อกขั้วต่อของตัวเครื่องภายในและภายนอก
- เสียบสายไฟและสายเชื่อมต่อเข้าไปในบล็อกขั้วต่อให้สุดอย่างระมัดระวังแล้วยึดไว้ด้วยสกรู
- ใช้เทปไวไฟหรืออื่นๆ พันรอบๆ สายไฟที่ไม่ได้ใช้เพื่อกันไฟฟ้า
- ยึดสายไฟและสายเชื่อมต่อเข้ากับตัวยึดสายไฟ
- ประกอบฝาครอบส่วนที่เป็นไฟฟ้าและฝาครอบบวาล์วลงบนตัวเครื่องด้านนอก

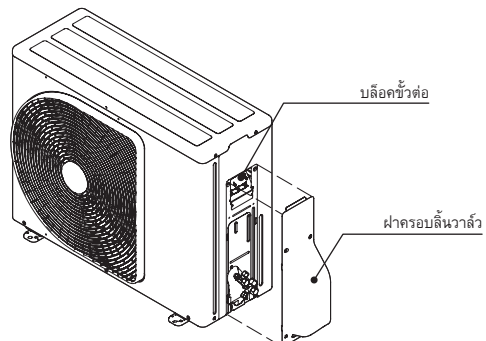


แหล่งจ่ายไฟและการเชื่อมต่อสายเชื่อมต่อ

กำลังกระแสไฟฟ้าของแหล่งจ่ายไฟที่บล็อกหัวต่อของตัวเครื่องภายนอก


ตัวเครื่องภายใน

สายเชื่อมต่อ



การเชื่อมต่อสายเคเบิลเชื่อมต่อกับ ① ② ③ ⊕


บล็อกหัวต่อ (1 2 3)




สายดิน

สายเชื่อมต่อ

ความยาวที่ปกคลุมของสายเชื่อมต่อ



ตัวเครื่องภายนอก

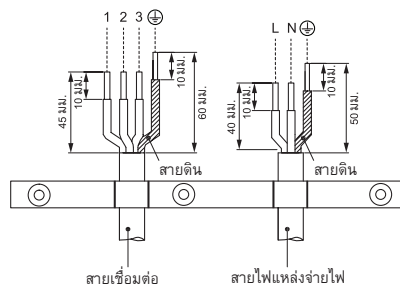


ข้อควรระวัง

1. แหล่งจ่ายไฟต้องเหมือนกับฟิสิกส์ของเครื่องปรับอากาศ
2. ควรมีแหล่งจ่ายไฟสำหรับการใช้งานของเครื่องปรับอากาศโดยเฉพาะ
3. สายไฟของแหล่งจ่ายไฟสำหรับเครื่องปรับอากาศนี้ต้องใช้เบรกเกอร์วงจรไฟฟ้า
4. ควรแน่ใจว่าขนาดและวิธีการเดินสายไฟของแหล่งจ่ายไฟและสายเชื่อมต่อเป็นไปตามข้อกำหนด
5. สายทุกเส้นต้องเชื่อมต่อกันอย่างแน่นหนา
6. เดินสายไฟเพื่อให้เกิดวิสัยสามารถของการเดินสายไฟปกติทั่วไป
7. การเชื่อมต่อสายที่ไม่ถูกต้องอาจทำให้ส่วนที่เป็นไฟฟ้าไหม้
8. การเดินสายไฟที่ไม่ถูกต้องหรือไม่สมบูรณ์ จะทำให้เกิดการติดไหม้หรือคว้นไฟได้
9. ผลิตภัณฑ์นี้สามารถเชื่อมต่อกับแหล่งจ่ายไฟหลักได้
การเชื่อมต่อกับการเดินสายไฟแบบตายตัว: สวิตช์ที่ตัดการเชื่อมต่อหัวสายไฟทุกหัวและมีระยะห่างหน้าสัมผัสอย่างน้อย 3 มม. ในทุกหัวสายไฟต้องเข้าร่วมในการเดินสายแบบตายตัว

ระบบอื่น ๆ

การทดสอบการรั่วของสารทำความเย็น

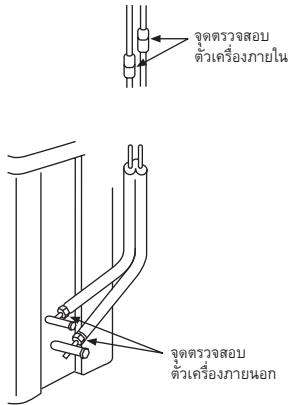

- ตรวจสอบการต่อเฟร้นท์ เพื่อหาการรั่วของสารทำความเย็นด้วยเครื่องตรวจสอบการรั่วของสารทำความเย็นหรือน้ำสบู่

การเลือกรีโมทคอนโทรล A-B

- การติดตั้งเครื่องปรับอากาศสองตัวในห้องเดียวกันหรือห้องที่เชื่อมติดกัน หากหลังการใช้งานด้วยรีโมทคอนโทรล เครื่องปรับอากาศทั้งสองตัวจะได้รับสัญญาณและทำงานเหมือนกัน ในกรณีนี้สามารถตั้งให้เครื่องปรับอากาศและรีโมทคอนโทรลคู่ใดคู่หนึ่งเป็นแบบ B ได้ (เครื่องปรับอากาศจะถูกตั้งเป็นแบบ A มาจากโรงงาน)
- หากตั้งค่าระหว่างรีโมทคอนโทรลและตัวเครื่องภายในไม่เหมือนกัน จะไม่สามารถส่งสัญญาณถึงกันได้
- การต่อท่อและสายไฟ ไม่เกี่ยวข้องกับการตั้งค่าแบบ A หรือการตั้งค่าแบบ B การแยกใช้รีโมทคอนโทรลควบคุมการทำงานชุดภายในแต่ละตัว ในกรณีที่ติดตั้งเครื่องปรับอากาศสองเครื่องใกล้กัน


การตั้งรีโมทคอนโทรล B

1. กดปุ่ม [RESET] ที่ชุดภายในเพื่อเปิดเครื่องปรับอากาศ
2. ชี้อรีโมทคอนโทรลไปที่ชุดภายใน
3. ใช้ปลายดินสอกดปุ่ม [CHECK] ที่รีโมทคอนโทรลค้างไว้โดย ข้อความ "00" จะแสดงขึ้นมาบนหน้าจอ (รูป ①)
4. กดปุ่ม [MODE] ในขณะที่กดปุ่ม [CHECK] ค้างไว้อยู่ สัญลักษณ์ "B" จะแสดงขึ้นมาบนหน้าจอ และข้อความ "00" จะหายไป และเครื่องปรับอากาศจะปิดการทำงาน รีโมทคอนโทรล B ถูกบันทึกไว้แล้ว (รูป ②)

หมายเหตุ: 1. ทำซ้ำขั้นตอนด้านบนเพื่อชี้รีโมทคอนโทรลไปเป็นรีโมทคอนโทรล A
2. รีโมทคอนโทรล A จะไม่แสดงสัญลักษณ์ "A"
3. ค่าที่ตั้งมาจากโรงงานคือ A

การทดสอบ

เพื่อสลับไปยังโหมด TEST RUN (COOL) กดปุ่ม [RESET] ค้างไว้นาน 10 วินาที (จะเกิดเสียงบี๊บสั้น ๆ)

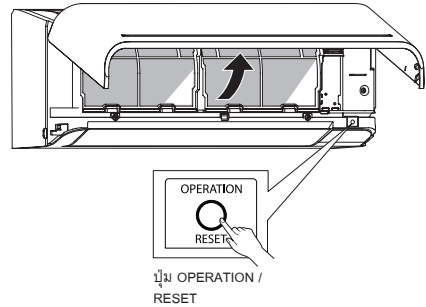

การตั้งค่าระบบเริ่มทำงานใหม่โดยอัตโนมัติ

ผลิตภัณฑ์นี้ถูกออกแบบมาให้สามารถเริ่มทำงานใหม่หลังไฟฟ้าขัดข้อง เครื่องจะเริ่มงานอีกครั้งในสภาวะเดิมได้โดยอัตโนมัติ

รายละเอียด

ผลิตภัณฑ์นี้จัดส่งมาโดยที่การตั้งค่าเริ่มต้นทำงานใหม่อัตโนมัติ อยู่ในสถานะเปิดการทำงานอยู่ ท่านสามารถปิดใช้การทำงานนี้ได้ตามความต้องการ

วิธีการปิดระบบเริ่มทำงานใหม่อัตโนมัติ


- กดปุ่ม [OPERATION] ที่เครื่องภายในค้างไว้ 3 วินาที (มีเสียงบี๊บ 3 ครั้ง แต่ไฟแสดงการทำงานไม่กะพริบ)

วิธีการเปิดระบบเริ่มทำงานใหม่อัตโนมัติ

- กดปุ่ม [OPERATION] ที่เครื่องภายในค้างไว้ 3 วินาที (มีเสียงบี๊บ 3 ครั้ง และไฟแสดงการทำงานกะพริบ 5 ครั้งต่อวินาทีเป็นเวลา 5 วินาที)

หมายเหตุ

- ในกรณีที่มีการตั้งเวลาเปิดหรือการตั้งเวลาปิด ระบบนี้จะไม่ทำงาน

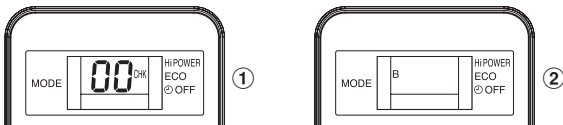

คำชี้แจงการใช้งาน

ที่ห้อง R22 และ R410A ที่มียุสามารถนำมาใช้กับการติดตั้งผลิตภัณฑ์อื่นเวอร์เตอร์ R32

ให้ตรวจสอบว่าท่อที่ใช้อัดเอมัลชันด้วยหัวหรือรูปพร้อมทั้งสภาพ
ที่เหมาะสม และทนทานต่อการใช้งานได้ ถ้าสภาพของท่อสามารถ
ถูกตรวจสอบ และมั่นใจในการใช้งานได้ก็สามารถใช้ท่อที่อยู่อัด
สำหรับ R22 และ R410A สำหรับ R32 ได้

1. แห้ง (ไม่มีความชื้นในท่อ)

- ### 3. แนวหน้า (ไม่มีรอยรั่วในท่อ)

- ข้อห้ามสำหรับการใช้ท่อที่มีอยู่

ในการติดต่อไปนี้ ท่อที่มีอยู่จะไม่สามารถกลับมาใช้ใหม่ได้ ให้ความ
สะดวกต่อที่มีอยู่ หรือเปลี่ยนท่อใหม่

1. เมื่อมีรอยร้าวหรือรอยบุบที่เห็นชัดเจน ให้ใช้เทใหม่สำหรับท่อสารกัก
ความเย็น

2. เมื่อความเหินห่างของท้องที่มีอยู่นั้นบางกว่าความหนาที่กำหนด
“เส้นผ่านศูนย์กลางของท่อ และความหนา”

- แรงดันที่ใช้งาน R32 สูง (1.6 เท่าของ R22) หากมีออร์รับหรือรอบรูปของท่อ หรือใช้ท่อยาวกว่าที่กำหนด อาจทำให้ท่อไม่สามารถทนแรงดันได้ ซึ่งส่งผลทำให้แตก

- * ขนาดเส้นผ่าศูนย์กลางและความหนาของท่อ (มม.)

เส้นผ่าศูนย์กลางภายนอกของท่อ	Ø6.4	Ø9.5	Ø12.7
	ความหนา	0.8	0.8

3. เมื่อระบบที่ยานอวกาศไม่ได้รับเชื้อเพลิง หรือมีเชื้อเพลิงรั่วไหลแล้วต้องไม่ได้รับการซ่อมและเปลี่ยนใหม่
4. อาจเป็นเพราะฝน หรืออากาศ รวมถึงความชื้นที่เข้าไปในท่อ
5. เมื่อท่อเย็นไม่สามารถกลับมามีงานได้แม้ว่าจะใช้อุปกรณ์ซ่อมท่อสารทำความเย็น
6. เป็นไปได้ว่าน้ำแข็งบนก้อนหรือความชื้นยังมากในท่อ

5. หากผู้ปลูกนำชุดความชื้นติดที่อยู่กับท่อสำหรับความชื้น
 - อาจทำให้มีแรงของตอแฉงเกิดขึ้นที่ท่อ
6. เมื่อเครื่องปรับอากาศเริ่มดูดออกหรือสร้างความชื้นออกทางแล้ว ให้ตรวจสอบความชื้นนั้น หากแตกต่างจากปกติในสมารถนำกลับมาใช้ได้
 - หากอุณหภูมิของห้องและน้ำในของสารทำความเย็นสูงเกินไป
 - มีการวนน้ำได้เร็วมีความชื้นไม่ผสมกันเป็นเนื้อ
 - น้ำไม่เปลี่ยนสี หรือตกค้างจำนวนมาก หรือกลิ่นไม่พึงประสงค์
 - มีสิ่งโลหะหรือสิ่งสกปรกเป็นจำนวนมาก ที่สามารถมองเห็นได้ในน้ำในของสารทำความชื้น
7. เมื่อเครื่องปรับอากาศเคยมีประวัติคอมเพล็กซอร์เสียและเคยถูกเปลี่ยนมาแล้ว
 - เมื่อพ่นน้ำมันเปลี่ยนสี สีโลหะ สิ่งสกปรก หรือสิ่งแปลกปลอมเริ่มมีอาจทำให้ตกปัญหา
8. เมื่อมีการติดตั้งและถอดออกเครื่องปรับอากาศที่ไม่ชำนาญ เช่น ผู้ปลูกหรือ
 - 9. หากการของสารทำความชื้น ของเครื่องปรับอากาศที่มีอยู่ในใช้น้ำดื่มเท่านั้น (น้ำดื่ม) Suniso, Feol-S, MS (น้ำดื่มสังเคราะห์), อัดคั้นน้ำเย็น (HAB, Barrel Freeze) ชุดคอมเพล็กซอร์ PVE จะถือว่าเป็นกลุ่มของเออร์
 - แนวโน้มความชื้นของเครื่องคอมเพล็กซอร์เสื่อมสภาพลง


คำอธิบายเบื้องต้นเป็นผลที่ได้รับการรับรองโดยบริษัทของเรา และอธิบายถึงมุมมองของเรา สำหรับผลิตภัณฑ์เครื่องปรับอากาศของบริษัท แต่ไม่ได้รับรองว่าการใช้ที่มีอยู่ของเครื่องปรับอากาศนั้นจะใช้ได้กับ R32

เมื่อทำการถอดเครื่องปรับอากาศภายในและภายนอกเป็นระยะเวลาหนึ่ง ให้ทำการเก็บรักษาอย่างเหมาะสมและนำส่งต่อไปที่

- หากไม่ประสงค์นำตัวแวน ลิ้นฉนวน ฟังก์ชันหรือสายอื่น
- เนื่องจากการควบคุมภายในห้อง
- สวมใส่ถุงมือและถุงเท้าเพื่อป้องกันการทำความสกปรก และจำเป็นต้องเปลี่ยน

ไฟฟอส

จุดเปลี่ยนอุปกรณ์	ระยะเวลา	วิธีการเก็บ
	1 เดือนหรือมากกว่านั้น	ทำให้น้ำแห้ง
	น้อยกว่า 1 เดือน	ทำให้น้ำแห้งหรือพื้นเปียก
ภายนอก	ทุกครั้ง	
ภายใน		

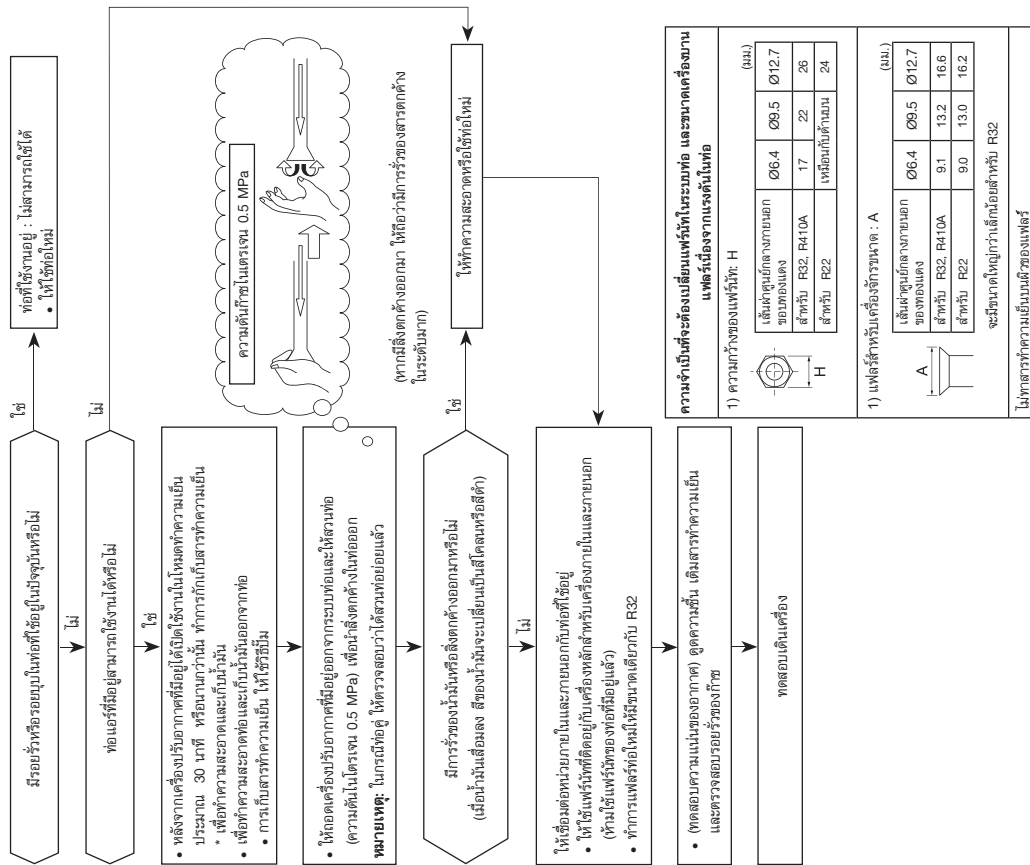

MEMO

MEMO

The Carrier logo is centered on the page. It consists of the word "Carrier" in a white, italicized serif font, enclosed within a dark oval with a thin white border. The background of the entire page is white, decorated with approximately 15 gray, semi-transparent spheres of varying sizes that resemble bubbles or droplets. A large, light gray curved shape sweeps across the bottom right corner of the page.

Carrier



1144180107