




R32

ENGLISH

ภาษาไทย

INSTALLATION MANUAL
AIR CONDITIONER (SPLIT TYPE)

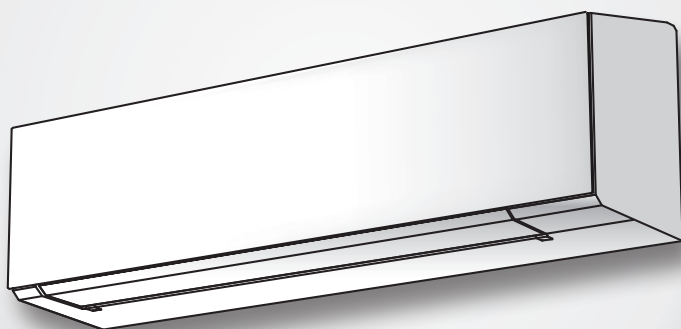

Indoor unit
42TVAB016 Series

Outdoor unit
38TVAB016-I



1126350110

EN	CONTENTS	TH	สารบัญ
PRECAUTIONS FOR SAFETY	1	ข้อควรระวังเพื่อความปลอดภัย	1
ACCESSORY PARTS	5	ชิ้นส่วนอุปกรณ์เสริม	5
INSTALLATION DIAGRAM OF INDOOR AND OUTDOOR UNITS.....	6	ผังการติดตั้งตัวเครื่องภายในและภายนอก	6
■ Optional Installation Parts	6	■ ชิ้นส่วนในการติดตั้ง.....	6
INDOOR UNIT.....	7	ตัวเครื่องภายใน.....	7
■ Installation Place.....	7	■ สถานที่ติดตั้ง	7
■ Cutting a Hole and Mounting Installation Plate.....	7	■ การเจาะรูและการติดแผ่นติดตั้ง.....	7
■ Piping and Drain Hose Installation.....	7	■ การติดตั้งท่อน้ำทิ้งและท่อส่ง	7
■ Indoor Unit Fixing.....	8	■ การติดตั้งตัวเครื่องภายใน	8
■ Drainage	9	■ การระบายน้ำ.....	9
OUTDOOR UNIT	9	ตัวเครื่องภายนอก.....	9
■ Installation Place.....	9	■ สถานที่ติดตั้ง	9
■ Refrigerant Piping Connection	9	■ การต่อท่อส่งสารทำความเย็น.....	9
■ Evacuating	10	■ การไล่อากาศออก	10
ELECTRICAL WORKS	11	การทำงานเกี่ยวกับไฟฟ้า.....	11
■ Wiring Connection.....	11	■ การเชื่อมต่อสายไฟ.....	11
■ Power Supply and Connecting Cable Connection	12	■ แหล่งจ่ายไฟและการเชื่อมต่อสายเชื่อมต่อ	12
OTHERS.....	13	ระบบอื่นๆ	13
■ Gas Leak Test	13	■ การทดสอบการรั่วของสารทำความเย็น.....	13
■ Remote Control A-B Selection	13	■ การเลือกรีโมทคอนโทรล A-B	13
■ Test Operation.....	13	■ การทดสอบ.....	13
■ Auto Restart Function Setting	13	■ การตั้งค่าระบบเริ่มทำงานใหม่โดยอัตโนมัติ.....	13
APPENDIX	14	ภาคผนวก	14

PRECAUTIONS FOR SAFETY

	Read the precautions in this manual carefully before operating the unit.	 This appliance is filled with R32.
---	--	--

EN

■ Warning indications on the air conditioner unit

Warning indication	Description
 CAUTION BURST HAZARD Open the service valves before the operation, otherwise there might be the burst.	CAUTION BURST HAZARD Open the service valves before the operation, otherwise there might be the burst.

- Before installation, please read these precautions for safety carefully.
- Be sure to follow the precautions provided here to avoid safety risks.

The symbols and their meanings are shown below.

WARNING : It indicates that incorrect use of this unit may cause severe injury or death.

CAUTION : It indicates that incorrect use of this unit may cause personal injury (*1), or property damage (*2).

*1: Personal injury means a slight accident, burn, or electrical shock which does not require admission or repeated hospital treatment.

*2: Property damage means greater damage which affects assets or resources.

For general public use

Power supply cord and connecting cable of appliance use shall be at least polychloroprene sheathed flexible cord (design H07RN-F) or cord designation 60245 IEC66. (Shall be installed in accordance with national wiring regulations.)

CAUTION To disconnect the appliance from the main power supply

This appliance must be connected to the main power supply by means of a circuit breaker or a switch with a contact separation of at least 3 mm in all poles.

DANGER

- FOR USE BY QUALIFIED PERSONS ONLY.
- TURN OFF MAIN POWER SUPPLY BEFORE ATTEMPTING ANY ELECTRICAL WORK. MAKE SURE ALL POWER SWITCHES ARE OFF.
FAILURE TO DO SO MAY CAUSE ELECTRIC SHOCK.
- CONNECT THE CONNECTING CABLE CORRECTLY. IF THE CONNECTING CABLE IS CONNECTED WRONGLY, ELECTRIC PARTS MAY BE DAMAGED.
- CHECK THE EARTH WIRE THAT IT IS NOT BROKEN OR DISCONNECTED BEFORE INSTALLATION.
- DO NOT INSTALL NEAR CONCENTRATIONS OF COMBUSTIBLE GAS OR GAS VAPORS.
FAILURE TO FOLLOW THIS INSTRUCTION CAN RESULT IN FIRE OR EXPLOSION.
- TO PREVENT OVERHEATING THE INDOOR UNIT AND CAUSING A FIRE HAZARD, PLACE THE UNIT WELL AWAY (MORE THAN 2 M) FROM HEAT SOURCES SUCH AS RADIATORS, HEATERS, FURNACE, STOVES, ETC.
- WHEN MOVING THE AIR CONDITIONER FOR INSTALLING IT IN ANOTHER PLACE AGAIN, BE VERY CAREFUL NOT TO GET THE SPECIFIED REFRIGERANT (R32) WITH ANY OTHER GASEOUS BODY INTO THE REFRIGERATION CYCLE. IF AIR OR ANY OTHER GAS IS MIXED IN THE REFRIGERANT, THE GAS PRESSURE IN THE REFRIGERATION CYCLE BECOMES ABNORMALLY HIGH AND IT RESULTINGLY CAUSES BURST OF THE PIPE AND INJURIES ON PERSONS.
- IN THE EVENT THAT THE REFRIGERANT GAS LEAKS OUT OF THE PIPE DURING THE INSTALLATION WORK, IMMEDIATELY LET FRESH AIR INTO THE ROOM. IF THE REFRIGERANT GAS IS HEATED BY FIRE OR SOMETHING ELSE, IT CAUSES GENERATION OF POISONOUS GAS.

WARNING

- Never modify this unit by removing any of the safety guards or bypassing any of the safety interlock switches.
- Do not install in a place which cannot bear the weight of the unit.
Personal injury and property damage can result if the unit falls.
- Before doing the electrical work, attach an approved plug to the power supply cord.
Also, make sure the equipment is properly earthed.
- Appliance shall be installed in accordance with national wiring regulations.
If you detect any damage, do not install the unit. Contact your dealer immediately.

- Do not use any refrigerant different from the one specified for complement or replacement.
Otherwise, abnormally high pressure may be generated in the refrigeration cycle, which may result in a failure or explosion of the product or an injury to your body.
- Do not use means to accelerate the defrosting process or to clean, other than those recommended by the manufacturer.
- The appliance shall be stored in a room without continuously operating ignition sources (for example: open flames, an operating gas appliance or an operating electric heater).
- Be aware that refrigerants may not contain an odour.
- Do not pierce or burn as the appliance is pressurized. Do not expose the appliance to heat, flame, sparks, or other sources or ignition. Else, it may explode and cause injury or death.
- For R32 model, use pipes, flare nut and tools which is specified for R32 refrigerant. Using of existing (R22) piping, flare nut and tools may cause abnormally high pressure in the refrigerant cycle (piping), and possibly result in explosion and injury.
- Thickness of copper pipes used R32 must be more than 0.8 mm. Never use copper pipes thinner than 0.8 mm.
- Do not perform flare connection inside a building or dwelling or room, when joining the heat exchanger of indoor unit with interconnection piping. Refrigerant connection inside a building or dwelling or room must be made by brazing or welding. Joint connection of indoor unit by flaring method can only be made at outdoor or at outside of building or dwelling or room. Flare connection may cause gas leak and flammable atmosphere.
- After completion of installation or service, confirm there is no leakage of refrigerant gas. It may generate toxic gas when the refrigerant contacts with fire.
- Comply with national gas regulations.

WARNING

- **After installation work, make sure below before operation.**
 - **Connection pipes are connected properly and no leakage.**
 - **Packed valves are fully open.**

Running compressor without open packed valves may cause abnormal high pressure and parts failure.

Leakage at connection piping may suck air and make further high pressure cause burst and injure.

- **During pump down work make sure below process.**
 - **Don't mix air into the refrigerant cycle.**
 - **Stop the compressor before removing piping after packed valves are fully closed.**

Removing piping under the compressor running and packed valves open, air might be sucked and refrigeration cycle pressure becomes abnormally high, and it causes burst or injury on persons.

CAUTION

- Exposure of unit to water or other moisture before installation could result in electric shock.
Do not store it in a wet basement or expose to rain or water.
- After unpacking the unit, examine it carefully for possible damage.
- Do not install the unit at place where leakage of flammable gas may occur.
In case gas leaks and accumulates at surrounding of the unit, it may cause of fire.
- Do not install in a place that can increase the vibration of the unit.
Do not install in a place that can amplify the noise level of the unit or where noise and discharged air might disturb neighbors.
- To avoid personal injury, be careful when handling parts with sharp edges.
- Please read this installation manual carefully before installing the unit. It contains further important instructions for proper installation.
- The manufacturer shall not assume any liability for the damage caused by not observing the description of this manual.

REQUIREMENT OF REPORT TO THE LOCAL POWER SUPPLIER

Please make absolutely sure that the installation of this appliance is reported to the local power supplier before installation. If you experience any problems or if the installation is not accepted by the supplier, the service agency will take adequate countermeasures.

■ **Important information regarding the refrigerant used**

This product contains fluorinated greenhouse gases.

Do not vent gases into the atmosphere.

Refrigerant type: **R32**

GWP⁽¹⁾ value: **675** * (ex. R32 ref. AR4)

⁽¹⁾GWP = global warming potential

The refrigerant quantity is indicated on the unit name plate.

* This value is based on F gas regulation 517/2014

ACCESSORY PARTS

Indoor Unit			
No.	Part name	No.	Part name
①	 Installation plate × 1	②	 Wireless remote control × 1
③	 Battery × 2	④	 Remote control holder × 1
⑤	 Ultra Pure filter × 2	⑥	 Mounting screw × 6
⑦	 Flat head wood screw × 2	⑧	 Owner's Manual × 1
⑨	 Installation Manual × 1	⑩	 Screw × 2

Air filters

Clean every 2 weeks.

1. Open the air inlet grille.
2. Remove the filters if they are on the air filter.
3. Vacuum or wash and then dry them.
4. Reinstall the filters and close the air inlet grille



filter

Maintenance & Shelf-life

Clean every 3-6 months when dust tuck or covers the filter.

1. Recommend to use vacuum to clean by sucking the dusts which stick or dip inside the filter or use the blower to blow the dust go out through the filter.
2. If necessary to use water to clean, simply use the plain water to wash the filter, dry with the sunlight for 3-4 hours or until it completely dry. Nevertheless, use hair drier to dry it. However, washing with water, it may reduce the performance of the filter.
3. Replace every 2 years or sooner. (contact your dealer to purchase new filter) (P/N: RB-A623DA)


Note: Filter life depends on the level of impurities in your operating environment. Higher levels of impurities may require more frequent cleaning and replacement. In all cases, we recommend an additional set of filters to improve the purifying and deodorizing performance of your air conditioner.




Dimension and weight of air conditioners.

Model	Unit size (Width x Length x Height)	Weight
42TVAB016 Series	320 x 1053 x 245 mm	14 kg
38TVAB016-I	550 x 780 x 290 mm	32 kg

INSTALLATION DIAGRAM OF INDOOR AND OUTDOOR UNITS

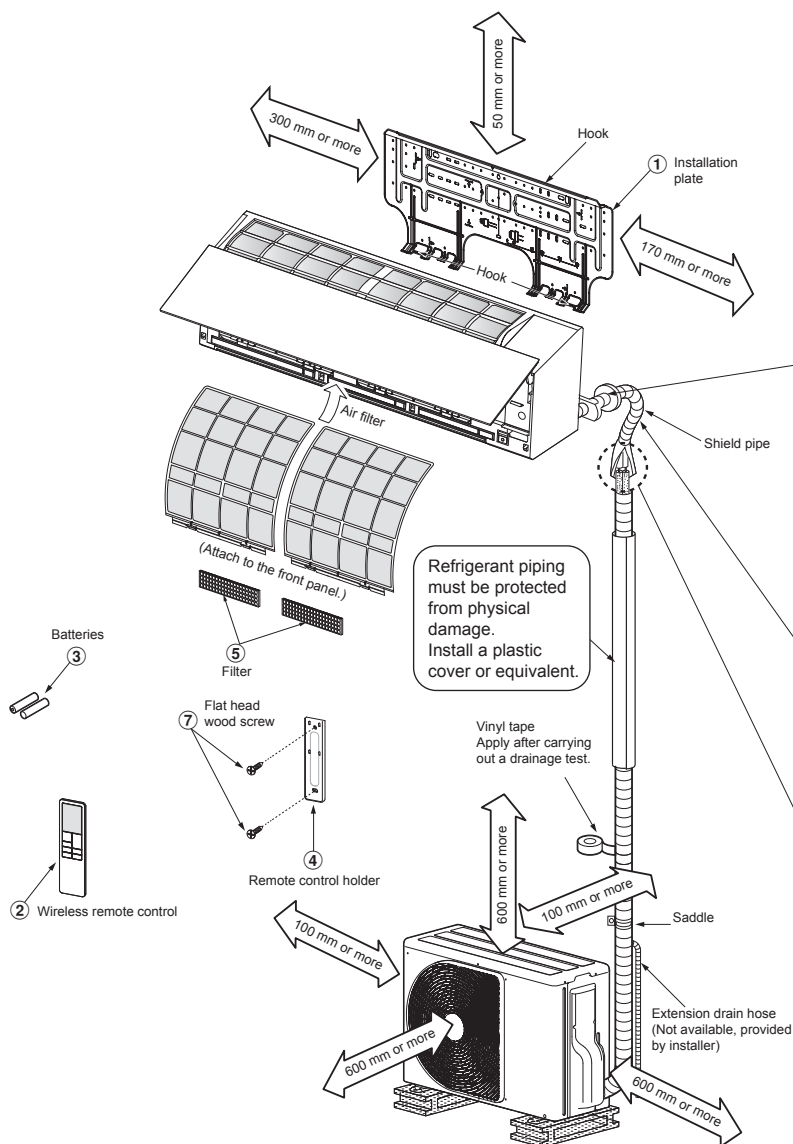


For the rear left, bottom left and left piping

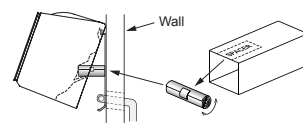


Cut out a piece of SPACER from indoor unit packaging box, roll it and insert between the indoor unit and wall to tilt the indoor unit for better operation.

The auxiliary piping can be connected to the left, rear left, rear right, right, bottom right or bottom left.




Do not allow the drain hose to get slack.



Make sure to run the drain hose sloped downward.

The flare connection should be installed outdoors.

Insulate the refrigerant pipes separately with insulation, not together.




Optional Installation Parts

Part code	Parts name	Q'ty
(A)	Refrigerant piping Liquid side : Ø6.35 mm Gas side : Ø12.70 mm	One each
(B)	Pipe insulating material (polyethylene foam, 8 mm thick)	1
(C)	Putty, PVC tapes	One each

Fixing bolt arrangement of outdoor unit

- Secure the outdoor unit with fixing bolts and nuts if the unit is likely to be exposed to a strong wind.
- Use Ø8 mm or Ø10 mm anchor bolts and nuts.



INDOOR UNIT

Installation Place


- A place which provides the spaces around the indoor unit as shown in the diagram
 - A place where there are no obstacles near the air inlet and outlet
 - A place which allows easy installation of the piping to the outdoor unit
 - A place which allows the front panel to be opened
 - The indoor unit shall be installed at least 2.5 m height.
- Also, it must be avoided to put anything on the top of the indoor unit.

CAUTION

- Direct sunlight to the indoor unit's wireless receiver should be avoided.
 - The microprocessor in the indoor unit should not be too close to RF noise sources.
- (For details, see the owner's manual.)

Remote control


- A place where there are no obstacles such as a curtain that may block the signal from the indoor unit
- Do not install the remote control in a place exposed to direct sunlight or close to a heating source such as a stove.
- Keep the remote control at least 1 m apart from the nearest TV set or stereo equipment. (This is necessary to prevent image disturbances or noise interference.)
- The location of the remote control should be determined as shown below.

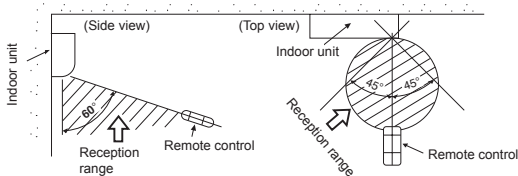

Cutting a Hole and Mounting Installation Plate

Cutting a hole

When installing the refrigerant pipes from the rear

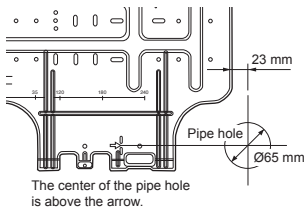


1. After determining the pipe hole position on the mounting plate (➡), drill the pipe hole (Ø65 mm) at a slight downward slant to the outdoor side.

NOTE

- When drilling a wall that contains a metal lath, wire lath or metal plate, be sure to use a pipe hole brim ring sold separately.

Mounting the installation plate

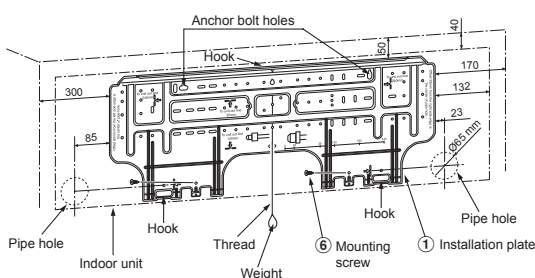

When the installation plate is directly mounted on the wall

1. Securely fit the installation plate onto the wall by screwing it in the upper and lower parts to hook up the indoor unit.
2. To mount the installation plate on a concrete wall with anchor bolts, use the anchor bolt holes as illustrated in the below figure.
3. Install the installation plate horizontally in the wall.


CAUTION

When installing the installation plate with a mounting screw, do not use the anchor bolt holes. Otherwise, the unit may fall down and result in personal injury and property damage.

Installation plate
(Keep horizontal direction.)




5 mm dia. hole



Clip anchor
(local parts)

Mounting screw
Ø4 mm x 25 ℓ



CAUTION

Failure to firmly install the unit may result in personal injury and property damage if the unit falls.

- In case of block, brick, concrete or similar type walls, make 5 mm dia. holes in the wall.
- Insert clip anchors for appropriate mounting screws (6).


NOTE

- Secure four corners and lower parts of the installation plate with 4 to 6 mounting screws to install it.

Piping and Drain Hose Installation

Piping and drain hose forming

- Since dewing results in a machine trouble, make sure to insulate both connecting pipes. (Use polyethylene foam as insulating material.)

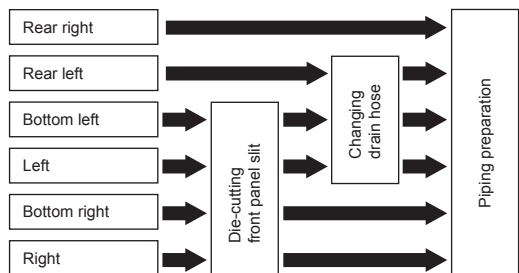

1. Die-cutting front panel slit


Cut out the slit on the left or right side of the front panel for the left or right connection and the slit on the bottom left or right side of the front panel for the bottom left or right connection with a pair of nippers.

2. Changing drain hose

For leftward connection, bottom-leftward connection and rear-leftward connection's piping, it is necessary to change the drain hose and drain cap.


How to remove the drain hose

- The drain hose can be removed by removing the screw securing the drain hose and then pulling out the drain hose.
- When removing the drain hose, be careful of any sharp edges of steel plate. The edges can injure.
- To install the drain hose, insert the drain hose firmly until the connection part contacts with heat insulator, and then secure it with original screw.




How to remove the drain cap

Clip the drain cap by needle-nose pliers and pull out.




How to fix the drain cap

- 1) Insert hexagon wrench (4 mm) in a center head.
- 2) Firmly insert the drain cap.



Do not apply lubricating oil (refrigerant machine oil) when inserting the drain cap. Application causes deterioration and drain leakage of the plug.

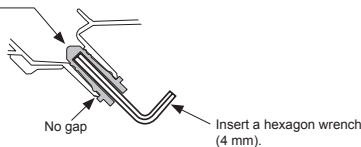


CAUTION

Firmly insert the drain hose and drain cap; otherwise, water may leak.


In case of right or left piping

- After scribing slits of the front panel with a knife or a making-off pin, cut them with a pair of nippers or an equivalent tool.



In case of bottom right or bottom left piping

- After scribing slits of the front panel with a knife or a making-off pin, cut them with a pair of nippers or an equivalent tool.




Left-hand connection with piping

- Bend the connecting pipe so that it is laid within 43 mm above the wall surface. If the connecting pipe is laid exceeding 43 mm above the wall surface, the indoor unit may unstably be set on the wall. When bending the connecting pipe, make sure to use a spring bender so as not to crush the pipe.

Bend the connecting pipe within a radius of 30 mm.

To connect the pipe after installation of the unit (figure)

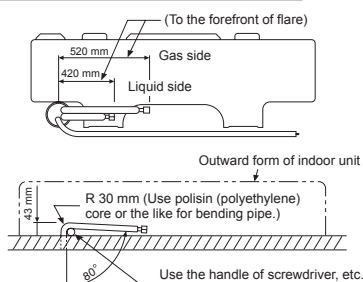


NOTE

If the pipe is bent incorrectly, the indoor unit may unstably be set on the wall. After passing the connecting pipe through the pipe hole, connect the connecting pipes to the auxiliary pipes and wrap the facing tape around them.

CAUTION



- Bind the auxiliary pipes (two) and connecting cable with facing tape tightly. In case of leftward piping and rear-leftward piping, bind the auxiliary pipes (two) only with facing tape.

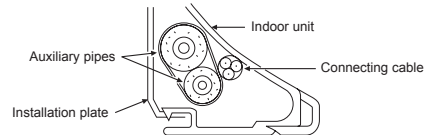


- Carefully arrange pipes so that any pipe does not stick out of the rear plate of the indoor unit.
- Carefully connect the auxiliary pipes and connecting pipes to one another and cut off the insulating tape wound on the connecting pipe to avoid double-taping at the joint; moreover, seal the joint with the vinyl tape, etc.
- Since dewing results in a machine trouble, make sure to insulate both connecting pipes. (Use polyethylene foam as insulating material.)
- When bending a pipe, carefully do it, not to crush it.

Indoor Unit Fixing

1. Pass the pipe through the hole in the wall and hook the indoor unit on the installation plate at the upper hook.
2. Swing the indoor unit to right and left to confirm that it is firmly hooked up on the installation plate.
3. While pressing the indoor unit onto the wall, hook it at the lower part on the installation plate. Pull the indoor unit toward you to confirm that it is firmly hooked up on the installation plate.




- For detaching the indoor unit from the installation plate, pull the indoor unit toward you while pushing its bottom up at the specified parts.

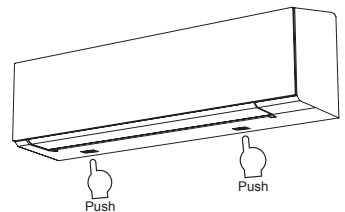

Information

The lower part of indoor unit may float, due to the condition of piping and you cannot fix it to the installation plate. In that case, use the ⑩ screws provided to fix the unit and the installation plate.




Drainage


1. Run the drain hose sloped downwards.

NOTE

- The hole should be made at a slight downward slant on the outdoor side.

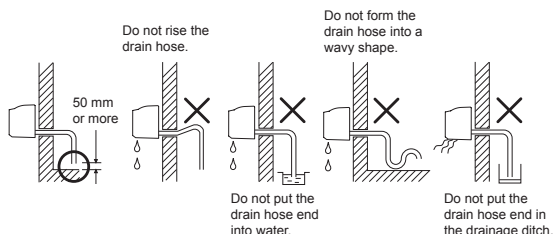


2. Put water in the drain pan and make sure that the water is drained out of doors.
3. When connecting extension drain hose, insulate the connecting part of extension drain hose with shield pipe.



CAUTION

Arrange the drain pipe for proper drainage from the unit. Improper drainage can result in dew-dropping.

This air conditioner has the structure designed to drain water collected from dew, which forms on the back of the indoor unit, to the drain pan. Therefore, do not store the power cord and other parts at a height above the drain guide.



OUTDOOR UNIT

Installation Place

- A place which provides the spaces around the outdoor unit as shown in the diagram
- A place which can bear the weight of the outdoor unit and does not allow an increase in noise level and vibration
- A place where the operation noise and discharged air do not disturb your neighbors
- A place which is not exposed to a strong wind
- A place free of a leakage of combustible gases
- A place which does not block a passage
- When the outdoor unit is to be installed in an elevated position, be sure to secure its feet.
- The allowable length of the connecting pipe.

Model	38TVAB016-I
Chargeless	Up to 15 m
Maximum length	20 m
Additional refrigerant charging	16 - 20 m (20 g / 1 m)
Maximum refrigerant charging	0.97 kg

- The allowable height of outdoor unit installation site.

Model	38TVAB016-I
Maximum height	12 m

- A place where the drain water does not raise any problems or with good drainage.
- A place where it can be installed horizontally.

Precautions for adding refrigerant


Use a scale having a precision with at least 10 g per index line when adding the refrigerant.
Do not use a bathroom scale or similar instrument.

CAUTION

When the outdoor unit is installed in a place where the drain water might cause any problems, Seal the water leakage point tightly using a silicone adhesive or caulking compound.

CAUTION

1. Install the outdoor unit without anything blocking the air discharging.
2. When the outdoor unit is installed in a place always exposed to strong wind like a coast or on a high storey of a building, secure the normal fan operation using a duct or a windshield.
3. In particularly windy areas, install the unit such as to avoid admission of wind.
4. Installation in the following places may result in trouble.
Do not install the unit in such places.
 - A place full of machine oil
 - A saline-place such as the coast
 - A place full of sulfide gas
 - A place where high-frequency waves are likely to be generated as from audio equipment, welders, and medical equipment



Refrigerant Piping Connection

Flaring

1. Cut the pipe with a pipe cutter.




2. Insert a flare nut into the pipe and flare the pipe.

- Projection margin in flaring : A (Unit : mm)

RIGID (clutch type)

Outer dia. of copper pipe	R32 tool used	Conventional tool used
Ø6.35	0 to 0.5	1.0 to 1.5
Ø9.52	0 to 0.5	1.0 to 1.5
Ø12.70	0 to 0.5	1.0 to 1.5
Pipes thickness	0.8 mm or more	



IMPERIAL (wing nut type)


Outer dia. of copper pipe	R32
Ø6.35	1.5 to 2.0
Ø9.52	1.5 to 2.0
Ø12.70	2.0 to 2.5
Pipes thickness	0.8 mm or more

CAUTION

- Do not scratch the inner surface of the flared part when removing burrs.
- Flare processing under the condition of scratches on the inner surface of flare processing part will cause refrigerant gas leak.

Tightening connection

Align the centers of the connecting pipes and tighten the flare nut as far as possible with your fingers. Then tighten the nut with a spanner and torque wrench as shown in the figure.

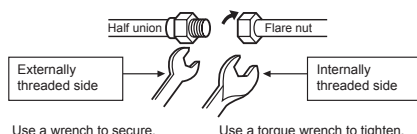

CAUTION


Do not apply excess torque. Otherwise, the nut may crack depending on the conditions.

(Unit : N·m)

Outer dia. of copper pipe	Tightening torque
Ø6.35 mm	16 to 18 (1.6 to 1.8 kgf·m)
Ø9.52 mm	30 to 42 (3.0 to 4.2 kgf·m)
Ø12.70 mm	50 to 62 (5.0 to 6.2 kgf·m)

Tightening torque of flare pipe connections

The operating pressure of R32 is higher than that of R22 (approx. 1.6 times). It is therefore necessary to firmly tighten the flare pipe connecting sections (which connect the indoor and outdoor units) up to the specified tightening torque. Incorrect connections may cause not only a gas leakage, but also damage to the refrigeration cycle.



Evacuating

After the piping has been connected to the indoor unit, you can perform the air purge together at once.


AIR PURGE

Evacuate the air in the connecting pipes and in the indoor unit using a vacuum pump. Do not use the refrigerant in the outdoor unit. For details, see the manual of the vacuum pump.

Using a vacuum pump

Be sure to use a vacuum pump with counter-flow prevention function so that inside oil of the pump does not flow backward into pipes of the air conditioner when the pump stops. (If oil inside of the vacuum pump enters the air conditioner, which use R32, refrigeration cycle trouble may result.)

1. Connect the charge hose from the manifold valve to the service port of the packed valve at gas side.
2. Connect the charge hose to the port of the vacuum pump.
3. Open fully the low pressure side handle of the gauge manifold valve.
4. Operate the vacuum pump to start evacuating. Perform evacuating for about 15 minutes if the piping length is 20 meters. (15 minutes for 20 meters) (assuming a pump capacity of 27 liters per minute) Then confirm that the compound pressure gauge reading is -101 kPa (-76 cmHg).
5. Close the low pressure side valve handle of the gauge manifold valve.
6. Open fully the valve stem of the packed valves (both gas and liquid sides).
7. Remove the charging hose from the service port.
8. Securely tighten the caps on the packed valves.

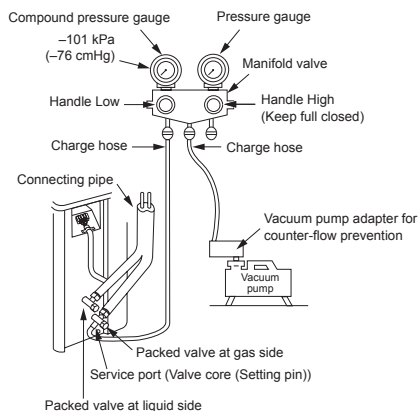

CAUTION

KEEP IMPORTANT 7 POINTS FOR PIPING WORK.

- (1) Take away dust and moisture (inside of the connecting pipes).
- (2) Tighten the connections (between pipes and unit).
- (3) Evacuate the air in the connecting pipes using a VACUUM PUMP.
- (4) Check gas leak (connected points).
- (5) Be sure to fully open the packed valves before operation.
- (6) Reusable mechanical connectors and flared joints are not allowed indoors. When mechanical connectors are reused indoors, sealing parts shall be renewed. When flared joints are reused indoors, the flare part shall be refabricated.
- (7) Don't operate air conditioner in case no refrigerant in the system.

Packed valve handling precautions

- Open the valve stem all the way out, but do not try to open it beyond the stopper.

Pipe size of Packed Valve	Size of Hexagon wrench
12.70 mm and smaller	A = 4 mm
15.88 mm	A = 5 mm

Pump down process


1. Turn off the Air Conditioner system.
2. Connect the charge hose from the manifold valve to the service port of the packed valve at gas side.
3. Turn on the Air Conditioner system in cooling operation more than 10 minutes.
4. Check the operating pressure of the system should be normal value. (Ref. with product specification)
5. Release the valve rod cap of both service valves.
6. Use the Hexagon wrench to turning the valve rod of Liquid side fully close. (*Make sure no entering air into the system)
7. Continue operate Air Conditioner system until and the gauge of manifold dropped into the range of $0.5 - 0$ kgf/cm²
8. Use the Hexagon wrench to turning the valve rod of Gas side fully close. And turn off the Air Conditioner system immediately thereafter.
9. Remove the gauge manifold from the service port of the packed valve.
10. Securely tighten the valve rod cap to the both service valves.

CAUTION

Should be check the compressor operating condition while pumping down process. It must not any abnormal sound, more vibration. It is abnormal condition appears and must turn off the Air Conditioner immediately.

- Securely tighten the valve cap with torque in the following table:

Cap	Cap Size (H)	Torque
Valve Rod Cap	H17 - H19	14~18 N·m (1.4 to 1.8 kgf·m)
	H22 - H30	33~42 N·m (3.3 to 4.2 kgf·m)
Service Port Cap	H14	8~12 N·m (0.8 to 1.2 kgf·m)
	H17	14~18 N·m (1.4 to 1.8 kgf·m)

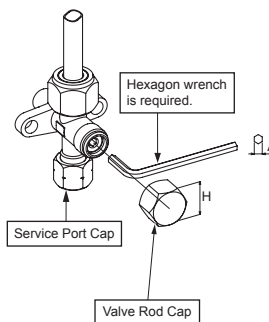

ELECTRICAL WORKS

Model	42TVAB016 Series
Power source	50Hz, 220V Single phase
Maximum running current	7.50A
Circuit breaker rating	15A
Power supply cable	H07RN-F or 60245 IEC66 (1.25 mm ² or more)
Connecting cable	H07RN-F or 60245 IEC66 (0.75 mm ² or more)


EN

Wiring Connection

Indoor unit


Wiring of the connecting cable can be carried out without removing the front panel.

1. Remove the air inlet grille.
Open the air inlet grille upward and pull it toward you.
2. Remove the terminal cover and cord clamp.
3. Insert the connecting cable (according to the local cords) into the pipe hole on the wall.
4. Take out the connecting cable through the cable slot on the rear panel so that it protrudes about 20 cm from the front.
5. Insert the connecting cable fully into the terminal block and secure it tightly with screws.
6. Tightening torque : 1.2 N·m (0.12 kgf·m)
7. Secure the connecting cable with the cord clamp.
8. Fix the terminal cover, rear plate bushing and air inlet grille on the indoor unit.

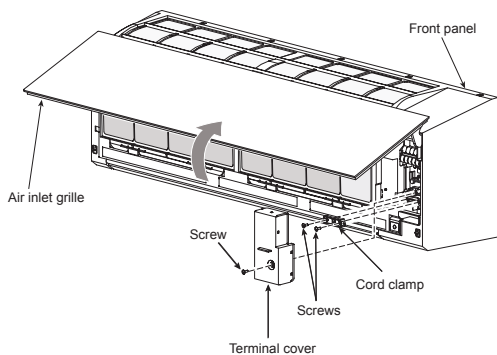


Outdoor unit

1. Remove the valve cover, the electric parts cover and the cord clamp from the outdoor unit.
2. Connect the connecting cable to the terminal as identified by the matching numbers on the terminal block of indoor and outdoor unit.
3. Insert the power cord and the connecting cable carefully into the terminal block and secure it tightly with screws.
4. Use vinyl tape, etc. to insulate the cords which are not going to be used. Locate them so that they do not touch any electrical or metal parts.
5. Secure the power cord and the connecting cable with the cord clamp.
6. Attach the electric parts cover and the valve cover on the outdoor unit.

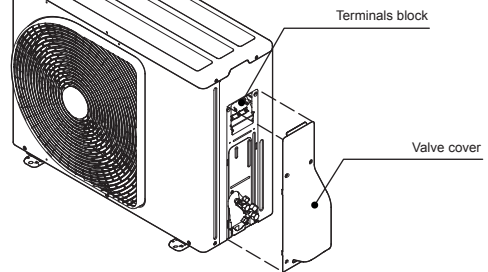


How to install the air inlet grille on the indoor unit

- When attaching the air inlet grille, the contrary of the removed operation is performed.

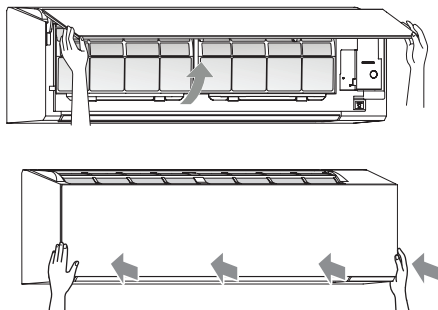

Power Supply and Connecting Cable Connection

Power Supply Input at Outdoor Unit Terminal Block

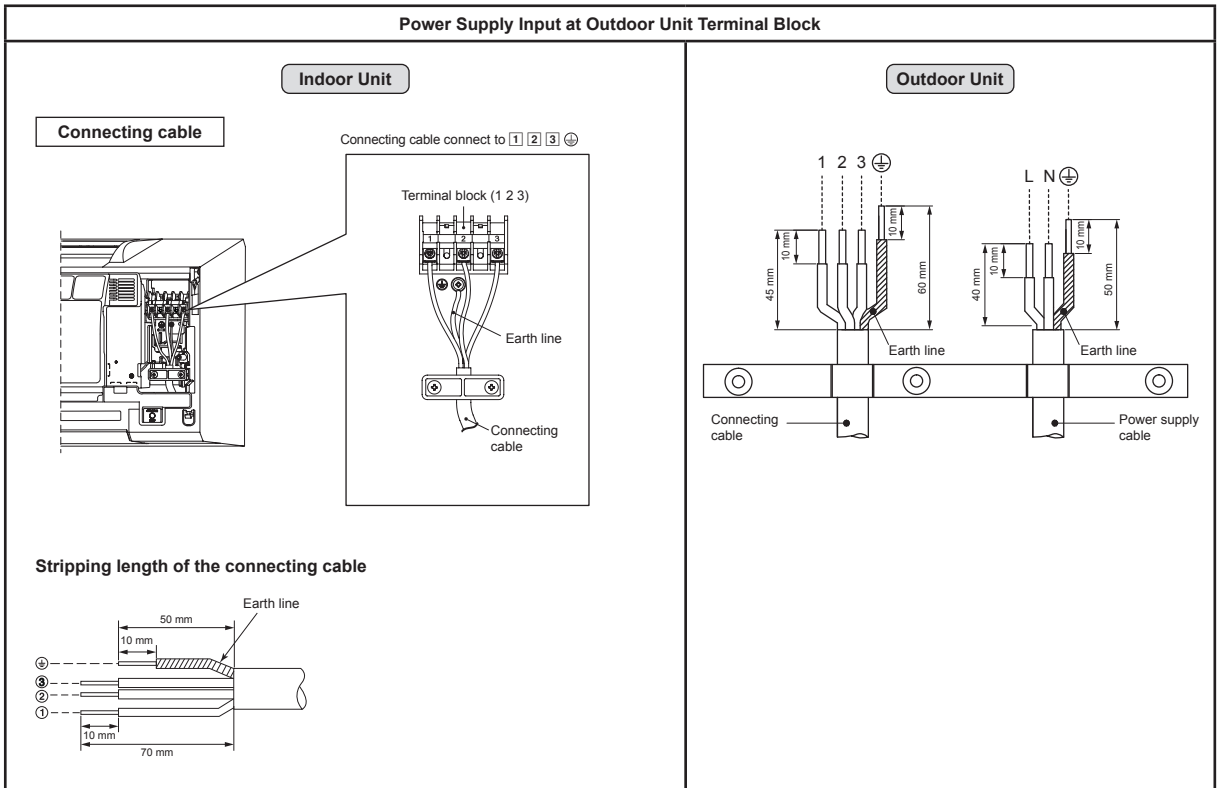


CAUTION

1. The power supply must be same as the rated of air conditioner.
 2. Prepare the power source for exclusive use with air conditioner.
 3. Circuit breaker must be used for the power supply line of this air conditioner.
 4. Be sure to comply power supply and connecting cable for size and wiring method.
 5. Every wire must be connected firmly.
 6. Perform wiring works so as to allow a general wiring capacity.
 7. Wrong wiring connection may cause some electrical part burn out.
 8. Incorrect or incomplete wiring is carried out, it will cause an ignition or smoke.
 9. This product can be connected to main power supply.
- Connection to fixed wiring : A switch which disconnects all poles and has a contact separation at least 3 mm must be incorporated in the fixed wiring.

OTHERS

Gas Leak Test

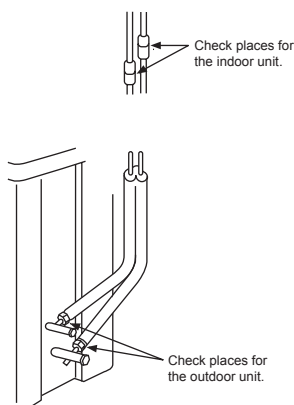

- Check the flare nut connections for the gas leak with a gas leak detector or soap water.


Remote Control A-B Selection

- When two indoor units are installed in the same room or adjacent two rooms, if operating a unit, two units may receive the remote control signal simultaneously and operate. In this case, the operation can be preserved by setting either one remote control to B setting. (Both are set to A setting in factory shipment.)
- The remote control signal is not received when the settings of indoor unit and remote control are different.
- There is no relation between A setting/B setting and A room/B room when connecting the piping and cables.


To separate using of remote control for each indoor unit in case 2 air conditioner are installed near.

Remote Control B Setup.

1. Press [RESET] button on the indoor unit to turn the air conditioner ON.
2. Point the remote control at the indoor unit.
3. Push and hold [CHECK] button on back side of Remote Control. "00" will be shown on the display (Picture ①).

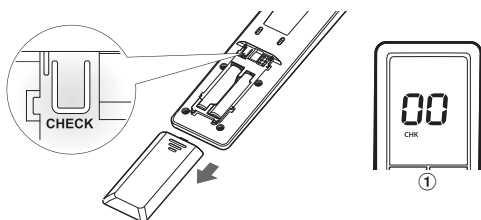


4. Press [MODE] during pushing [CHECK]. "B" will show on the display and "00" will disappear and the air conditioner will turn OFF. The Remote Control B is memorized (Picture ②).



- Note :
1. Repeat above step to reset Remote Control to be A.
 2. Remote Control A have no "A" display.
 3. Default setting of Remote Control from factory is A.

Test Operation

To switch the TEST RUN (COOL) mode, press [RESET] button for 10 seconds. (The beeper will make a short beep.)

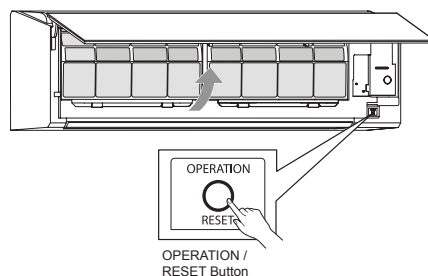

Auto Restart Function Setting

This product is designed so that, after a power failure, it can restart automatically in the same operating mode as before the power failure.

Information

The product is shipped with Auto Restart function in the ON position. Turn it OFF if this function is not required.

How to turn OFF the Auto Restart Function

- Press and hold the [OPERATION] button on the indoor unit for 3 seconds (3 beep sounds but OPERATION lamp does not blink).

How to turn ON the Auto Restart Function

- Press and hold the [OPERATION] button on the indoor unit for 3 seconds (3 beep sounds and OPERATION lamp blink 5 time/sec for 5 seconds).

NOTE

- In case of ON timer or OFF timer are set, AUTO RESTART OPERATION does not activate.

APPENDIX

Work instructions

The existing R22 and R410A piping can be reused for inverter R32 product installations.

WARNING

Confirming the existence of scratches or dents on the existing pipes and confirming the reliability of the pipe strength are conventionally referred to the local site.

If the specified conditions can be cleared, it is possible to update existing R22 and R410A pipes to those for R32 models.

Basic conditions needed to reuse existing pipes

Check and observe the presence of three conditions in the refrigerant piping works.

1. **Dry** (There is no moisture inside of the pipes.)
2. **Clean** (There is no dust inside of the pipes.)
3. **Tight** (There are no refrigerant leaks.)

Restrictions for use of existing pipes

In the following cases, the existing pipes should not be reused as they are. Clean the existing pipes or exchange them with new pipes.

1. When a scratch or dent is heavy, be sure to use new pipes for the refrigerant piping works.
2. When the existing pipe thickness is thinner than the specified "Pipe diameter and thickness," be sure to use new pipes for the refrigerant piping works.
- The operating pressure of R32 is high (1.6 times that of R22). If there is a scratch or dent on the pipe or a thinner pipe is used, the pressure strength may be inadequate, which may cause the pipe to break in the worst case.

* Pipe diameter and thickness (mm)

Pipe outer diameter	Ø6.4	Ø9.5	Ø12.7	
Thickness	R32, R410A	0.8	0.8	0.8
	R22			

3. When the outdoor unit was left with the pipes disconnected, or the gas leaked from the pipes and the pipes were not repaired and refilled.

• There is the possibility of rain water or air, including moisture, entering the pipe.

4. When refrigerant cannot be recovered using a refrigerant recovery unit.

• There is the possibility that a large quantity of dirty oil or moisture remains inside the pipes.

5. When a commercially available dryer is attached to the existing pipes.

• There is the possibility that copper green rust has been generated.

6. When the existing air conditioner is removed after refrigerant has been recovered.

Check if the oil is judged to be clearly different from normal oil.

• The refrigerant oil is copper rust green in color.

There is the possibility that moisture has mixed with the oil and rust has been generated inside the pipe.

• There is discolored oil, a large quantity of residue, or a bad smell.

• A large quantity of shiny metal dust or other wear residue can be seen in the refrigerant oil.

7. When the air conditioner has a history of the compressor failing and being replaced.

• When discolored oil, a large quantity of residue, shiny metal dust, or other wear residue or mixture of foreign matter is observed, trouble will occur.

8. When temporary installation and removal of the air conditioner are repeated such as when leased etc.

9. If the type of refrigerant oil of the existing air conditioner is other than the following oil (Mineral oil), Suniso, Freol-S, MS (Synthetic oil), alkyl benzene (HAB, Barrel-freeze), ester series, PVE only of ether series.

• The winding-insulation of the compressor may deteriorate.

NOTE


The above descriptions are results have been confirmed by our company and represent our views on our air conditioners, but do not guarantee the use of the existing pipes of air conditioners that have adopted R32 in other companies.

Curing of pipes

When removing and opening the indoor or outdoor unit for a long time, cure the pipes as follows:

- Otherwise rust may be generated when moisture or foreign matter due to condensation enters the pipes.
- The rust cannot be removed by cleaning, and new pipes are necessary.

Placement location	Term	Curing manner
Outdoors	1 month or more	Pinching
Indoors	Less than 1 month	Pinching or taping
	Every time	

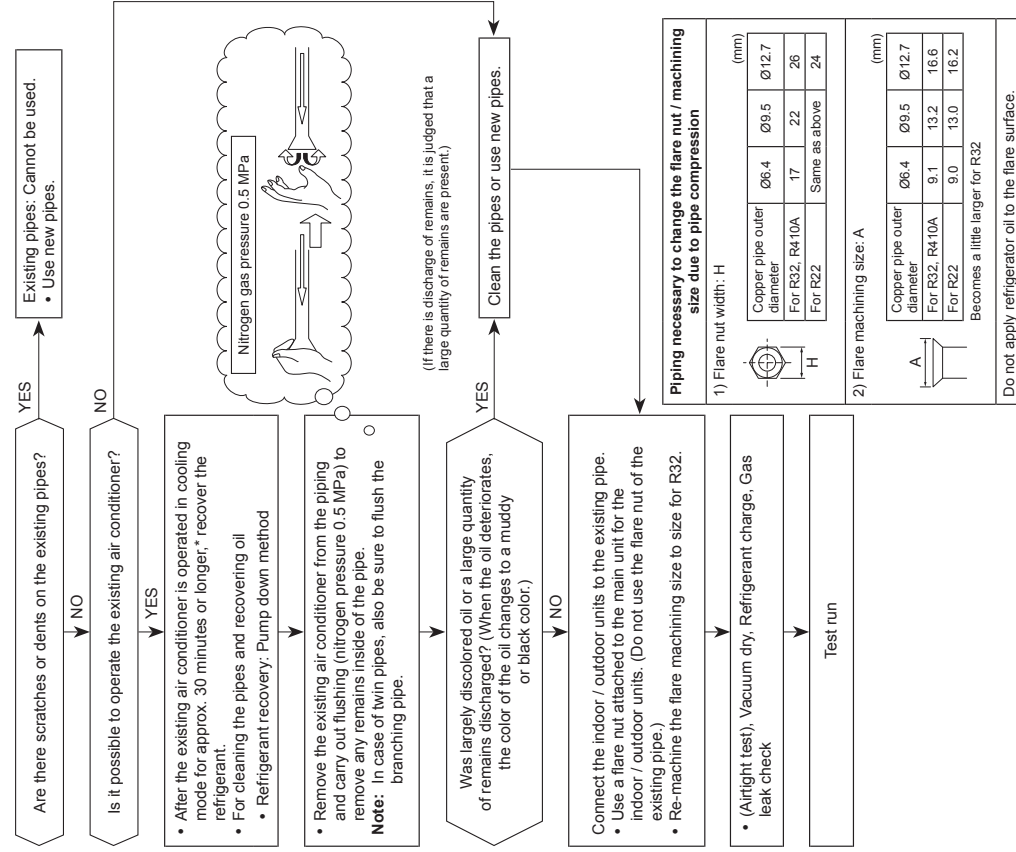

ข้อควรระวังเพื่อความปลอดภัย

	อ่านข้อควรระวังในคู่มือนี้อย่างละเอียด ก่อนใช้งาน		อุปกรณ์นี้เติมด้วยสารทำความเย็น R32
---	--	---	--

■ สัญลักษณ์คำเตือนของตัวเครื่องปรับอากาศ

สัญลักษณ์คำเตือน	คำอธิบาย
 CAUTION BURST HAZARD Open the service valves before the operation, otherwise there might be the burst.	ข้อควรระวัง อันตรายจากการระเบิด ให้เปิดวาล์วบริการก่อนเปิดใช้งานเครื่อง มิฉะนั้น อาจเกิดการระเบิดขึ้นได้

- ก่อนการติดตั้ง โปรดอ่านข้อควรระวังเพื่อความปลอดภัยอย่างระมัดระวัง
 - ควรทำตามข้อควรระวังที่เขียนไว้ ณ ที่นี้เพื่อหลีกเลี่ยงอันตรายที่อาจเกิดขึ้น
- ต่อไปนี้เป็นสัญลักษณ์และความหมาย

คำเตือน : สัญลักษณ์นี้แสดงว่าการใช้งานที่ผิดอาจก่อให้เกิดการบาดเจ็บสาหัสหรือถึงแก่ชีวิต

ข้อควรระวัง : สัญลักษณ์นี้แสดงว่าการใช้งานที่ผิดอาจก่อให้เกิดการบาดเจ็บส่วนบุคคล (*1) หรือความเสียหายแก่ทรัพย์สิน (*2)

*1: การบาดเจ็บส่วนบุคคล หมายถึง อุบัติเหตุเล็กน้อย การลุกไหม้หรือ ไฟดูด ซึ่งไม่จำเป็นต้องเข้ารับการรักษาตัวในโรงพยาบาล

*2: ความเสียหายแก่ทรัพย์สิน หมายถึง ความเสียหายที่รุนแรงกว่า ซึ่งส่งผลต่อทรัพย์สินหรือทรัพย์สิน

สำหรับการใช้งานทั่วไป

สายจ่ายไฟและสายเชื่อมต่อของตัวเครื่องภายนอก อย่างน้อยจะต้องเป็นสายชนิดอ่อนหุ้มด้วยโพลีคลอโรพรีน (แบบ H07RN-F) หรือสายไฟที่ตรงตามข้อกำหนด 60245 IEC66 (ควรติดตั้งตามข้อกำหนดการเดินสายไฟ)

ข้อควรระวัง การปลดสายเครื่องจากตัวจ่ายไฟฟ้าหลัก

เครื่องนี้ต้องได้รับการต่อเข้ากับตัวจ่ายไฟหลักด้วย เบรกเกอร์วงจรไฟฟ้า หรือสวิตช์ที่มีการแยกตัวสัมผัสอย่างน้อย 3 มม. ในทุกชั่ว

อันตราย

- ใช้โดยผู้ชำนาญงานเท่านั้น
- ปิดตัวจ่ายไฟหลักก่อนการปฏิบัติงานที่เกี่ยวข้องกับไฟฟ้า ให้แน่ใจว่าได้ปิดสวิตช์ไฟทั้งหมดแล้ว
การละลายอาจทำให้เกิดไฟฟ้าช็อต
- ต่อสายไฟอย่างถูกต้อง ถ้าต่อสายผิดพลาด อาจทำให้อุปกรณ์ไฟฟ้าเกิดการเสียหายได้
- ตรวจสอบสายดินอย่าให้ขาดหรือหลุด ก่อนการติดตั้ง
- อย่าติดตั้งใกล้กับแหล่งก๊าซไวไฟหรือไอก๊าซ
การละลายไม่ปฏิบัติตามคำแนะนำอาจเป็นผลให้เกิดเพลิงไหม้หรือระเบิด
- เพื่อเป็นการป้องกันตัวเครื่องภายในไม่ให้ร้อนเกินและไม่ทำให้เกิดอันตรายจากเพลิงไหม้ วางเครื่องให้ห่าง
(มากกว่า 2 เมตร) จากแหล่งความร้อน เช่น เครื่องกระจายความร้อน เครื่องทำความร้อน เตาลอบม เต่าไฟ
 เป็นต้น
- ในการเคลื่อนย้ายเครื่องปรับอากาศไปติดตั้งในที่อื่นๆ ควรระมัดระวังในการอัดสารทำความเย็น (R32) ถ้า
อากาศหรือก๊าซใดๆ ผสมเข้าไปในสารทำความเย็น แรงดันก๊าซภายในวงจรสารทำความเย็น อาจสูงขึ้นแบบ
ผิดปกติ และอาจเป็นสาเหตุของการระเบิดของท่อและเกิดอันตรายได้
- ในกรณีที่สารทำความเย็นรั่วออกจากท่อในระหว่างทำการติดตั้ง ให้รีบเปิดรับอากาศเข้ามาในห้อง ถ้าสาร
ทำความเย็นถูกทำให้ร้อนด้วยไฟหรืออื่นๆ จะทำให้เกิดก๊าซพิษ

คำเตือน

- อย่าแก้ไขดัดแปลงเครื่องโดยการถอดตัวป้องกัน หรือลัดวงจรสวิตช์ภายในเพื่อความปลอดภัย
- ไม่ควรติดตั้งในสถานที่ที่ไม่สามารถรองรับน้ำหนักของตัวเครื่องได้
เพราะถ้าเครื่องหล่นลงมา จะทำให้เกิดอันตรายและสิ่งของเสียหายได้
- ก่อนทำงานเกี่ยวกับไฟฟ้า ควรตัดปลั๊กที่ได้มาตรฐานเข้ากับสายจ่ายไฟ
และต่อสายดินให้กับอุปกรณ์
- เครื่องต้องได้รับการติดตั้งตามข้อกำหนดการเดินสายไฟ
ถ้าตรวจพบความเสียหาย อย่าติดตั้งเครื่อง ให้ติดต่อตัวแทนจำหน่ายทันที
- ห้ามใช้สารทำความเย็นใดๆ ที่แตกต่างไปจากที่ระบุไว้ให้สำหรับการเติมหรือการเปลี่ยน
มีฉะนั้นอาจมีแรงดันสูงผิดปกติแพร่กระจาย เข้าสู่วงจรการทำงาน ซึ่งทำให้ผลิตภัณฑ์นี้ทำงานผิดปกติ
หรือเกิดการระเบิดหรืออาจทำให้ท่านได้รับบาดเจ็บได้
- อย่าใช้วิธีการเร่งกระบวนการละลายน้ำแข็งหรือทำความสะอาด นอกเหนือจากวิธีการที่ผู้ผลิตได้แนะนำ
- ควรวางเครื่องไว้ในห้องที่ปราศจากแหล่งจุดติดไฟที่ทำงานตลอดเวลา (เช่น เบลวไฟที่ไม่มีสิ่งปิดกั้น เครื่องใช้
ไฟฟ้าที่ใช้ก๊าซที่กำลังทำงานอยู่ หรือ เครื่องทำความร้อนที่ใช้ไฟฟ้าที่กำลังทำงานอยู่)
- ควรใช้ความระมัดระวังเนื่องจากสารทำความเย็นอาจไม่มีกลิ่น

- อย่าเจาะหรือเผาเนื่องจากเครื่องถูกอัดความดันไว้ อย่าให้เครื่องโดนความร้อน เปลวไฟ ประกายไฟ หรือ แหล่งกำเนิดหรือแหล่งติดไฟอื่นๆ มิฉะนั้นแล้ว เครื่องอาจจะเปิดจนทำให้เกิดการบาดเจ็บหรือเสียชีวิตได้
- สำหรับรุ่น R32 ให้ใช้ท่อแฟลร์นัทและเครื่องมือที่กำหนดไว้ให้ใช้กับ R32 การใช้ระบบท่อ (R22) แฟลร์นัท และเครื่องมือที่มีอยู่แล้ว อาจทำให้เกิดความดันสูงผิดปกติในวงจร สารทำความเย็น (ระบบท่อ) และอาจทำให้เกิดการระเบิดและบาดเจ็บได้
- ความหนาของท่อทองแดงที่ใช้ R32 จะต้องมากกว่า 0.8 มม. ห้ามใช้ท่อทองแดงที่หนาน้อยกว่า 0.8 มม. โดยเด็ดขาด
- อย่าทำการต่อท่อแบบปลายบานภายในอาคาร ที่พักอาศัย หรือห้องพัก เมื่อต่อเครื่องแลกเปลี่ยนความร้อนของเครื่องภายในเข้ากับท่อเชื่อมต่อ การเชื่อมต่อสารทำความเย็นภายในอาคารที่พักอาศัยหรือห้องพัก จะต้องกระทำโดยการบัดกรีแข็งหรือการเชื่อมโลหะ การเชื่อมต่อของเครื่องภายในด้วยวิธีการบานท่อสามารถกระทำได้เฉพาะกลางแจ้ง หรือด้านนอกของอาคารที่พักอาศัยหรือห้องพักเท่านั้น การต่อท่อแบบปลายบาน อาจเป็นสาเหตุให้ก๊าซรั่วและทำให้บรรยากาศโดยรอบอยู่ในสภาพไวไฟได้
- หลังจากเสร็จสิ้นการติดตั้ง หรือการบำรุงรักษาแล้ว ควรตรวจยืนยันว่าไม่มีการรั่วของก๊าซสารทำความเย็นเกิดขึ้น หากสารทำความเย็นติดไฟ อาจทำให้เกิดก๊าซพิษได้
- สอดคล้องกับระเบียบแห่งชาติว่าด้วยเรื่องก๊าซ

คำเตือน

- **หลังการติดตั้ง โปรดตรวจสอบตามรายละเอียดด้านล่างก่อนการเปิดใช้งาน**

- ห้ามมีการเชื่อมต่ออย่างถูกต้องและไม่มีการรั่วไหล
- วาล์วเปิดอยู่เต็มที่

การทำงานของคอมเพรสเซอร์ที่วาล์วเปิดอยู่ อาจทำให้เกิดแรงดันสูงผิดปกติและทำให้ชิ้นส่วนเสียหายได้ การรั่วไหลที่ท่อต่อ อาจดูดอากาศเข้าไป และทำให้แรงดันสูงขึ้นจนทำให้เกิดการระเบิดและการบาดเจ็บได้

- **ระหว่างที่มีการทำปั๊มคาวนเพื่อเก็บสารทำความเย็น ดำเนินการตรวจสอบให้แน่ใจว่า ได้ดำเนินการตามขั้นตอนด้านล่างต่อไปนี้**

- ห้ามผสมอากาศเข้าไปในวงจรสารทำความเย็น
- หยุดคอมเพรสเซอร์ก่อนถอดท่อ หลังจากปิดวาล์วอัดจนสุดแล้ว

การถอดท่อในระหว่างที่คอมเพรสเซอร์กำลังทำงานและวาล์วที่บรรจุเปิดอยู่ อาจทำให้อากาศถูกดูดเข้าไป และแรงดันวงจรการทำความเย็นจะสูงผิดปกติ และทำให้เกิดการระเบิด หรือการบาดเจ็บขึ้นได้

ข้อควรระวัง

- ถ้าเครื่องถูกน้ำหรือความชื้นก่อนการติดตั้ง อาจทำให้เกิดไฟฟ้าลัดวงจรได้ อย่าเก็บเครื่องไว้ในห้องใต้ดินที่ชื้น หรือให้เครื่องถูกฝนหรือน้ำ
- หลังนำเครื่องออกจากบรรจุภัณฑ์ ตรวจสอบความเสียหายที่อาจเกิดขึ้นอย่างละเอียด
- อย่าติดตั้งเครื่องในสถานที่ซึ่งอาจมีการรั่วไหลของก๊าซไวไฟเกิดขึ้น ในกรณีที่ก๊าซรั่วและสะสมอยู่โดยรอบตัวเครื่อง อาจทำให้เกิดไฟไหม้ได้
- อย่าติดตั้งในสถานที่ซึ่งจะเพิ่มความชื้นให้กับเครื่อง อย่าติดตั้งในสถานที่ซึ่งสามารถขยายระดับเสียงของเครื่อง ที่ซึ่งเสียงและลมที่เป่าออกมาอาจรบกวนเพื่อนบ้าน
- เพื่อหลีกเลี่ยงการได้รับบาดเจ็บ ระวังเมื่อจับถือส่วนที่มีขอบคม
- กรุณาอ่านคู่มือการติดตั้งนี้อย่างละเอียดก่อนติดตั้งเครื่อง ในคู่มือประกอบด้วยคำแนะนำสำคัญเพื่อการติดตั้งอย่างถูกต้อง
- ผู้ผลิตจะไม่รับประกันความเสียหายใดๆ อันเกิดจากการละเลยต่อคำแนะนำในคู่มือเล่มนี้

ข้อกำหนดในการแจ้งการไฟฟ้าส่วนท้องถิ่น

โปรดตรวจสอบให้แน่ใจว่าได้แจ้งการไฟฟ้าส่วนท้องถิ่นให้ทราบถึงการติดตั้งเครื่องนี้ก่อนดำเนินการแล้ว หากประสบปัญหาใดๆ หรือหากการไฟฟ้าไม่อนุญาตให้ทำการติดตั้ง หน่วยงานผู้ให้บริการควรหามาตรการรับมือที่เหมาะสม

- **ข้อมูลสำคัญเกี่ยวกับสารทำความเย็นที่ใช้แล้ว**

เครื่องปรับอากาศนี้บรรจุก๊าซเรือนกระจกกลุ่มฟลูโอรีเนต

อย่าระบายก๊าซเข้าสู่บรรยากาศ

ประเภทของสารทำความเย็น: **R32**


ค่า GWP⁽¹⁾: **675** * (ตัวอย่าง R32 ref. AR4)

⁽¹⁾GWP = ค่าศักยภาพในการทำให้เกิดภาวะโลกร้อน

ปริมาณสารทำความเย็นจะระบุไว้ที่ป้ายข้อมูลของผลิตภัณฑ์

* ค่านี้จะอ้างอิงตามระเบียบว่าด้วยก๊าซกลุ่มฟลูโอรีเนต (F gas regulation) 517/2014

ชิ้นส่วนอุปกรณ์เสริม

ตัวเครื่องภายใน			
หมายเลข	ชื่อชิ้นส่วน	หมายเลข	ชื่อชิ้นส่วน
①	 แผ่นติดตั้ง × 1	②	 รีโมทคอนโทรลไร้สาย × 1
③	 แบตเตอรี่ × 2	④	 โครงเสียบรีโมทคอนโทรล × 1
⑤	 แผ่นกรอง Ultra pure × 2	⑥	 สกรูยึด × 6
⑦	 สกรูหัวแบน × 2	⑧	 คู่มือการใช้งาน × 1
⑨	 คู่มือการติดตั้ง × 1	⑩	 สกรู × 2

แผ่นกรองอากาศ

ทำความสะอาดแผ่นกรองทุกๆ 2 สัปดาห์

1. เปิดหน้ากากด้านหน้า (ช่องลมเข้า)
2. ถอดแผ่นกรองอากาศออก ถ้าแผ่นกรองติดอยู่บนแผ่นกรองอากาศ
3. ดูดฝุ่นหรือล้างแผ่นกรองด้วยน้ำ แล้วปล่อยให้แห้ง
4. ประกอบแผ่นกรองเข้าที่และเปิดหน้ากากด้านหน้า


แผ่นกรอง

การบำรุงรักษาและอายุการใช้งาน

ทำความสะอาดแผ่นกรองทุกๆ 3 ถึง 6 เดือน หรือเมื่อมีฝุ่นเกาะที่แผ่นกรอง

1. แนะนำให้ใช้เครื่องดูดฝุ่น ดูดทำความสะอาดฝุ่นที่ติดฝังอยู่ในแผ่นกรอง หรือใช้เครื่องเป่าลมเป่าฝุ่นให้หลุดออกจากแผ่นกรอง
2. หากต้องใช้น้ำทำความสะอาด ให้ล้างแผ่นกรองด้วยน้ำเปล่า ตากแดดให้แห้งเป็นเวลา 3-4 ชั่วโมงหรือจนกว่าจะแห้งสนิท หรือใช้เครื่องเป่าลมเป่าให้แห้ง อย่างไรก็ตามการล้างด้วยน้ำอาจลดประสิทธิภาพการทำงานของแผ่นกรองได้
3. เปลี่ยนใหม่ทุก 2 ปี หรือเร็วกว่านั้น (ติดต่อตัวแทนจำหน่ายสำหรับแผ่นกรองใหม่) (P/N : RB-A623DA)


หมายเหตุ: อายุการใช้งานของแผ่นกรองขึ้นอยู่กับระดับของฝุ่นที่อยู่ในสภาวะแวดล้อมนั้น หากระดับของฝุ่นมีมาก อาจจะต้องทำความสะอาดและเปลี่ยนแผ่นกรองบ่อย เราขอแนะนำให้คุณติดตั้งแผ่นกรองอากาศ เพื่อเพิ่มประสิทธิภาพของเครื่องปรับอากาศ ในการกรองอากาศบริสุทธิ์และดับกลิ่นมากยิ่งขึ้น

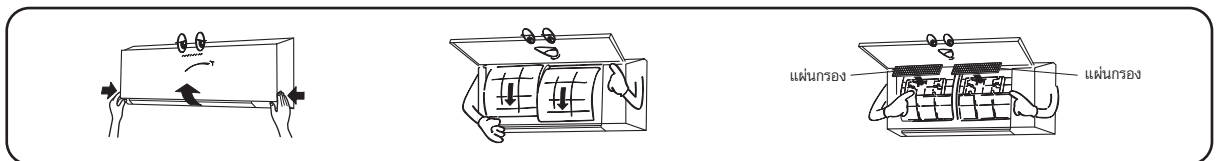


ขนาดและน้ำหนักของเครื่องปรับอากาศ

รุ่น	ขนาดของเครื่อง (กว้าง x ยาว x สูง)	น้ำหนัก
42TVAB016 Series	320 x 1053 x 245 มม.	14 กก.
38TVAB016-I	550 x 780 x 290 มม.	32 กก.

ผังการติดตั้งตัวเครื่องภายในและภายนอก

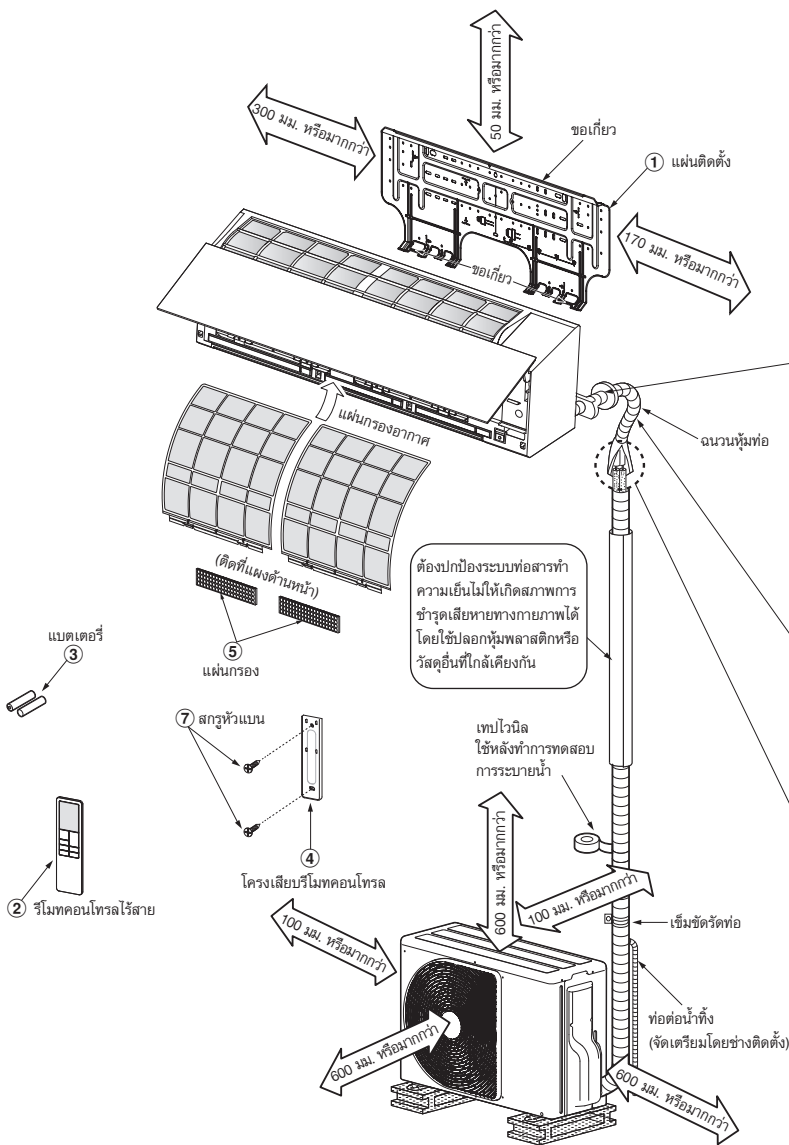


(การต่อท่อด้านหลังซ้าย ด้านล่างซ้าย และด้านซ้าย)

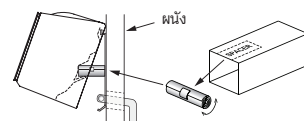

ติดตั้งส่วน SPACER จากกล่องบรรจุภัณฑ์
ของตัวเครื่องภายใน ม้วนแล้วใส่ไว้ระหว่างตัว
เครื่องภายในและผนังเพื่อหนุนตัวเครื่องภายใน
ให้ทำงานได้ดียิ่งขึ้น

การต่อท่อเสริมสามารถต่อออกด้านซ้าย, ด้านหลังซ้าย, ด้านหลังขวา, ด้านขวา, ด้านล่างขวาหรือด้านล่างซ้าย

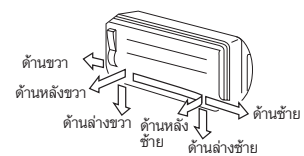


ไม่ควรให้ท่อน้ำทิ้งเกิดการหย่อน



ตรวจดูให้แน่ใจว่าท่อน้ำทิ้ง อยู่ในตำแหน่ง
ลาดเอียงลง

การต่อท่อแบบปลายบานควรติดตั้ง
ภายนอกอาคาร

ห้ามฉนวนท่อสารทำความเย็นแยกกัน
ไม่ควรห้ามฉนวนรวม




โฟมโพลีเอธีลีนฉนวนความร้อน
หนา 8 มม.

ชั้นส่วนในการติดตั้ง

รหัสชิ้นส่วน	ชื่อชิ้นส่วน	จำนวน
Ⓐ	ท่อส่งสารทำความเย็น ด้านของเหลว : Ø6.35 มม. ด้านก๊าซ : Ø12.70 มม.	อย่างละชิ้น
Ⓑ	วัสดุที่ใช้เป็นฉนวนท่อ (โฟมโพลีเอทิลีนหนา 8 มม.)	1
Ⓒ	ปูนอุดและเทปไวน์ด	อย่างละชิ้น

การจัดวางสลักเกลียวยึดของตัวเครื่องภายนอก

- ยึดตัวเครื่องภายนอกให้แน่นด้วยสลักเกลียวสมอและแป้นเกลียว ถ้าเครื่องถูกลมกรรโชก
- ใช้สลักเกลียวสมอและแป้นเกลียวขนาด Ø8 มม. หรือ Ø10 มม.



ตัวเครื่องภายใน

สถานที่ติดตั้ง


- สถานที่ซึ่งมีพื้นที่โดยรอบเครื่องตามที่แสดงไว้ในผังการติดตั้ง
- สถานที่ซึ่งไม่มีสิ่งกีดขวางใกล้ขั้วรับและระบายอากาศ
- สถานที่ซึ่งติดตั้งต้องส่งไปยังตัวเครื่องภายนอกได้ง่าย
- สถานที่ซึ่งสามารถเปิดหน้าต่างเครื่องออกได้
- ควรติดตั้งเครื่องภายในโดยให้ความสูงอย่างน้อย 2.5 เมตร และต้องหลีกเลี่ยงการวางสิ่งของใดๆ ไว้บนตัวเครื่องภายในด้วย

ข้อควรระวัง

- เพื่อให้ตัวรับสัญญาณไร้สายของตัวเครื่องภายในถูกแสงแดดโดยตรง
- ส่วนไมโครโปรเซสเซอร์ในตัวเครื่องภายในไม่ควรอยู่ใกล้กับแหล่งที่มีคลื่นวิทยุ RF รบกวน
(รายละเอียดดูในคู่มือการใช้งาน)

รีโมทคอนโทรล


- ไม่ควรฝืนถึงขีดความสามารถส่งสัญญาณจากรีโมทคอนโทรล เช่น ผ่านผ่าน ซึ่งจะกันสัญญาณจากตัวเครื่องภายในได้
- อย่าติดตั้งรีโมทคอนโทรลในสถานที่ถูกแสงแดดโดยตรง หรือใกล้กับแหล่งทำความร้อน เช่น เตาไฟ
- เก็บรีโมทคอนโทรลให้ห่างจากเครื่องรับโทรทัศน์หรือเครื่องเสียงที่ใกล้ที่สุดอย่างน้อย 1 เมตร (เพื่อป้องกันการรบกวนของสัญญาณ)
- ตำแหน่งของรีโมทคอนโทรล ถูกกำหนดตามที่แสดงไว้ด้านล่าง

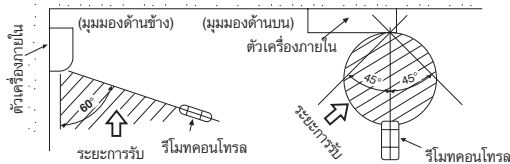

การเจาะรูและการติดแผ่นติดตั้ง

ការទោទ្ទ

เมื่อติดตั้งท่อสารทำความเย็นจากด้านหลัง

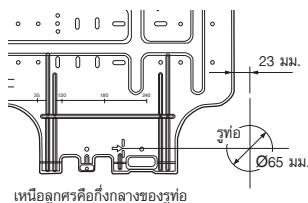


1. หลังจากกำหนดตำแหน่งรูท่อนบนแผ่นยึด (➡) เจาะรูท่อ (Ø65 มม.) ให้เฉียงลงไปตามตัวเครื่องภายนอกเพียงเล็กน้อย

หมายเหตุ

- เมื่อเจาะผนังที่มีโครงโลหะ โครงลวด หรือแผ่นโลหะ ให้ใช้ฉาปิดสำหรับรูท่อซึ่งขายต่างหาก

การตีแผ่แนวคิด

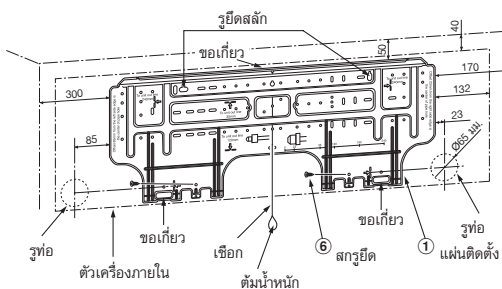


เมื่อติดแผ่นติดตั้งกับผนังโดยตรง

1. ตัดแผนติดตั้งเข้ากับผนัง โดยใช้สกรูยึดที่ส่วนบนและส่วนล่างเพื่อเกาะเข้ากับตัวเครื่องภายใน
2. การติดตั้งติดตั้งบนผนังคอนกรีตด้วยสลักเกลียวเสมอ ให้ใช้สำหรับสลักเกลียวเสมอตามภาพแสดงด้านล่าง
3. ติดตั้งแผ่นติดตั้งบนผนังตามแนวนอน

ข้อควรระวัง

เมื่อติดตั้งแผ่นติดตั้งด้วยสกรูยึด อย่าใช้สำหรับสลักเกลียวสมอ ไม่เช่นนั้น
เครื่องอาจตกลงมาและทำให้ได้รับบาดเจ็บและความเสียหายต่อทรัพย์สิน

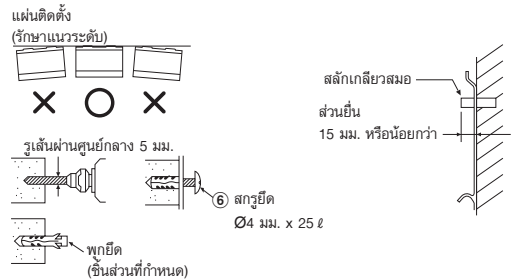

ข้อควรระวัง

การติดตั้งเครื่องไม่มั่นคงอาจทำให้ได้รับบาดเจ็บและความเสียหายต่อทรัพย์สิน
ถ้าเครื่องตกลงมา

- ในกรณีที่ผนังเป็นแบบบล็อก อิฐ คอนกรีต หรือชนิดคล้ายกันนี้ให้เจาะรูขนาดเส้นผ่านศูนย์กลาง 5 มม. ที่ผนัง
- ใส่ทุกยึดสำหรับสกรูยึด ⑥


หมายเหตุ

- ยึดมมส์ด้านและส่วนล่างของแผ่นติดตั้งด้วยสกรียึด 4 ถึง 6 ตัว เพื่อติดตั้ง

การติดตั้งท่อน้ำทิ้งและท่อส่ง

การวางท่อน้ำทิ้งและท่อส่ง


- เนื่องจากหยตน้ำจะทำให้เครื่องมีปัญหา จึงต้องหุ้มฉนวนท่อต่อเชื่อมทั้งสองท่อ (ใช้โฟมโพลีเอธิลีนเป็นฉนวน)

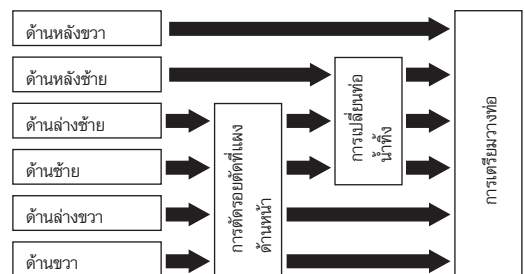

1. การตัดรอยตัดที่แบ่งด้านหน้า
ให้ตัดพลาสติกทางด้านซ้ายหรือขวาของหน้าฉากเครื่องปรับอากาศสำหรับการนำท่อน้ำยา
ออกทางด้านซ้ายหรือขวา และตัดพลาสติกทางด้านล่างซ้ายหรือขวาเพื่อนำท่อออกทางด้านล่าง
โดยใช้ส้อมในการตัดพลาสติก
2. การเปลี่ยนท่อน้ำทิ้ง
สำหรับการต่อท่อทางด้านซ้าย การถอดด้านซ้าย และ การถอดด้านหลังซ้าย จะต้องเปลี่ยน
ท่อน้ำทิ้งและจกปิดท่อน้ำทิ้ง


วิธีการถอดท่อน้ำทิ้ง

- สามารถถอดท่อน้ำทิ้งออกได้ โดยถอดสกรูที่ยึดท่อน้ำทิ้งจากนั้นดึงท่อออก
- เมื่อถอดท่อน้ำทิ้ง ควรระมัดระวังไม่ให้โดนส่วนที่แหลมคมของแผ่นเหล็ก เพราะอาจทำให้บาดเจ็บได้
- ในการประกอบท่อน้ำทิ้ง ให้เสียบท่อน้ำทิ้งให้แน่น จนกระทั่งส่วนเชื่อมต่อสัมผัสกับฉนวนกันความร้อน แล้วยึดด้วยสกรูตัวเดิม



วิธีการถอดจุกปิดท่อน้ำทิ้ง


ใช้คีมหัวแหลมหนีบจุกปิดท่อน้ำทิ้ง แล้วดึงออก



วิธีปิดจุกปิดท่อน้ำทิ้ง

- 1) สอดประแจหกเหลี่ยม (4 มม.) เข้าไปกลางจุกปิดท่อน้ำทิ้ง
- 2) ดันจุกปิดท่อน้ำทิ้งเข้าไปให้แน่น

เวลาใส่จุกปิดท่อน้ำทิ้ง ห้ามใส่น้ำมันหล่อลื่น (น้ำมันหล่อลื่นเครื่องเย็น) เพราะจะทำให้อายุการใช้งานสั้นลง และทำให้เกิดการรั่วที่จุกปิดท่อน้ำทิ้งได้

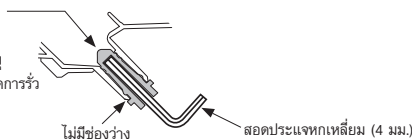


ข้อควรระวัง

ใส่ท่อน้ำทิ้งและจุกปิดท่อน้ำทิ้งให้แน่นหนา มิฉะนั้นน้ำอาจรั่วได้


การต่อท่อด้านขวาหรือซ้าย

- หลังจากรอยตัดที่แผงด้านหน้าด้วยมีดหรือลิ้ม ให้ตัดออกด้วยคีมหรือเครื่องมืออื่นที่คล้ายกัน



การต่อท่อด้านขวาล่างหรือด้านซ้ายล่าง

- หลังจากรอยตัดที่แผงด้านหน้าด้วยมีดหรือลิ้ม ให้ตัดออกด้วยคีมหรือเครื่องมืออื่นที่คล้ายกัน




การต่อท่อออกด้านซ้าย

- ตัดท่อให้ห่างจากผนัง 43 มม. ถ้าตัดท่อมากกว่า 43 มม. อาจทำให้ตัวเครื่องภายในติดบนผนังไม่มั่นคง ดังนั้นควรตัดท่อโดยใช้เครื่องตัดแบบสปริง เพื่อไม่ให้ท่อบุบ

ตัดท่อโดยใช้คีมประมาณ 30 มม.

การต่อท่อส่งหลังการติดตั้งเครื่อง (ดูรูป)

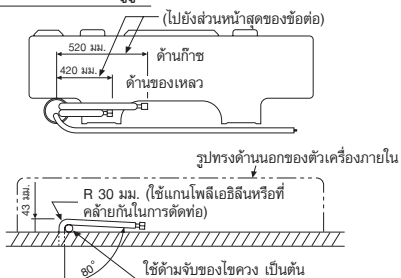


หมายเหตุ

ถ้าตัดท่อไม่ถูกต้อง อาจทำให้ตัวเครื่องภายในติดบนผนังไม่มั่นคง หลังสอดท่อต่อเชื่อมผ่านรูท่อ ต่อท่อต่อเชื่อมเข้ากับท่อจากตัวเครื่องและพันรอบท่อด้วยเทปพันท่อ

ข้อควรระวัง


- พันท่อต่อ (2 ท่อ) และสายเชื่อมต่อเข้าด้วยกันให้แน่นด้วยเทปพันท่อ ในกรณีที่เป็นท่อออกทางซ้ายและทางด้านหลังซ้าย พันเฉพาะท่อต่อ (2 ท่อ) เข้าด้วยกันด้วยเทปพันท่อ

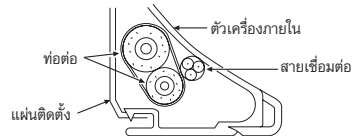


- จัดวางท่ออย่างระมัดระวัง อย่าให้ท่อใดๆ ยื่นออกจากแผ่นหลังของตัวเครื่องภายใน
- ต่อท่อจากตัวเครื่องและท่อต่อเชื่อมเข้าด้วยกันอย่างระมัดระวัง แกะเทปที่หุ้มบนท่อต่อเชื่อมออก เพื่อหลีกเลี่ยงการพันเทปสองชั้นที่ข้อต่อ หุ้มข้อต่อด้วยเทปไวแนล หรืออื่นๆ
- เนื่องจากหยดน้ำจะทำให้เครื่องมีปัญหา จึงต้องหุ้มฉนวนท่อต่อเชื่อมทั้งสองท่อ (ใช้โฟมโพลีเอทิลีนเป็นฉนวน)
- เมื่อตัดท่อ ตัดอย่างระมัดระวังอย่าให้ท่อบุบ

การติดตั้งตัวเครื่องภายใน

1. สอดท่อผ่านช่องในผนัง และเกี่ยวตัวเครื่องภายในบนแผ่นติดตั้งเข้าที่ข้อเกี่ยวบน
2. เลื่อนตัวเครื่องภายในไปมาซ้ายขวา เพื่อทดสอบว่า เครื่องเกี่ยวอยู่บนแผ่นติดตั้งแน่นดีแล้ว
3. ขณะดันตัวเครื่องภายในเข้าไปยังผนัง เกี่ยวเครื่องที่ส่วนล่างบนแผ่นติดตั้ง ดึงตัวเครื่องภายในเข้าหาตัว เพื่อทดสอบว่าเครื่องเกี่ยวอยู่บนแผ่นติดตั้งแน่นดีแล้ว

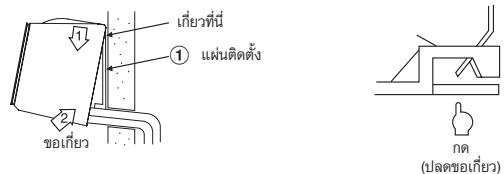


- สำหรับการถอดตัวเครื่องภายในออกจากแผ่นติดตั้ง ให้ดึงตัวเครื่องภายในเข้าหาตัว ขณะดันข้างใต้ตรงส่วนที่ระบุไว้

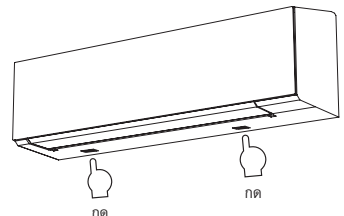

เพื่อทราบ

ส่วนล่างของเครื่องภายในอาจลอยขึ้นมา เนื่องจากสภาพของระบบท่อและไมอาจติดตั้งส่วนดังกล่าว เข้ากับแผ่นติดตั้งได้ ในกรณีดังกล่าว ให้ใช้สกรู ⑩ ที่ให้มา ติดเครื่องเข้ากับแผ่นติดตั้งนั้น




การระบายน้ำ

1. ปลอยท่อน้ำทิ้งให้ลาดลง


หมายเหตุ

- ควรเจาะรูด้านนอกให้ลาดเอียงลงเล็กน้อย

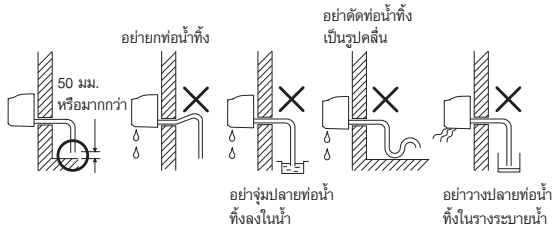

2. ทดลองใส่ในภาชนะน้ำทิ้ง เพื่อทดสอบการระบายน้ำออกสู่ภายนอก


3. เมื่อต่อท่อต่อน้ำทิ้ง หุ้มส่วนเชื่อมต่อท่อต่อน้ำทิ้งด้วยฉนวนหุ้มท่อ



ข้อควรระวัง

จัดวางท่อน้ำทิ้งให้ระบายน้ำจากเครื่องได้สะดวก
การระบายน้ำที่ไม่เหมาะสม ทำให้เกิดการหยดของน้ำได้

เครื่องปรับอากาศนี้ ถูกออกแบบให้ระบายน้ำ
ที่เกิดจากหยดน้ำทิ้ง เกาอยู่ด้านหลังของ
ตัวเครื่องภายในให้ไหลลงภาชนะน้ำทิ้ง
ดังนั้น ไม่ควรติดตั้งสายไฟหรืออุปกรณ์อื่นๆ
เหนือแนวระบายน้ำ



ตัวเครื่องภายนอก

สถานที่ติดตั้ง

- สถานที่ซึ่งมีพื้นที่โดยรอบตัวเครื่องภายนอกตามที่แสดงไว้ในผังการติดตั้ง
- สถานที่ซึ่งรองรับน้ำหนักตัวเครื่องภายนอกได้และไม่เพิ่มระดับเสียงและการสั่น
- สถานที่ซึ่งเสี่ยงจากการทำงานและลมที่เป่าออกมาไม่รบกวนเพื่อนบ้าน
- สถานที่ซึ่งไม่ถูกลมกรรโชก
- สถานที่ซึ่งไม่มีกระแสของก๊าซไอไฟ
- สถานที่ซึ่งไม่เกิดขวางทางเดิน
- เมื่อจะติดตั้งตัวเครื่องภายนอกในตำแหน่งที่ถูกยกขึ้น ยึดขาตัวเครื่องให้แน่น
- ความยาวของท่อต่อที่ใช้ได้

รุ่น	38TVAB016-I
ไม่ต้องเพิ่มสารทำความเย็น	ไม่เกิน 15 เมตร
ความยาวสูงสุด	20 ม.
การเติมสารทำความเย็นเพิ่มเติม	16 - 20 ม. (20 ก. / 1 ม.)
การเติมสารทำความเย็นสูงสุด	0.97 กก.

- ความสูงที่ใช้ได้ของพื้นที่ติดตั้งเครื่องภายนอก

รุ่น	38TVAB016-I
ความสูงไม่เกิน	12 ม.

- ติดตั้งในตำแหน่งซึ่งเครื่องปรับอากาศไม่เกิดปัญหาน้ำฝน หรือติดตั้งในที่ซึ่งระบายน้ำได้ดี
- ติดตั้งในสถานที่ซึ่งสามารถติดตั้งเครื่องปรับอากาศในแนวนอนได้

ข้อควรระวังในการเติมสารทำความเย็น

ใช้เครื่องวัดที่มีความเที่ยงตรง โดยใช้อย่างน้อย 10 กรัม ต่อระดับเข็มวัดเมื่อทำการเติมสารทำความเย็น


ห้ามใช้เครื่องชั่งน้ำหนักทั่วไปหรือเครื่องมือลักษณะเดียวกันนี้

ข้อควรระวัง

เมื่อติดตั้งตัวเครื่องภายนอก ในบริเวณที่มีน้ำในท่อระบายน้ำอาจทำให้เกิดปัญหาได้
ให้ใช้การซิลิโคนหรือวัสดุการเพื่อปิดรอยรั่ว

ข้อควรระวัง

1. ติดตั้งตัวเครื่องภายนอกโดยอย่าให้มีสิ่งกีดขวางการระบายอากาศ
2. เมื่อติดตั้งตัวเครื่องภายนอกในสถานที่ที่มีลมกรรโชกเสมอ เช่น ชายทะเล หรือ
ชั้นสูงๆ ของอาคาร ควรป้องกันการสั่นของพัดลมโดยใช้ท่อลมหรือ
แผ่นกันลม
3. ควรติดตั้งตัวเครื่องภายนอกให้พ้นจากทิศทางลม โดยเฉพาะในบริเวณที่มีลมแรง
4. การติดตั้งในสถานที่ต่อไปนี้ อาจทำให้เกิดปัญหา
อย่าติดตั้งเครื่องในสถานที่ดังนี้
 - ที่ซึ่งเต็มไปด้วยน้ำมันเครื่อง
 - ที่ซึ่งมีความเค็ม เช่น ชายทะเล
 - ที่ซึ่งเต็มไปด้วยก๊าซซัลไฟด์
 - ที่ซึ่งอาจก่อให้เกิดคลื่นความถี่สูง เช่น
จากเครื่องเสียง เครื่องเชื่อมโลหะ และอุปกรณ์ทางการแพทย์



การต่อท่อส่งสารทำความเย็น

การบานท่อ

1. ตัดด้วยเครื่องมือที่ตัดท่อ




2. สวมแฟลร์นัทเข้าไปในท่อและบานท่อ

- ขอบการขยายในการบานท่อ : A (หน่วย : มม.)

RIDGID (แบบคลัทช์)

เส้นผ่านศูนย์กลางภายนอก ของท่อทองแดง	เครื่องมือมาตรฐาน R32	เครื่องมืออื่นที่มีคุณสมบัติ ที่ทดแทนกันได้
Ø6.35	0 ถึง 0.5	1.0 ถึง 1.5
Ø9.52	0 ถึง 0.5	1.0 ถึง 1.5
Ø12.70	0 ถึง 0.5	1.0 ถึง 1.5
ความหนาของท่อ	0.8 มม. หรือมากกว่า	



IMPERIAL (แบบใช้น็อตทางปลา)


เส้นผ่านศูนย์กลางภายนอก ของท่อทองแดง	R32
Ø6.35	1.5 ถึง 2.0
Ø9.52	1.5 ถึง 2.0
Ø12.70	2.0 ถึง 2.5
ความหนาของท่อ	0.8 มม. หรือ มากกว่า

ข้อควรระวัง

- ห้ามฉีกพื้นผิวด้านในของชิ้นส่วนที่ผ่านการแฟลร์แล้ว ขณะกำลังฉีกส่วนขยออก
- หากทำการขยายท่อโดยพื้นผิวด้านในของชิ้นส่วนมีรอยขีดข่วน จะทำให้
สารทำความเย็นรั่วไหล

การขันแน่นข้อต่อ

จัดให้ท่อที่เชื่อมอยู่กึ่งกลาง และขันแฟลร์นัทให้แน่นด้วยมือ จากนั้นจึงขันน็อตด้วย
ประแจปากตายและประแจวัดแรงบิดดังแสดงในภาพ

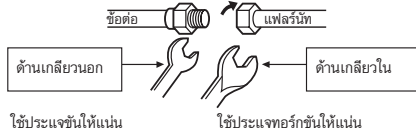

ใช้ประแจขันให้แน่น

ใช้ประแจทอร์คขันให้แน่น

ข้อควรระวัง


อย่าใช้แรงบิดมากเกินไป ไม่เช่นนั้นแป้นเกลียวอาจแตกได้ ขึ้นอยู่กับการติดตั้งด้วย

(หน่วย : นิวตันเมตร)

เส้นผ่านศูนย์กลางภายนอกของท่อทองแดง	แรงบิดในการขันแน่น
Ø6.35 มม.	16 ถึง 18 (1.6 ถึง 1.8 กก.ม.)
Ø9.52 มม.	30 ถึง 42 (3.0 ถึง 4.2 กก.ม.)
Ø12.70 มม.	50 ถึง 62 (5.0 ถึง 6.2 กก.ม.)

• แรงบิดในการขันแน่นการต่อแบบปลายบาน

แรงดันของสารทำความเย็นรุ่น R32 สูงกว่ารุ่น R22 ประมาณ 1.6 เท่า ดังนั้นให้ขันแน่นท่อแบบปลายบาน (ซึ่งเชื่อมต่อตัวเครื่องภายนอกกับตัวเครื่องภายใน) ด้วยแรงบิดที่กำหนดไว้ โดยใช้ประแจวัดแรงบิด ถ้าต่อท่อแบบปลายบานไม่ถูกต้อง นอกจากจะเป็นสาเหตุให้ก๊าซรั่วแล้ว ยังอาจทำให้วงจรสารทำความเย็นเกิดปัญหา



การไล่อากาศออก

หลังต่อท่อส่งเข้าตัวเครื่องภายใน คุณสามารถไล่อากาศพร้อมกันได้


การไล่อากาศ

ไล่อากาศในท่อต่อเชื่อมและในตัวเครื่องภายในด้วยปั๊มสุญญากาศ อย่าใช้สารทำความเย็นในตัวเครื่องภายนอก สำหรับรายละเอียดดูคู่มือของปั๊มสุญญากาศ

การใช้ปั๊มสุญญากาศ

ใช้ปั๊มสุญญากาศที่มีระบบป้องกันการไหลย้อนกลับ เพื่อไม่ให้น้ำมันภายในปั๊มไหลกลับเข้าไปในท่อของเครื่องปรับอากาศเมื่อปั๊มหยุดทำงาน (หากมีน้ำมันที่อยู่ในเครื่องปั๊มสุญญากาศเข้าไปในเครื่องปรับอากาศที่ใช้สารทำความเย็นชนิด R32 อาจทำให้วงจรระบบทำความเย็นของเครื่องปรับอากาศทำงานไม่ได้)

1. เชื่อมต่อจากวาล์วร่วม ไปยังช่องบริการของวาล์วอัดแผ่นปะเก็นที่ด้านก๊าซ
2. ต่อท่อเติมสารทำความเย็นเข้ากับพอร์ทของปั๊มสุญญากาศ
3. เปิดด้ามจับวาล์วเกจท่อร่วมด้านแรงดันต่ำให้สุด
4. เปิดปั๊มเพื่อเริ่มการถ่ายอากาศ การถ่ายอากาศใช้เวลาประมาณ 15 นาที ถ้าท่อส่งมีความยาว 20 เมตร (15 นาที สำหรับ 20 เมตร) (สมมติความสูงของปั๊มคือ 27 ลิตรต่อนาที) และค่าที่ควรอ่านได้จากเกจแรงดันประกอบคือ -101 กิโลปาสกาล (-76 ซม.ปรอท)
5. ปิดด้ามจับวาล์วเกจท่อร่วมด้านแรงดันต่ำ
6. เปิดก้านวาล์วของวาล์วร่วม (ทั้งด้านก๊าซและของเหลว)
7. ถอดท่อเติมสารทำความเย็นออกจากวาล์วบริการ
8. ขันจุกปิดบนวาล์วร่วมให้แน่น

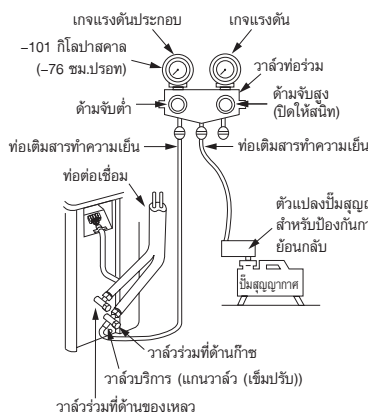

ข้อควรระวัง

• 7 จุดสำคัญในการเดินท่อ

- (1) ขจัด ฟูนและความชื้น (ภายในท่อต่อเชื่อม)
- (2) ขันแน่นข้อต่อ (ระหว่างท่อและตัวเครื่อง)
- (3) ถ่ายอากาศในท่อต่อเชื่อมออกด้วยปั๊มสุญญากาศ
- (4) ตรวจการรั่วของสารทำความเย็น (จุดเชื่อมต่อ)
- (5) โปรดแน่ใจว่าวาล์วร่วมเปิดจนสุดแล้วก่อนใช้งาน
- (6) ห้ามนำคอนเน็คเตอร์เชิงกลที่ใช้กันช้าและข้อต่อที่ผ่านการแฟลร์ มาใช้กับตัวเครื่องภายใน เมื่อนำคอนเน็คเตอร์เชิงกลมาใช้งานเข้ากับตัวเครื่องภายใน จะต้องทำความสะอาดชิ้นส่วนกันรั่วให้เรียบร้อย
- (7) ห้ามใช้งานเครื่องปรับอากาศในกรณีที่ไม่สามารถทำความสะอาดในระบบ

ข้อควรระวังในการควบคุมวาล์วร่วม

- เปิดก้านวาล์วออกตลอดทาง แต่อย่าเปิดเกินตัวสวิตช์เปิด

ขนาดท่อของวาล์วร่วม	ขนาดของประแจหกเหลี่ยม
12.70 มม. และเล็กกว่า	A = 4 มม.
15.88 มม.	A = 5 มม.

กระบวนการปิดปั๊ม

1. ปิดระบบเครื่องปรับอากาศ
2. เชื่อมต่อท่อจากวาล์วร่วม ไปยังช่องบริการของวาล์วอัดแผ่นปะเก็นที่ด้านก๊าซ
3. ปิดระบบเครื่องปรับอากาศให้หมดทำความเย็น ให้นานกว่า 10 นาที
4. ตรวจสอบแรงดันทำงานของระบบ ซึ่งควรจะเป็นค่าปกติ (อ้างอิงข้อมูลจำเพาะผลิตภัณฑ์)
5. คลายฝาปิดก้านวาล์วของวาล์วบริการทั้งสองตัว
6. ใช้ประแจหกเหลี่ยมเพื่อหมุนก้านวาล์วด้านของเหลวให้ปิดสนิท (*ต้องมั่นใจว่าไม่มีอากาศเข้าไปในระบบ)
7. ปิดระบบเครื่องปรับอากาศต่อเนื่องจนกว่าเกจวัดท่อร่วมอ่านค่าได้ 0.5 - 0 กก./ซม.²
8. ใช้ประแจหกเหลี่ยมขันก้านวาล์วด้านก๊าซให้ปิดสนิท และหลังจากนั้นให้ปิดระบบเครื่องปรับอากาศโดยทันที
9. ถอดเกจท่อร่วมออกจากช่องบริการของวาล์วอัดแผ่นปะเก็น
10. ขันฝาปิดก้านวาล์วที่วาล์วบริการทั้งสองตัวให้แน่น


ข้อควรระวัง

ควรจะมีการตรวจสอบสภาวะการทำงานของคอมเพรสเซอร์ ขณะทำการปิดปั๊ม โดยจะต้องไม่ปล่อยดังผลิตภัณฑ์

หากมีสภาวะการทำงานที่ผิดปกติเกิดขึ้น ต้องปิดระบบเครื่องปรับอากาศในทันที

- ขันฝาครอบลิ้นวาล์วให้แน่นด้วยแรงบิดตามตารางต่อไปนี้

จุก	ขนาดของจุก (H)	แรงบิด
จุกปิดก้านวาล์ว	H17 - H19	14~18 นิวตันเมตร (1.4 ถึง 1.8 กก.ม.)
	H22 - H30	33~42 นิวตันเมตร (3.3 ถึง 4.2 กก.ม.)
จุกปิดวาล์วบริการ	H14	8~12 นิวตันเมตร (0.8 ถึง 1.2 กก.ม.)
	H17	14~18 นิวตันเมตร (1.4 ถึง 1.8 กก.ม.)

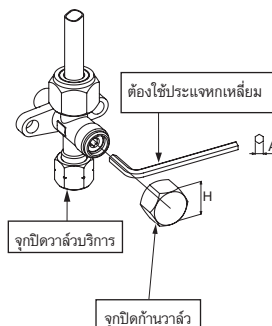

การทำงานเกี่ยวกับไฟฟ้า


รุ่น	42TVAB016 Series
แหล่งจ่ายไฟฟ้า	50Hz 220V 1 เฟส
กระแสไฟฟ้าสูงสุด	7.50A
ขนาดเบรกเกอร์วงจรไฟฟ้า	15A
สายของแหล่งจ่ายไฟ	มากกว่า H07RN-F หรือ 60245 IEC66 (1.25 มม. ² หรือมากกว่านั้น)
สายเชื่อมต่อ	มากกว่า H07RN-F หรือ 60245 IEC66 (0.75 มม. ² หรือมากกว่านั้น)

การเชื่อมต่อสายไฟ

ตัวเครื่องภายใน


การเดินสายเชื่อมต่อทำได้โดยไม่ต้องถอดแผงด้านหน้าออก

1. ถอดหน้ากากด้านหน้า
2. เปิดหน้ากากด้านหน้าขึ้นและดึงเข้าหาตัว
3. ถอดฝาครอบขั้วต่อและตัวยึดสายไฟ
3. สอดสายเชื่อมต่อ (ตามที่กำหนดไว้) เข้าไปในรูที่ผนัง
4. ดึงสายเชื่อมต่อผ่านช่องสายไฟที่แผงด้านหลัง ให้สายไฟโผล่ออกมาด้านหน้าประมาณ 20 ซม.
5. สอดสายเชื่อมต่อเข้าไปในบล็อกขั้วต่อให้สุด และยึดให้แน่นด้วยสกรู
6. แร่งบิดในการขันแน่น : 1.2 นิวตันเมตร (0.12 กก.ม.)
7. ยึดสายเชื่อมต่อให้แน่นด้วยตัวยึดสายไฟ
8. ติดฝาครอบขั้วต่อ ตัวรองแผ่นด้านหลัง และหน้ากากด้านหน้าที่ตัวเครื่องภายใน

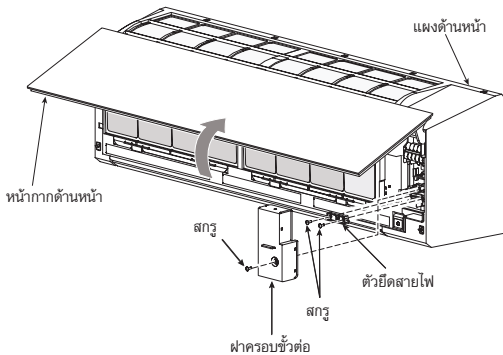


วิธีการติดตั้งหน้ากากด้านหน้าที่ตัวเครื่องภายใน

- สำหรับการประกอบหน้ากากด้านหน้า ให้ประกอบในลำดับย้อนกลับกับการถอด

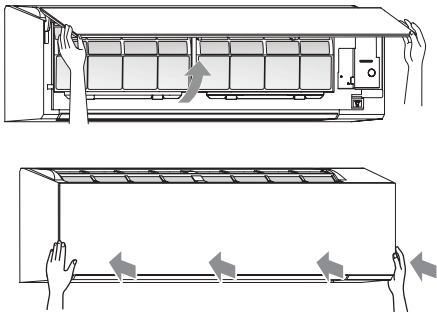


ตัวเครื่องภายนอก

1. ถอดฝาครอบบวาล์ว, ฝาครอบส่วนที่เป็นไฟฟ้าและตัวยึดสายไฟ ออกจากตัวเครื่องภายนอก
2. ต่อสายเชื่อมต่อเข้ากับขั้วต่อตามที่ระบุไว้ โดยให้หมายเลขตรงกับบล็อกขั้วต่อของตัวเครื่องภายในและภายนอก
3. เลียบสายไฟและสายเชื่อมต่อเข้าไปในบล็อกขั้วต่อให้สุดอย่างระมัดระวัง แล้วยึดไว้ด้วยสกรู
4. ใช้เทปฉนวนหรืออื่นๆ พันรอบๆ สายไฟที่ไม่ได้ใช้ จัดวางสายไฟให้ดีเพื่อให้สายไฟสัมผัสกับชิ้นส่วนที่มีไฟฟ้าหรือชิ้นส่วนที่มีโลหะใดๆ
5. ยึดสายไฟและสายเชื่อมต่อเข้ากับตัวยึดสายไฟ
6. ประกอบฝาครอบส่วนที่เป็นไฟฟ้าและฝาครอบบวาล์วลงบนตัวเครื่องด้านนอก

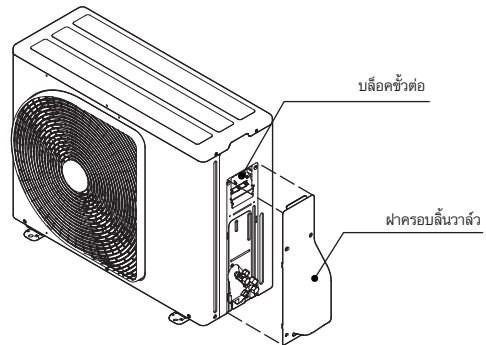

แหล่งจ่ายไฟและการเชื่อมต่อสายเชื่อมต่อ

กำลังกระแสไฟฟ้าของแหล่งจ่ายไฟที่ปลั๊กหัวต่อของตัวเครื่องภายนอก

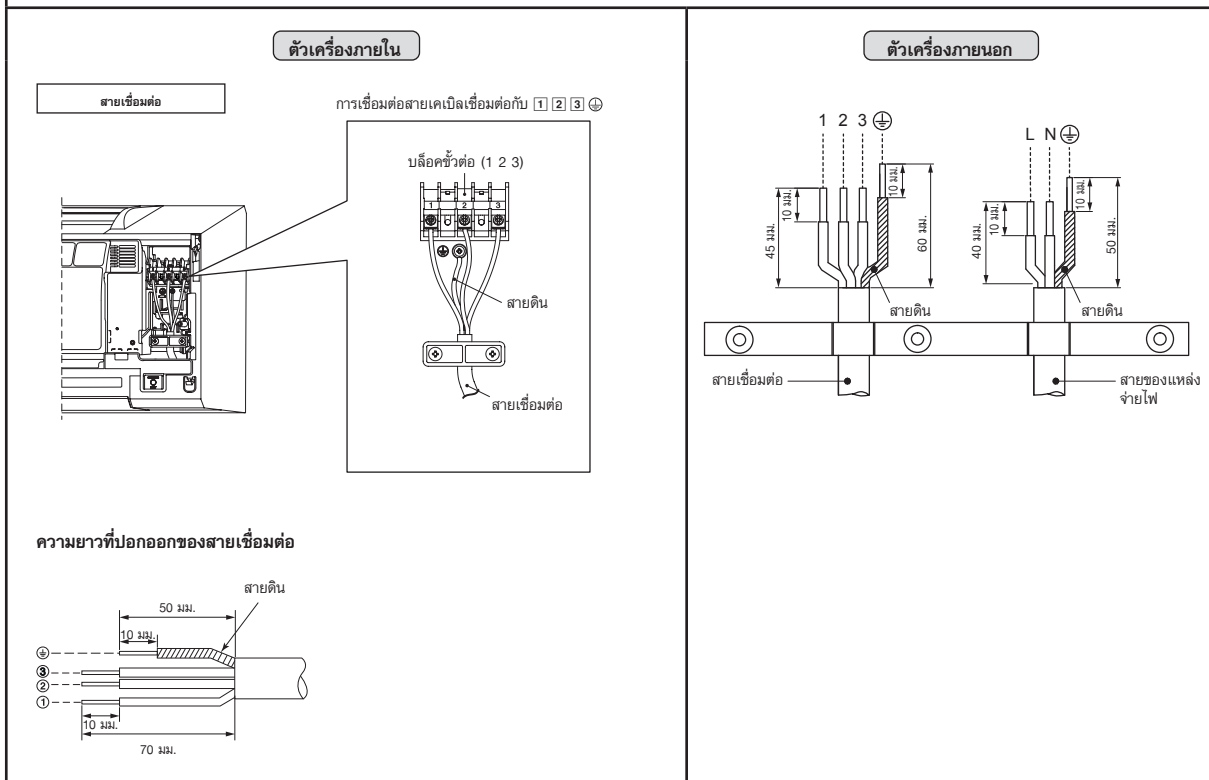


ข้อควรระวัง

1. แหล่งจ่ายไฟต้องเหมือนกับฟีดของเครื่องปรับอากาศ
2. ควรมีแหล่งจ่ายไฟสำหรับการใช้งานของเครื่องปรับอากาศโดยเฉพาะ
3. สายไฟของแหล่งจ่ายไฟสำหรับเครื่องปรับอากาศนี้ต้องใช้เบรคเกอร์วงจรไฟฟ้า
4. ควรแน่ใจว่าขนาดและวิธีการเดินสายไฟของแหล่งจ่ายไฟและสายเชื่อมต่อเป็นไปตามข้อกำหนด
5. สายทุกเส้นต้องเชื่อมต่อกันอย่างแน่นหนา
6. เดินสายไฟเพื่อให้เกิดความเสี่ยงของการเดินสายไฟปกติทั่วไป
7. การเชื่อมต่อสายที่ไม่ถูกต้องอาจทำให้อุปกรณ์ทางไฟฟ้าเสียหายหรือเกิดไฟไหม้ได้
8. การเดินสายไฟที่ไม่ถูกต้องหรือไม่สมบูรณ์ จะทำให้เกิดการติดไหมหรือควันไฟได้
9. ผลิตภัณฑ์นี้สามารถเชื่อมต่อกับแหล่งจ่ายไฟหลักได้

การเชื่อมต่อการเดินสายไฟแบบตายตัว : สวิตช์ที่ตัดการเชื่อมต่อหัวสายไฟทุกหัว และมีระยะห่างหน้าสัมผัสอย่างน้อย 3 มม. ในทุกหัวสายไฟ ต้องใช้ร่วมในการเดินสายแบบตายตัว

ระบบอื่นๆ

การทดสอบการรั่วของสารทำความเย็น

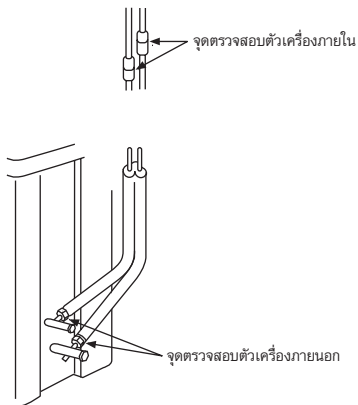

- ตรวจสอบการต่อฟลักซ์ เพื่อหาการรั่วของสารทำความเย็นด้วยเครื่องตรวจการรั่วของสารทำความเย็นหรือน้ำสบู่


การเลือกรีโมทคอนโทรล A-B

- การติดตั้งเครื่องปรับอากาศสองตัวในห้องเดียวกันหรือห้องที่เชื่อมติดกัน หากสั่งการใช้งานด้วยรีโมทคอนโทรล เครื่องปรับอากาศทั้งสองตัวจะได้รับสัญญาณและทำงานเหมือนกัน ในกรณีนี้สามารถตั้งให้เครื่องปรับอากาศและรีโมทคอนโทรลคู่ใดคู่หนึ่งเป็นแบบ B ได้ (เครื่องปรับอากาศจะถูกตั้งเป็นแบบ A มาจากโรงงาน)
- หากตั้งค่าระหว่างรีโมทคอนโทรลและตัวเครื่องภายในไม่เหมือนกัน จะไม่สามารถส่งสัญญาณถึงกันได้
- การต่อท่อและสายไฟ ไม่เกี่ยวข้องกับการตั้งค่าแบบ A หรือการตั้งค่าแบบ B และห้องแบบ A หรือห้องแบบ B


การแยกใช้รีโมทคอนโทรลควบคุมการทำงานชุดภายในแต่ละตัว ในกรณีที่ติดตั้งเครื่องปรับอากาศสองเครื่องใกล้กัน

การตั้งรีโมทคอนโทรล B

1. กดปุ่ม [RESET] ที่ชุดภายในเพื่อเปิดเครื่องปรับอากาศ
2. ชีรีโมทคอนโทรลไปที่ชุดภายใน
3. กดปุ่ม [CHECK] ที่ด้านหลังของรีโมทคอนโทรลค้างไว้ "00" จะแสดงขึ้นมาบนหน้าจอ (รูป ①)

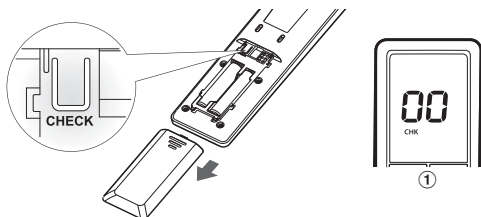


4. กดปุ่ม [MODE] ในขณะที่ยกปุ่ม [CHECK] ค้างไว้อยู่ สัญลักษณ์ "B" จะแสดงขึ้นมาบนหน้าจอ และข้อความ "00" จะหายไป และเครื่องปรับอากาศจะเปิดการทำงานรีโมทคอนโทรล B ถูกบันทึกไว้แล้ว (รูป ②)



- หมายเหตุ : 1. ทำซ้ำขั้นตอนด้านบนเพื่อรีเซ็ตรีโมทคอนโทรลไปเป็นรีโมทคอนโทรล A
2. รีโมทคอนโทรล A จะไม่แสดงสัญลักษณ์ "A"
 3. ค่าที่ตั้งมาจากโรงงานคือ A

การทดสอบ

เพื่อสลับไปยังโหมด TEST RUN (COOL) กดปุ่ม [RESET] ค้างไว้ 10 วินาที (จะเกิดเสียงบี๊บสั้นๆ)

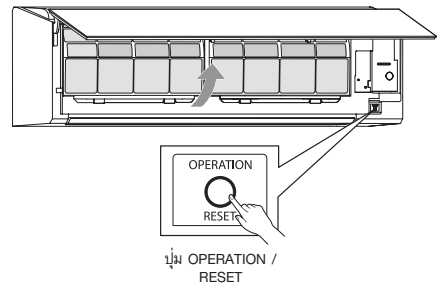

การตั้งค่าระบบเริ่มทำงานใหม่โดยอัตโนมัติ

ผลิตภัณฑ์นี้ถูกออกแบบมาเพื่อให้สามารถเริ่มทำงานใหม่หลังไฟฟ้าขัดข้อง เครื่องจะเริ่มทำงานอีกครั้งในสภาวะเดิมได้โดยอัตโนมัติ

เพื่อทราบรายละเอียด

ระบบเริ่มทำงานใหม่โดยอัตโนมัติของผลิตภัณฑ์นี้อยู่ที่ตำแหน่งเปิดเป็นค่าเริ่มต้นจากบริษัทผู้ผลิต และสามารถทำการปิดใช้ระบบนี้ได้เมื่อไม่ต้องการ

วิธีการปิดระบบเริ่มทำงานใหม่อัตโนมัติ

- กดปุ่ม [OPERATION] ที่เครื่องภายในค้างไว้ 3 วินาที (มีเสียงบี๊บ 3 ครั้ง แต่ไฟแสดงการทำงานไม่กะพริบ)

วิธีการเปิดระบบเริ่มทำงานใหม่อัตโนมัติ

- กดปุ่ม [OPERATION] ที่เครื่องภายในค้างไว้ 3 วินาที (มีเสียงบี๊บ 3 ครั้ง และไฟแสดงการทำงานกะพริบ 5 ครั้งต่อวินาทีเป็นเวลา 5 วินาที)

หมายเหตุ

- ในกรณีที่มีการตั้งเวลาเปิดหรือการตั้งเวลาปิด ระบบนี้จะไม่ทำงาน

ภาคผนวก

คำชี้แจงการใช้งาน

ท่อ R22 และ R410A ที่มียูนิทสามารถนำมาใช้กับการติดตั้งผลิตภัณฑ์ อินเวอร์เตอร์ R32

คำเตือน

ให้ตรวจสอบว่าท่อที่ร้อยเคเบิล หรือยึดขั้วหรือบน พร้อมทั้งสภาพที่เหมาะสมและเหมาะสมก่อนการใช้งานได้

ถ้าสภาพของท่อสามารถตรวจสอบ และมั่นใจในการใช้งานได้ก็จะสามารถใช้อุณหภูมิของเคเบิล R22 และ R410A สำหรับ R32 ได้

สภาพพื้นฐานที่จำเป็นต่อการใช้อุณหภูมิที่อยู่ในระบบ

กรุณาตรวจสอบและสังเกตสภาพสามข้อต่อไปนี้

1. แหล่ง (ไม่มีความร้อนในท่อ)
2. สะอาด (ไม่มีฝุ่นในท่อ)
3. แบนหนา (ไม่มีรอยรั่วในท่อ)

ข้อห้ามสำหรับการใช้ท่อที่มียูนิท

ในกรณีต่อไปนี้ ท่อที่มียูนิทจะไม่สามารถกลับมาใช้ได้

ให้ทำความสะอาดท่อที่มียูนิท หรือเปลี่ยนท่อใหม่

1. เมื่อมีรอยร้าวหรือรอยบวมที่ท่อจน ให้ใช้อุปกรณ์สำหรับทำความสะอาด
2. เมื่อความหนาของท่อที่มียูนิทนั้น บวมกว่าความหนาที่กำหนด "เส้นผ่านศูนย์กลางของท่อและความหนา"
 - แรงดันที่ใช้ในงาน R32 สูง (1.6 เท่าของ R22) ท่อมีการรั่วหรือรอยบวมของท่อ หรือใช้เวลานานกว่าที่กำหนด อาจทำให้ท่อไม่สามารถทนแรงดันได้ ซึ่งส่งผลทำให้แตก

* ขนาดเส้นผ่านศูนย์กลางและความหนาของท่อ (มม.)

ความหนา	เส้นผ่านศูนย์กลางภายนอกของท่อ	
	R32, R410A	R22
Ø6.4	Ø9.5	Ø12.7
0.8	0.8	0.8

3. เมื่อระบบท่อแยกมีท่อที่ไม่ได้เชื่อมต่อ หรือมีก๊าซรั่วจากท่อ และท่อยังไม่ได้รับการซ่อมและเปลี่ยนใหม่

• อาจเป็นเพราะฝุ่นหรืออากาศ รวมถึงความชื้นที่เข้าไปในท่อ

4. เมื่อท่อเย็นไม่สามารถกลับมาทำงานได้ แม้ว่าจะใช้อุปกรณ์ซ่อมท่อแล้วก็ตาม

• เป็นไปได้ว่า ฝุ่นมันบนเนื้อหรือมีน้ำมันที่เข้ามาในท่อ

5. หากมีอุปกรณ์ดูดความชื้นติดตั้งอยู่ในท่อสำหรับทำความเย็น

• อาจทำให้มีสิ่งสกปรกของแข็งเกิดขึ้นในท่อ

6. เมื่อเครื่องรับอากาศเดิมถูกถอดออกหรือจากการนำสารทำความเย็นออกจากท่อแล้ว

ให้ตรวจสอบความดันนั้น หากแตกต่างจากปกติจะไม่สามารถนำกลับมาใช้ได้

- หากเปลี่ยนท่อของแข็ง นั้นขึ้นสองหรือความเย็นจะเป็นสีเขียว
- มีความดันไม่มีความดันไม่ผสมกันนั้นขึ้นมากในท่อ
- น้ำแข็งเปลี่ยนสี หรือสิ่งสกปรกจำนวนมาก หรือมีกลิ่นไม่พึงประสงค์
- มีเสียงหรือสิ่งสกปรกจำนวนมากที่สามารมองเห็นได้

ของสารทำความเย็น

7. เมื่อเครื่องรับอากาศเดิมมีประวัติคอมเพรสเซอร์เสียและเคยถูกเปลี่ยนมาแล้ว

- เมื่อพ่นน้ำมันเปลี่ยนสี ผงโลหะ สิ่งสกปรก หรือสิ่งแปลกปลอมเจือปนอาจทำให้เกิดปัญหา

8. เมื่อมีการติดตั้งและถอดออกของเครื่องรับอากาศซ้ำไปรับมา เช่น สัญญาณเพื่อ

9. หากประเภทของสารทำความเย็นของเครื่องรับอากาศที่มียูนิท ไม่ใช่ น้ำมันต่อไปนี้ (น้ำมันแฉะ), Suniso, Freol-S, MS (น้ำมันสังเคราะห์) อีอีบีบีบีบี (HAB, Barrel freeze) ซุโดเอสเทอร์ PVE จีอีอีวี เป็นกลุ่มของอีอีวี

- ฉนวนกันความร้อนของเครื่องคอมเพรสเซอร์เสื่อมสภาพลง

หมายเหตุ

คำอธิบายเบื้องต้นเป็นสิ่งที่ได้การรับรองโดยบริษัทของเรา และอธิบายถึงมุมมองของเรา สำหรับผลิตภัณฑ์เครื่องรับอากาศของบริษัท แต่ไม่ได้รับรองว่าการใช้อุณหภูมินี้จะใช้ได้กับ R32

การรักษาท่อ

เมื่อทำการถอดเครื่องรับอากาศมาในและภายนอกเป็นระยะเวลานานๆ ให้ทำการเก็บรักษาตามคำแนะนำดังต่อไปนี้:

- หากไม่มีการทำความสะอาดและ สันนิยาถึงขึ้นหรือความชื้นหรือสารอื่นเนื่องจากความชื้นในท่อ
- สันนิยาถึงขึ้นหรือความชื้นและอาจ ได้จากการทำความเย็น และจำเป็นต้องเปลี่ยนท่อใหม่

จุดเปลี่ยนอุปกรณ์	ระยะเวลา	วิธีการเก็บ
ภายนอก	1 เดือนหรือมากกว่านั้น	ทำให้แห้ง
	น้อยกว่า 1 เดือน	ทำให้แห้งหรือพันเทปขาว
ภายใน	ทุกครั้ง	

หอยรื้อของบรูในท่อที่ใช้ในปัจจุบันหรือไม่

ใช่

ท่อที่ใช้ภายใน: ไม่สามารถใช้ได้

• ให้ใช้ท่อใหม่

หอยรื้อของบรูในท่อที่ใช้ในปัจจุบันหรือไม่

ใช่

- หลังจากเครื่องรับอากาศที่มียูนิทได้ใช้งานไม่หมดทำความเย็นประมาณ 30 นาที หรือนานกว่านั้น -ทำการเก็บสภาพความเย็น
- เพื่อทำความสะอาดและเก็บน้ำมันออกจากท่อ
- การเก็บสภาพความเย็น: ให้ใช้วิธีนี้

ความดันที่เก็บในท่อ: 0.5 MPa

- ให้ถอดเครื่องรับอากาศที่มียูนิทในระบบท่อและให้ระบบท่อ (ความดัน) 0.5 MPa เพื่อให้น้ำมันที่ค้างในท่อออก

หมายเหตุ: ในกรณีท่อ ให้ตรวจสอบว่าได้รื้อท่อเรียบร้อยแล้ว

มีกรรขรของน้ำมันหรือสิ่งสกปรกค้างออกมาหรือไม่ (เมื่อน้ำมันเปลี่ยนสีหรือสิ่งสกปรก)

ใช่

ให้ทำความสะอาดท่อใหม่

ให้เชื่อมต่อหน่วยภายในและภายนอกกับท่อที่ใช้อุณหภูมิ

- ให้ใช้แฟลร์ที่ติดอยู่กับเครื่องหลัก สำหรับเครื่องภายในและภายนอก (ห้ามใช้แฟลร์ที่ติดอยู่กับท่อที่มียูนิทแล้ว)
- ทำการแฟลร์เพื่อให้อุณหภูมิให้มีความดันเดียวกัน R32

ให้ทำความสะอาดและตรวจสอบความดันของก๊าซ

ทดสอบความดันของอากาศ

ทดสอบเดินเครื่อง

ความกว้างของแฟลร์: H	
เส้นผ่านศูนย์กลางภายนอกของท่อ	Ø6.4
สำหรับ R32, R410A	17
สำหรับ R22	22
เพิ่มอีก 1 มม.	24

เส้นผ่านศูนย์กลางภายนอกของท่อ	Ø6.4	Ø9.5	Ø12.7
สำหรับ R32, R410A	9.1	13.2	16.6
สำหรับ R22	9.0	13.0	16.2

จะขนาดใหญ่มากกว่าเส้นผ่านศูนย์กลาง R22

ไม่ทำสำหรับการเชื่อมเข้าของแฟลร์



1126350110